

Commercial/Industrial Floodplain Development Permit

Doddridge County, WV Floodplain Management

This permit has been issued to **Dominion Transmission, Inc.** and is for the approved commercial and/or industrial development project associated with this permit that impacts the FEMA-designated floodplain and/or floodway of Doddridge County, WV, pursuant to the rules and regulations established by all applicable Federal, State and local laws and ordinances, including the Doddridge County Floodplain Ordinance. This permit must be posted at the site of work as to be clearly visible, and must remain posted during entirety of development.

Permit #:15-361

Date Approved: 07/20/2015

Expires: 07/20/2016

Issued to: Dominion Transmission, Inc.

POC: Robert Jennings (804) 273-3737

Company Address: 5000 Dominion Blvd., Glen Allen, VA 23060

Project Address: South F ork of Hughes River, (CR 40)

Firm: 225C

Lat/Long: 39.1797950367N/80.7624598038W

Purpose of development: New building

Issued by: George C. Eidel, Doddridge County FPM (or designee)

Date: 20 July, 2015

For additional information regarding this permit, please contact
Doddridge County Floodplain Manager at 304.873.2631, or via email at
doddridgecountyfpm@gmail.com
118 East Court Street; West Union, WV 26456

SENDER: COMPLETE THIS SECTION		COMPLETE THIS SECTION ON DELIVERY	
<ul style="list-style-type: none"> Complete items 1, 2, and 3. Also complete item 4 if Restricted Delivery is desired. Print your name and address on the reverse so that we can return the card to you. Attach this card to the back of the mailpiece, or on the front if space permits. 		A. Signature <i>X Mike Triplett</i> <input type="checkbox"/> Agent <input type="checkbox"/> Addressee	
1. Article Addressed to: <i>15-361</i> I.L. (Ike) Morris PO Box 397 Glennville, WV 26351		B. Received by (Printed Name) <i>Mike Triplett</i>	C. Date of Delivery <i>6-23-15</i>
		D. Is delivery address different from item 1? <input type="checkbox"/> Yes <input type="checkbox"/> No If YES, enter delivery address below:	
		3. Service Type <input checked="" type="checkbox"/> Certified Mail <input type="checkbox"/> Express Mail <input type="checkbox"/> Registered <input type="checkbox"/> Return Receipt for Merchandise <input type="checkbox"/> Insured Mail <input type="checkbox"/> C.O.D.	
2. Article Number (Transfer from service label)		4. Restricted Delivery? (Extra Fee) <input type="checkbox"/> Yes	
		7013 2250 0001 6914 9947	
PS Form 3811, February 2004		Domestic Return Receipt	102595-02-M-1540

U.S. Postal Service™
CERTIFIED MAIL™ RECEIPT
(Domestic Mail Only; No Insurance Coverage Provided)

For delivery information visit our website at www.usps.com

OFFICIAL USE

Postage	\$ <i>49</i>
Certified Fee	<i>3.45</i>
Return Receipt Fee (Endorsement Required)	<i>2.82</i>
Restricted Delivery Fee (Endorsement Required)	<i>6.74</i>


15-361

7013 2250 0001 6914 9947

Se
St
or
Ci

I.L. (Ike) Morris
PO Box 397
Glennville, WV 26351

PS See Reverse for Instructions



9/18/15

re-issued
They Never received
this permit

Sert 8
John Terlingo
600 Market Place Ave
Suite 301
Bridgeport WV
26330

Floodplain Development Permit

Doddridge County, WV Floodplain Management

This permit gives approval for the development/ project listed that impacts the FEMA-designated floodplain and/or floodway of Doddridge County, WV, pursuant to the rules and regulations established by all applicable Federal, State and local laws and ordinances, including the Doddridge County Floodplain Ordinance. This permit must be posted at the site of work as to be clearly visible, and must remain posted during entirety of development.

Permit: # 15-361

West Union

Date Approved: 07/20/2015

Expires: 07/20/2016

Issued to: Dominion Transmission, Inc.

POC: Robert Jennings

804-273-3737

**Company Address: 5000 Dominion Blvd.,
Glen Allen, VA 23060**

Project Address: South Fork of Hughes River, (CR 40)

Firm: #225C

Lat/Long: 39.179795036N/80.7624598038W

Purpose of development: New Building

Issued by: George C Eidel, Doddridge County FPM (or designee)

Date: 09/18/2015

For additional information regarding this permit, please contact
Doddridge County Floodplain Manager at 304.873.2631, or via email at
doddridgecountyfpm@gmail.com
118 East Court Street; West Union, WV 26456

Legal Advertisement:
Doddridge County
Floodplain Permit Application

Please take notice that on the 1st day of June, 2015

Dominion Transmission, Inc.

filed an application for a Floodplain Permit to develop land located at or about:

Southwest District

39.1797950367N/80.7624598038W

Permit #15-361 2015 Maxwell Compressor Station – New Building

The Application is on file with the Clerk of the County Court and may be inspected or copied during regular business hours. Any interested persons who desire to comment shall present the same in writing by **July 06 , 2015**, delivered to:

Clerk of the County Court

118 E. Court Street, West Union, WV 26456

Beth A Rogers, Doddridge County Clerk

Edwin L. "Bo" Wriston. Doddridge County Flood Plain Manager

15-361

Dominion Resources Services, Inc.
5000 Dominion Boulevard,
Glen Allen, VA 23060



DE W. A. HUBBARD
COUNTY CLERK
DODDRIDGE COUNTY, WV

May 21, 2015

BY OVERNIGHT (OR EXPRESS) MAIL

Mr. Edwin "Bo" Wriston
Doddridge County Floodplain Manager
118 East Court Street, Room 102
West Union, WV 26456
DoddridgeCountyFPM@gmail.com

RE: Flood Plain Development Permit Application
Dominion Transmission, Inc.
2015 Maxwell Compressor Station – New Building
Southwest District, Doddridge County, West Virginia

Dear Mr. Wriston:

Dominion Transmission, Inc. (DTI) has enclosed for your review the Doddridge County Flood Plain Permit Application for the 2015 Maxwell Compressor Station – New Building (Project) in Southwest District, Doddridge County, West Virginia, with applicable \$1,730.00¹ fee made payable to the Doddridge County Commission (Enclosure 1).

DTI is planning to construct one (1) new compressor station building within the existing graveled and fenced lot of the Maxwell Compressor Station. The new building is needed in order for DTI to house a new compressor engine. The building will be located near GPS coordinates 39.1797950367, -80.7624598038, off of South Fork of Hughes River Road (CR 40) in West Union, West Virginia, 26456.

The new building will be constructed with the FEMA-mapped 100-year floodplain of the South Fork Hughes River. The building will be approximately 42-foot wide by 42-foot long by 30-foot high. The building will be constructed of steel and will be on a poured concrete pad that will be five (5)-feet deep.

As listed in Section 6 – As Built Elevations, elevations will be provided to the County at the completion of the construction activities.

¹ The fee was calculated based on the total construction costs of \$245,055.00.
\$1,000.00 base fee + \$5.00 * \$146,000.00 = \$1,730.00.

Mr. Edwin "Bo" Wriston
DTI – 2015 Maxwell Compressor Station – New Building
Page 2

If you have any questions concerning the application or need additional information, please contact Robert Jennings at (804) 273-3737 or Robert.H.Jennings@dom.com. Please direct your response to:

Robert Jennings
Dominion Resources Services, Inc.
5000 Dominion Boulevard
Glen Allen, VA 23060
Robert.H.Jennings@dom.com

Sincerely,

A handwritten signature in cursive script, appearing to read "Paula A. Hamel".

Paula A. Hamel
Director, Gas Environmental Business Support

Enclosures:

Doddridge County Flood Plain Permit Application
\$1,730.00 check made payable to Doddridge County Commission
Project mapping and photographs

ENCLOSURE 1

DODDRIDGE COUNTY FLOOD PLAIN
DEVELOPMENT PERMIT APPLICATION AND FEE PAYMENT

**DODDRIDGE COUNTY
FLOODPLAIN DEVELOPMENT PERMIT APPLICATION**

SECTION 1: GENERAL PROVISIONS (APPLICANT TO READ AND SIGN)

1. No work may start until a permit is issued.
2. The permit may be revoked if any false statements are made herein.
3. If revoked, all work must cease until permit is re-issued.
4. Development shall not be used or occupied until a Certificate of Compliance is issued.
5. The permit will expire if no work is commenced within six months of issuance.
6. Applicant is hereby informed that other permits may be required to fulfill local, state, and federal requirements.
7. Applicant hereby gives consent to the Floodplain Administrator/Manager or his/her representative to make inspections to verify compliance.
8. I THE APPLICANT CERTIFY THAT ALL STATEMENTS HEREIN AND IN ATTACHMENTS TO THIS APPLICATION ARE, TO THE BEST OF MY KNOWLEDGE, TRUE AND ACCURATE.

APPLICANT'S SIGNATURE _____



DATE _____

5-20-15

SECTION 2: PROPOSED DEVELOPMENT (TO BE COMPLETED BY APPLICANT).

IF THE APPLICANT IS NOT A NATURAL PERSON, THE NAME, ADDRESS, AND TELEPHONE NUMBER OF A NATURAL PERSON WHO SHALL BE APPOINTED BY THE APPLICANT TO RECEIVE NOTICE PURSUANT TO ANY PROVISION OF THE CURRENT DODDRIDGE COUNTY FLOODPLAIN ORDINANCE.

APPLICANT'S NAME: Dominion Transmission, Inc.

ADDRESS: 5000 Dominion Boulevard, Glen Allen, VA 23060

TELEPHONE NUMBER: (804) 273-3737

CONTRACTOR NAME: LR Builds, Inc. - Sheldon E. Raber, VP

ADDRESS: One Railroad Street, Shinnston, WV 26431

TELEPHONE # (304) 592-2083

WV CONTRACTOR LICENCE # WV000081

ENGINEER'S NAME: Derek Ingle

ADDRESS: 335 US Highway 33W, Weston, WV 26452

TELEPHONE NUMBER: (304) 269-6990

PROJECT LOCATION: GPS Coordinates: 39.1797950367, -80.7624598038

PHYSICAL ADDRESS: South Fork of Hughes River Road (CR 40) in West Union, West Virginia, 26456

NAME OF SURFACE OWNER/OWNERS (IF NOT THE APPLICANT): Dominion Transmission, Inc.

ADDRESS OF SURFACE OWNER/OWNERS (IF NOT THE APPLICANT):

445 West Main St, Clarksburg, WV 26301

DISTRICT: Southwest District

LAND BOOK DESCRIPTION: 5.4 acres & 0.89 acres

DEED BOOK REFERENCE: 5.4 acres - 83/272; 0.89 acres - 162/325

TAX MAP REFERENCE: Doddridge County – Southwest District – Map 10; Parcel Number Not Available

EXISTING BUILDINGS/USES OF PROPERTY: Existing DTI Compressor Station (Maxwell Station);

One compressor building and associated above-ground facilities on-site

NAME OF AT LEAST ONE ADULT RESIDING IN EACH RESIDENCE LOCATED UPON THE SUBJECT PROPERTY N/A

ADDRESS OF AT LEAST ONE ADULT RESIDING IN EACH RESIDENCE LOCATED UPON THE SUBJECT PROPERTY N/A

To avoid delay in processing the application, please provide enough information to easily identify the project location.

DESCRIPTION OF WORK (CHECK ALL APPLICABLE BOXES)

A. STRUCTURAL DEVELOPMENT

ACTIVITY	STRUCTURAL TYPE
<input checked="" type="checkbox"/> <u>New Structure</u>	<input type="checkbox"/> Residential (1 – 4 Family)
<input type="checkbox"/> Addition	<input type="checkbox"/> Residential (more than 4 Family)
<input type="checkbox"/> Alteration	<input type="checkbox"/> Non-residential (floodproofing)
<input type="checkbox"/> Relocation	<input type="checkbox"/> Combined Use (res. & com.)
<input type="checkbox"/> Demolition	<input type="checkbox"/> Replacement
<input type="checkbox"/> Manufactured/Mobil Home	<input checked="" type="checkbox"/> <u>Industrial (Compressor Station Building)</u>

B. OTHER DEVELOPMENT ACTIVITIES:

- Fill Mining Drilling Pipelining
- Grading**
- Excavation (except for STRUCTURAL DEVELOPMENT checked above)
- Watercourse Alteration (including dredging and channel modification)
- Drainage Improvements (including culvert work)
- Road, Street, or Bridge Construction
- Subdivision (including new expansion)
- Individual Water or Sewer System
- Other (please specify)

C. STANDARD SITE PLAN OR SKETCH

1. SUBMIT ALL STANDARD SITE PLANS, IF ANY HAVE BEEN PREPARED (ENGINEERING PLANS MUST BE SIGNED AND SEALED).
2. IF STANDARD SITE PLANS HAVE NOT BEEN PREPARED:
SKETCH ON A SEPARATE 8 ½ X 11 INCH SHEET OF PAPER THE SHAPE AND LOCATION OF THE LOT. SHOW THE LOCATION OF THE INTENDED CONSTRUCTION OR LAND USE INDICATING BUILDING SETBACKS, SIZE & HEIGHT. IDENTIFY EXISTING BUILDINGS, STRUCTURES OR LAND USES ON THE PROPERTY.
3. SIGN AND DATE THE SKETCH.

ACTUAL TOTAL CONSTRUCTION COSTS OF THE COMPLETE DEVELOPMENT/ PROPOSED CONSTRUCTION PROJECT WITHIN THE FLOODPLAIN \$ 245,055.00

D. ADJACENT AND/OR AFFECTED LANDOWNERS:

1. NAME AND ADDRESS OF ALL OWNERS OF SURFACE TRACTS ADJACENT TO THE AREA OF THE SURFACE TRACT (UP & DOWN STREAM) UPON WHICH THE PROPOSED ACTIVITY WILL OCCUR AND ALL OTHER SURFACE OWNERS UP & DOWN STREAM) WHO OWN PROPERTY THAT MAY BE AFFECTED BY FLOODING AS IS DEMONSTRATED BY A FLOODPLAIN STUDY OR SURVEY (IF ONE HAS BEEN COMPLETED).

NAME: I.L (Ike) Morris ADDRESS: P.O. Box 397, Glenville, WV 26351

2. NAME AND ADDRESS OF AT LEAST ONE ADULT RESIDING IN EACH RESIDENCE LOCATED UPON ANY ADJACENT PROPERTY AT THE TIME THE FLOODPLAIN PERMIT APPLICATION IS FILED AND THE NAME AND ADDRESS OF AT LEAST ONE ADULT RESIDING IN ANY HOME ON ANY PROPERTY THAT MAY BE AFFECTED BY FLOODING AS IS DEMONSTRATED BY A FLOODPLAIN STUDY OR SURVEY.

NAME: Same as Above

NAME: _____

ADDRESS: _____

ADDRESS: _____

E. CONFIRMATION FORM

THE APPLICANT ACKNOWLEDGES, AGREES, AND CONFIRMS THAT HE/IT WILL PAY WITHIN 30 DAYS OF RECEIPT OF INVOICE BY THE COUNTY FOR ALL EXPENSES RELATIVE TO THE PERMIT APPLICATION PROCESS GREATER THAN THE REQUIRED DEPOSIT FOR EXPENSES INCLUDING:

- (A) PERSONAL SERVICE OF PROCESS BY THE DODDRIDGE COUNTY SHERIFF AT THE RATES PERMITTED BY LAW FOR SUCH SERVICE.
- (B) SERVICE BY CERTIFIED MAIL RETURN RECEIPT REQUESTED.
- (C) PUBLICATION.
- (D) COURT REPORTING SERVICES AT ANY HEARINGS REQUESTED BY THE APPLICANT.
- (E) CONSULTANTS AND/OR HEARING EXPERTS UTILIZED BY DODDRIDGE COUNTY FLOODPLAIN ADMINISTRATOR/MANAGER OR FLOODPLAIN APPEALS BOARD FOR REVIEW OF MATERIALS AND/OR TESTIMONY REGARDING THE EFFICACY OF GRANTING OR DENYING THE APPLICANT'S FLOODPLAIN PERMIT.

NAME (PRINT): Cristie D. Neller

SIGNATURE: 

DATE: 5-20-15

After completing SECTION 2, APPLICANT should submit form and fees to Clerk of Doddridge County Court or his/her representative for review.

SECTION 3: FLOODPLAIN DETERMINATION (to be completed by Floodplain Administrator/Manager or his/her representative)

THE PROPOSED DEVELOPMENT:

THE PROPOSED DEVELOPMENT IS LOCATED ON:

FIRM Panel: _____

Dated:----- _____

- Is NOT located in a Specific Flood Hazard Area (Notify applicant that the application review is complete and NO FLOODPLAIN DEVELOPMENT PERMIT IS REQUIRED).
- Is located in Special Flood Hazard Area.
FIRM zone designation _____
100-Year flood elevation is _____ NGVD .
Stream name _____
Profile # _____
- Unavailable
- The proposed development is located in a floodway.
- See section 4 for additional instructions.

SIGNED _____

DATE _____

SECTION 4: ADDITIONAL INFORMATION REQUIRED FOR DEVELOPMENT IN SPECIAL FLOOD HAZARD AREA (To be completed by Floodplain Administrator/Manager or his/her representative)

The applicant must submit the documents checked below before the application can be processed.

- A plan showing the location of all existing structures, water bodies, adjacent roads and proposed development.
- Development plans, drawn to scale, and specifications, including where applicable: details for anchoring structures, storage tanks, proposed elevation of lowest floor, (including basement or crawl space), types of water resistant materials used below the first floor, details of flood proofing of utilities located below the first floor and details of enclosures below the first floor.
Also _____
- Subdivision or other development plans (If the subdivision or development exceeds 10 lots or 2 acres, whichever is the lesser, the applicant must provide 100-year flood elevations if they are not otherwise available).
- Plans showing the extent of watercourse relocation and/or landform alterations.

- Top of new fill elevation _____ Ft. NGVD.
For floodproofing structures applicant must attach certification from registered engineer or architect.
- Certification from a registered engineer that the proposed activity in a regulatory floodway will not result in any increase in the height of the 100-year flood. A copy of all data and calculations supporting this finding must also be submitted.
- Manufactured homes located in a Flood Hazard Area must have a West Virginia Contractor's License and a Manufactured Home Installation License as required by the Federal Emergency Management Agency (FEMA).
- Other: _____

SECTION 5: PERMIT DETERMINATION (To be completed by Floodplain Administrator/Manager or his/her representative)

I have determined that the proposed activity (type is or is not) in conformance with provisions of the Floodplain Ordinance adopted by the County Commission of Doddridge County on May 21, 2013. The permit is issued subject to the conditions attached to and made part of this permit.

SIGNED _____ DATE _____

If the Floodplain Administrator/Manager found that the above was not in conformance with the provisions of the Doddridge County Floodplain Ordinance and/or denied that application, the applicant may appeal.

APPEALS: Appealed to the County Commission of Doddridge County? Yes No
 Hearing Date: _____
 County Commission Decision - Approved Yes No

CONDITIONS: _____

SECTION 6: AS-BUILT ELEVATIONS (To be submitted by APPLICANT before Certificate of Compliance is issued). **As-Built Elevations will be provided after the building has been constructed.**

The following information must be provided for project structures. This section must be completed by a registered professional engineer or a licensed land surveyor (or attach a certification to this application).

COMPLETE 1 OR 2 BELOW:

- 1 Actual (As-Built) Elevation of the top of the lowest floor (including basement or crawl space is _____ FT. NGVD.
- 2 Actual (As Built) elevation of floodproofing is _____ FT. NGVD.
 Note: Any work performed prior to submittal of the above information is at risk of the applicant.

SECTION 7: COMPLIANCE ACTION (To be completed by the Floodplain Administrator/Manager or his/her representative).

The Floodplain Administrator/Manager or his/her representative will complete this section as applicable based on inspection of the project to ensure compliance with the Doddridge County Floodplain Ordinance.

INSPECTIONS:

DATE: _____ BY: _____
DEFICIENCIES? Y/N

COMMENTS _____

SECTION 8: CERTIFICATE OF COMPLIANCE (To be completed by Floodplain Administrator/Manager or his/her representative).

Certificate of Compliance issued: DATE: _____ BY: _____

**CERTIFICATE OF COMPLIANCE
FOR DEVELOPMENT IN SPECIAL FLOOD HAZARD AREA (OWNER MUST RETAIN)**

PERMIT NUMBER: _____
PERMIT DATE: _____

PURPOSE –

CONSTRUCTION LOCATION: _____

OWNER'S ADDRESS: _____

THE FOLLOWING MUST BE COMPLETED BY THE FLOODPLAIN ADMINISTRATOR/MANAGER OR HIS/HER AGENT.

COMPLIANCE IS HEREBY CERTIFIED WITH THE REQUIREMENT OF THE FLOODPLAIN ORDINANCE ADOPTED BY THE COUNTY COMMISSION OF DODDRIDGE COUNTY ON MAY 21, 2013.

SIGNED _____ DATE _____

ENCLOSURE 2
PROJECT MAPPING

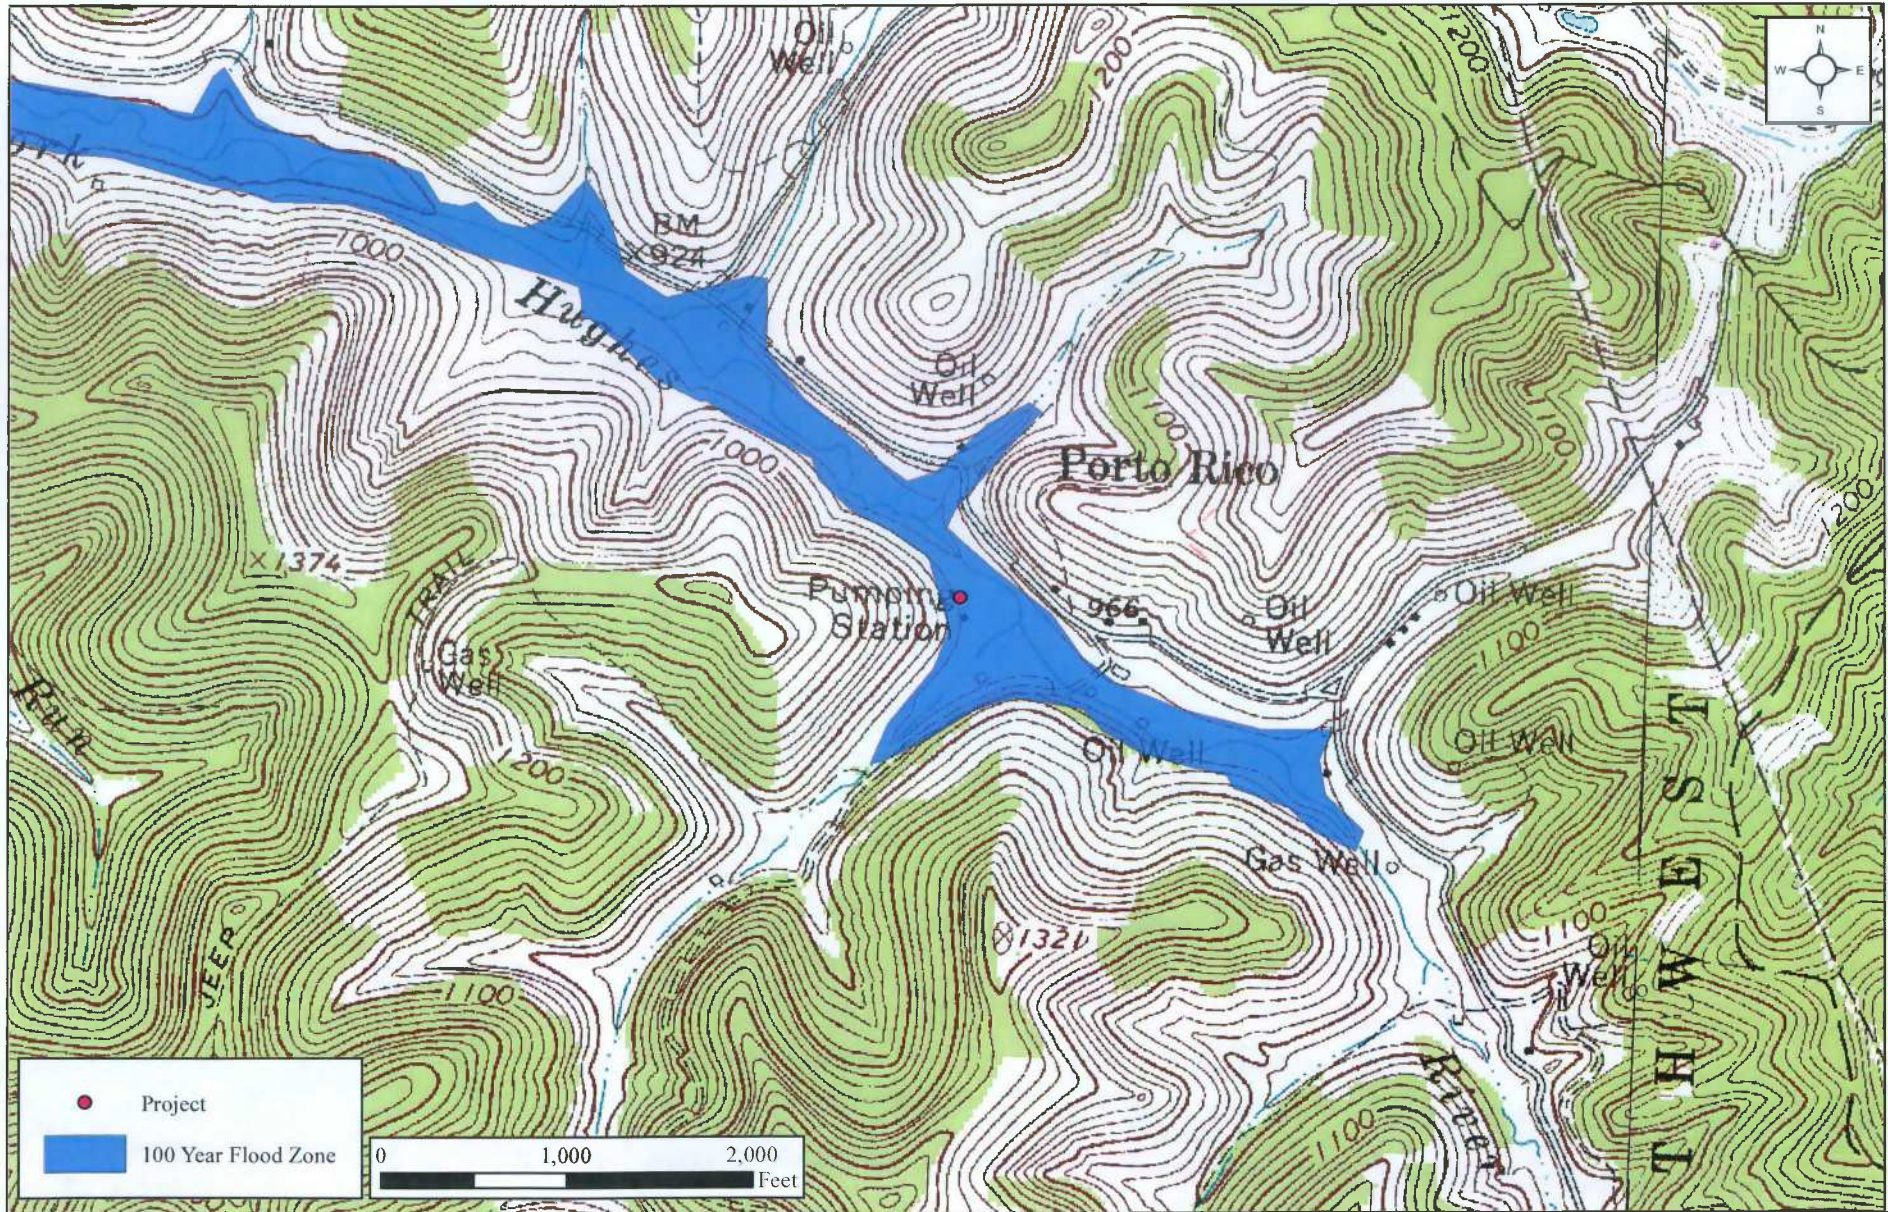


Figure 1

Dominion Transmission, Inc.
 Maxwell Station Project
 Doddridge County, West Virginia

USGS 7.5 Topographic Map with FEMA Overlay
 Oxford, WV Quadrangle
 1:12,000
Environment & Archaeology
 LLC

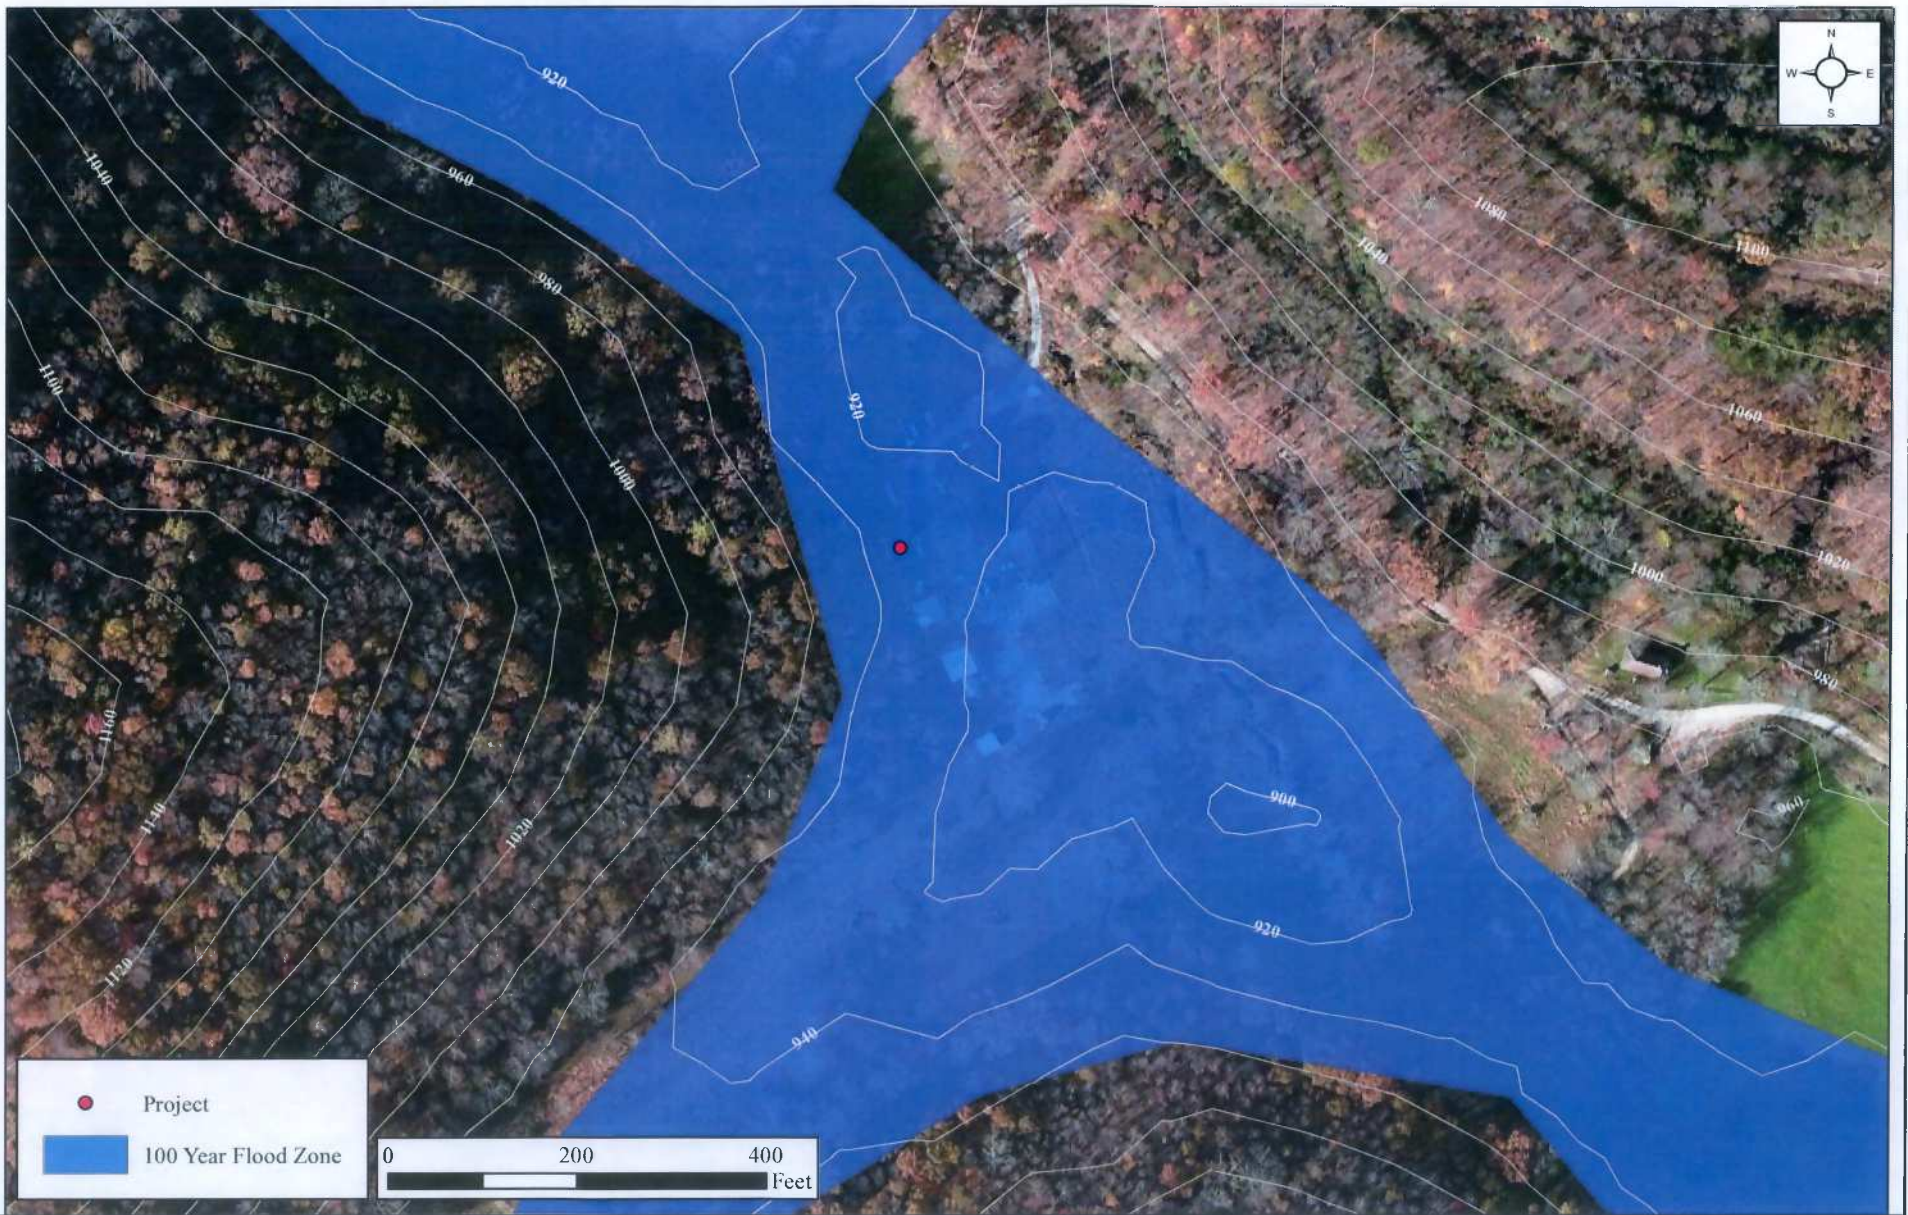


Figure 2

Dominion Transmission, Inc.
 Maxwell Station Project
 Doddridge County, West Virginia

Aerial Map
 Aerial Provided by ESRI Map Services
 1:2,400
Environment & Archaeology
 LLC

ENCLOSURE 3
SITE PHOTOGRAPHS



Photo: 1 Date: 4-28-2015 Comments: View of the existing gravel access drive and lot associated with the Maxwell Compressor Station, facing south.



Photo: 2 Date: 4-28-2015 Comments: View of proposed workspace associated with the new building installation, facing WSW.



Photo: 3 Date: 4-28-2015 Comments: Overview of location of new compressor building, approximately 40 feet in front of the existing building, facing ENE.



Photo: 4 Date: 4-28-2015 Comments: View of existing compressor building, and location of proposed new building, facing east.



Edwin Wriston <doddridgecountyfpm@gmail.com>

Dominion Project 2015 Maxwell Compressor Station New Building1 message

Edwin Wriston <doddridgecountyfpm@gmail.com>

Fri, Jun 12, 2015 at 12:26 PM

To: Robert.H.Jennings@dom.com

Cc: brett slater <blslater.4774@yahoo.com>, Gregory Robinson <wvrobby@hughes.net>

Mr. Jennings,

The Dominion Project, 2015 Maxwell Compressor Station - New Building, submitted to the Doddridge County Floodplain Office will require both an H&H & HECRAS engineering study to be completed before any further action is taken.

The project as submitted is entirely in the FEMA designated 100-yr floodplain, and a building of the size and proportion proposed will have impact on the flow of water. H&H & HECRAS studies must therefore be completed to determine possible impacts both up and downstream.

Please submit your studies at your earliest convenience. Once received, your studies will be forwarded to an independent 3rd party engineering firm for review as per our normal procedures.

If you do not feel this can be completed in the 90-day window from the date of submission to our office, you may request an extension for the permitting process, or withdraw your current application until such time the H&H & HECRAS studies are completed.

Please note that we will also require all additional DEP, USACE, WVDNR permits, etc. needed for this project to be obtained and forwarded to us before a floodplain permit can be issued.

If you have any questions, please feel free to contact our office via email at your convenience.

Respectfully,

--

Edwin L. "Bo" Wriston, Floodplain Manager
Doddridge County Commission
118 East Court Street
West Union, WV 26456
Work Phone: 1-304-873-2631
Mobile Phone: 1-304-629-3735
Fax: 1-304-873-1840
doddridgecountyfpm@gmail.com
www.doddridgecounty.wv.gov

--

CONFIDENTIALITY NOTE: This email message is for the sole use of the intended recipient(s) and may contain confidential, privileged, or sensitive information. Any unauthorized review, use, disclosure, or distribution is strictly prohibited and may be legally accountable.

Dominion Resources Services, Inc.
5000 Dominion Boulevard
Glen Allen, VA 23060



July 16, 2015

BY EXPRESS MAIL

Ms. Catie Slater
Office of Doddridge County Floodplain Manager
Doddridge County Commission
118 East Court Street
West Union, West Virginia 26456

**RE: Hydrologic & Hydraulic Engineering Analysis Report
Dominion Resources, Inc.
Maxwell Compressor Station New Building Project
Doddridge County, West Virginia**

FILED
2015 JUL 17 AM 11:03
J. H. A. COUNTY CLERK
DODDRIDGE COUNTY, WV

Dear Ms. Slater:

Dominion Transmission, Inc. (DTI) is pleased to submit the enclosed Hydrologic & Hydraulic (H&H) Engineering Analysis Report for the Maxwell Compressor Station New Building Project (Project) in Doddridge County, West Virginia (WV). The report includes the Hydrologic Engineering Centers River Analysis System (HEC-RAS) modeling results, as requested by the county.

This H&H Engineering Analysis Report was prepared to support construction of one (1) new compressor station building within the existing graveled and fenced lot of the existing Maxwell Compressor Station. The Station is located along the South Fork Hughes River. The new building is needed for DTI to house a new compressor engine, and it will be located near GPS coordinates 39.1797950367° N, -80.764598038° W, off of South Fork Hughes River Road (CR 40) in West Union, WV. The building will be constructed on existing grade (no fill) and will be approximately 42 feet wide x 42 feet long x 30 feet high. The building will be steel on a poured concrete slab that is five (5) feet thick.

The Station is located within a Zone A Special Flood Hazard Area per the Federal Emergency Management Agency (FEMA) Flood Insurance Rate Map (FIRM) Number 54017C0225C, dated October 4, 2011. This H&H analysis establishes a design discharge (flood flow) and base flood elevations (BFEs) for both existing and proposed conditions along South Fork Hughes River in the reach of stream near the Project Site so that the impacts of the new development can be assessed. The report is included as Enclosure 1.

This study was done to accompany the original Doddridge County Floodplain Permit application that was submitted by DTI on May 20, 2015.

Doddridge County Floodplain Manager
July 16, 2015
Page 2

Should you have any questions or require further information, please do not hesitate to contact Robert Jennings at (804) 273-3737, or at Robert.H.Jennings@dom.com.

Sincerely,

A handwritten signature in cursive script that reads "Paula Hamel". The signature is written in black ink and is positioned above the printed name and title.

Paula Hamel
Director, Gas Environmental Business Support

Enclosure: H&H Engineering Analysis Report

ENCLOSURE

H&H ENGINEERING ANALYSIS REPORT

July 16, 2015

Project C141803.36, Task 001

Mr. Rob Jennings
Dominion Transmission, Inc
500 Dominion Boulevard
Glen Allen, Virginia 23060

**Hydrologic and Hydraulic Analysis
Floodplain Development Permit Application
Dominion Transmission, Inc.
2015 Maxwell Compressor Station – New Building
Southwest District, Doddridge County, West Virginia**

Dear Mr. Jennings:

GAI Consultants, Inc. (GAI) is submitting this Hydrologic and Hydraulic (H&H) Analysis as an attachment to the Floodplain Development Application for the 2015 Maxwell Compressor Station – New Building Project (Project) submitted to Doddridge County on May 19, 2015. This attachment was prepared based on email correspondence from the from the Doddridge County Floodplain Manager on June 12, 2015 which indicated that the County would require an H&H Analysis of the proposed Project's impact on the existing 100-year flood elevation in order to further process the application.

This H&H Analysis was prepared to support construction of one new compressor station building within the existing graveled and fenced lot of the existing Maxwell Compressor Station (Station). The Station is located along the South Fork Hughes River. The new building is needed for Dominion Transmission, Inc. (DTI) to house a new compressor engine, and it will be located near global positioning system coordinates 39.1797950367, -80.764598038, off of South Fork of Hughes River Road (County Route [CR] 40) in West Union, West Virginia (WV). Figure 1 shows the Project location (Attachment 1). The building will be constructed on existing grade (no fill) and will be approximately 42-feet wide by 42-feet long by 30-feet high. The building will be steel on a poured concrete slab that is five-feet thick.

The Station is located within a Zone A Special Flood Hazard Area per the Federal Emergency Management Agency (FEMA) Flood Insurance Rate Map (FIRM) Number 54017C0225C, dated October 4, 2011. Figure 2 in Attachment 1 shows the FIRM. "Zone A" classification means the floodplain delineation has been established by approximate methods and base flood elevations (BFEs) have not been determined by FEMA. The design storm for a project located in FEMA Zone A is the 100-year (one percent annual chance) flood event. This H&H Analysis establishes a design discharge (flood flow) and BFEs for both existing and proposed conditions along South Fork Hughes River in the reach of stream near the Project Site so that the impacts of the new development can be assessed.

Current Site Conditions

South Fork Hughes River flows in a north westerly direction along CR 40 through the studied reach. As shown on Figure 3, which was developed using the WV Flood Tool, the area of the proposed Project is within the FEMA approximate 100-year floodplain.

GAI conducted a field visit on June 30, 2015 to collect site-specific data for use in this H&H Analysis. Along the Project Reach, the stream's right and left banks are two- to three-feet high and are heavily

vegetated (see Photograph 1). The left floodplain extends across a relatively flat area covered with thick brush for 100 to 200 feet before reaching the fenced-in compressor station (see Photograph 2). The compressor station is then bordered by a steep hillside (see Figure 5 and Photograph 3). The right floodplain varies in width from 10 to 50 feet and is vegetated with brush and trees. It is also bordered by a steep hillside. The bottom width of the channel throughout the Project Reach is approximately nine feet, with some sections of varying widths (eight to 10 feet). The stream bed material is a silty mud with some cobbles and larger stones present.

There is an existing access road and culvert crossing located approximately 300-feet downstream of the proposed building location. The crossing consists of two four-foot diameter corrugated metal pipe culverts as shown in Photograph 4. The culverts are approximately 40 feet in length with two to three feet of cover and two feet of spacing between them. Photograph 5 shows the stream reach downstream of the existing culvert crossing and proposed building location.

Proposed Project Description

There is currently an engine oil tank (approximate dimensions eight-feet wide by 23-feet long) at the proposed compressor building location (see Photograph 6). The tank and elevated fill will be removed and replaced with the proposed compressor building, constructed on existing grade (no fill) of approximate dimensions 42-feet wide by 42-feet long by 30-feet high. The building will be steel on a poured concrete slab that is five-feet thick.

Hydrologic Analysis

The drainage area to South Fork Hughes River at the crossing is approximately 1.82 square miles (1,165 acres). The drainage area at the Site is shown on Figure 4. No stream gages or controlled reservoirs exist on South Fork Hughes River. Peak flows for the current study were computed using the United States Geological Survey (USGS) Regression (SIR 2010-5033) and National Resources Conservation Service TR-55 methods in accordance with Section 4.3.4 of the *WV Division of Highways (WVDOH) Drainage Manual*. The computer program Hydraflow Hydrographs was used to estimate flow rates for the TR-55 method.

Per Section 4.4.4.2 of the WVDOH Manual, because the drainage area is less than 10 square miles, the USGS method is not recommended to be used for design. Thus, the USGS flows (with and without the suggested prediction error) are provided for comparison only. The TR-55 flows are within 10 percent of the USGS flows (adjusted for error), and are believed to be representative of site conditions. Thus, the TR-55 100-year peak discharge of 1,192 cubic feet per second (cfs) has been adopted for design. Hydrologic calculations are provided in Attachment 3.

No flood history of the site was available for calibration. However, the results presented in this analysis are presumed to be conservative based on the South Fork Hughes River model presented in the WV Flood Tool, which uses the USGS flows (without error). Additional changes were made to the WV Flood Tool model as described in the hydraulic modeling section.

Hydraulic Modeling Procedure

Analyses of South Fork Hughes River in the vicinity of the proposed Project location were conducted using the United States Army Corps of Engineers computer program "Hydrologic Engineering Center-River Analysis System" (HEC-RAS) Version 4.1.0.

A Hydrologic Engineering Centers River Analysis System (HEC-RAS) model for South Fork Hughes River was obtained from the WV Flood Tool Site. The model was reviewed, and it does not include the existing culvert crossing at the site entrance. Thus, the WV Flood Tool model was used for Reference to obtain

the shape and approximate elevation of the floodplain in the Project area; however modifications were made to add additional detail as described below.

Seven cross-sections (two upstream of the proposed building location and five downstream) have been created for the existing conditions model. A cross section location map is provided in Attachment 4-Hydraulic Calculations. The general shape of each cross section was determined from ten foot contours derived from the WV Digital Elevation Models (DEM) and the WV Flood Tool model, and supplemented with field measurement of channel geometry. The water surface elevations of the existing and proposed models converge within the studied reach both upstream and downstream of the crossing.

The proposed model is identical to the existing conditions model in all locations except for the modifications to the obstructions at Section 46324.2. The proposed building, along with existing buildings and structures were modeled as obstructions in the HEC-RAS Geometry data. The existing culvert downstream of the proposed building was modeled using the culvert data editor.

Results

The table below shows the predicted 100-year flood elevations along South Fork Hughes River for the Existing and Proposed Project Models. The proposed building is modeled by the obstruction in Cross Section 46324.2.

Predicted 100-Year Water Surface Elevations (feet, NGVD)

Cross Section	Existing Conditions	Proposed Conditions	Difference (Proposed - Existing)
45723.6	916.04	916.04	0.00
45851.4	920.10	920.10	0.00
46014.1	924.55	924.55	0.00
46080.0	Existing Culvert Crossing		
46087.4	925.52	925.52	0.00
46324.2	925.65	925.65	0.00
46405.6	925.63	925.63	0.00
46468.0	925.82	925.82	0.00

For the 100-year event, the Proposed Project Model does not predict an increase in water surface elevation or velocity above the Existing Conditions Model. This result can be reasonably expected as the calculated flood depths at the proposed building location are relatively shallow, there is an existing obstruction to be replaced by the proposed building, and the proposed building is generally in the shadow of other station features with respect to flow direction.

Closure

Analyses have been performed to identify and quantify potential effects of the proposed Project on 100-year flood levels. The analyses indicate that the proposed Project will not increase 100-year flood levels by more than one foot, upstream, or downstream of the Project site in the studied reach. Thus, the Project is in compliance with Article IV, Section 4.3 of the Doddridge County Floodplain Ordinance.

The analyses and findings presented in this letter are based on site topography (ten-foot contours derived from WV DEM (USGS and SAMB, 2005)), a GAI field view, and Project mapping provided by DTI. GAI has relied upon this information to model the impact of the proposed Project on 100-year flood

levels. Should conditions or the proposed work change from as described herein, GAI requests the opportunity to review, and if applicable, revise its findings.


GAI appreciates your review of this information. Should you have any questions or require additional information, please feel free to contact either Mr. Derek Medved or Mr. Shane Fisher at 412-476-2000, extension 1437 or 304-808-6680, extension 2306, respectively. We can also be reached via email at d.medved@gaiconsultants.com or s.fisher@gaiconsultants.com.

Sincerely,


GAI Consultants, Inc.



Derek L. Medved
Assistant Civil Technical Leader



Shane A. Fisher, P.E.
Assistant Engineering Manager

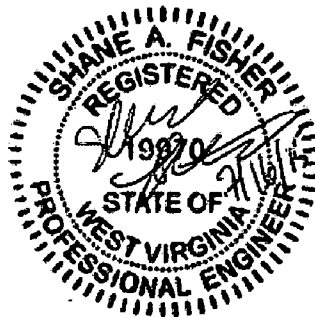


SAF/vev

Attachments: Attachment 1 (Figures), Attachment 2 (Photographs), Attachment 3 (Hydrologic Calculations), and Attachment 4 (Hydraulic Calculations)

cc: Derek Ingle, Neil Robinson, Karl Kratzer (DTI)

ATTACHMENT 1
Figures

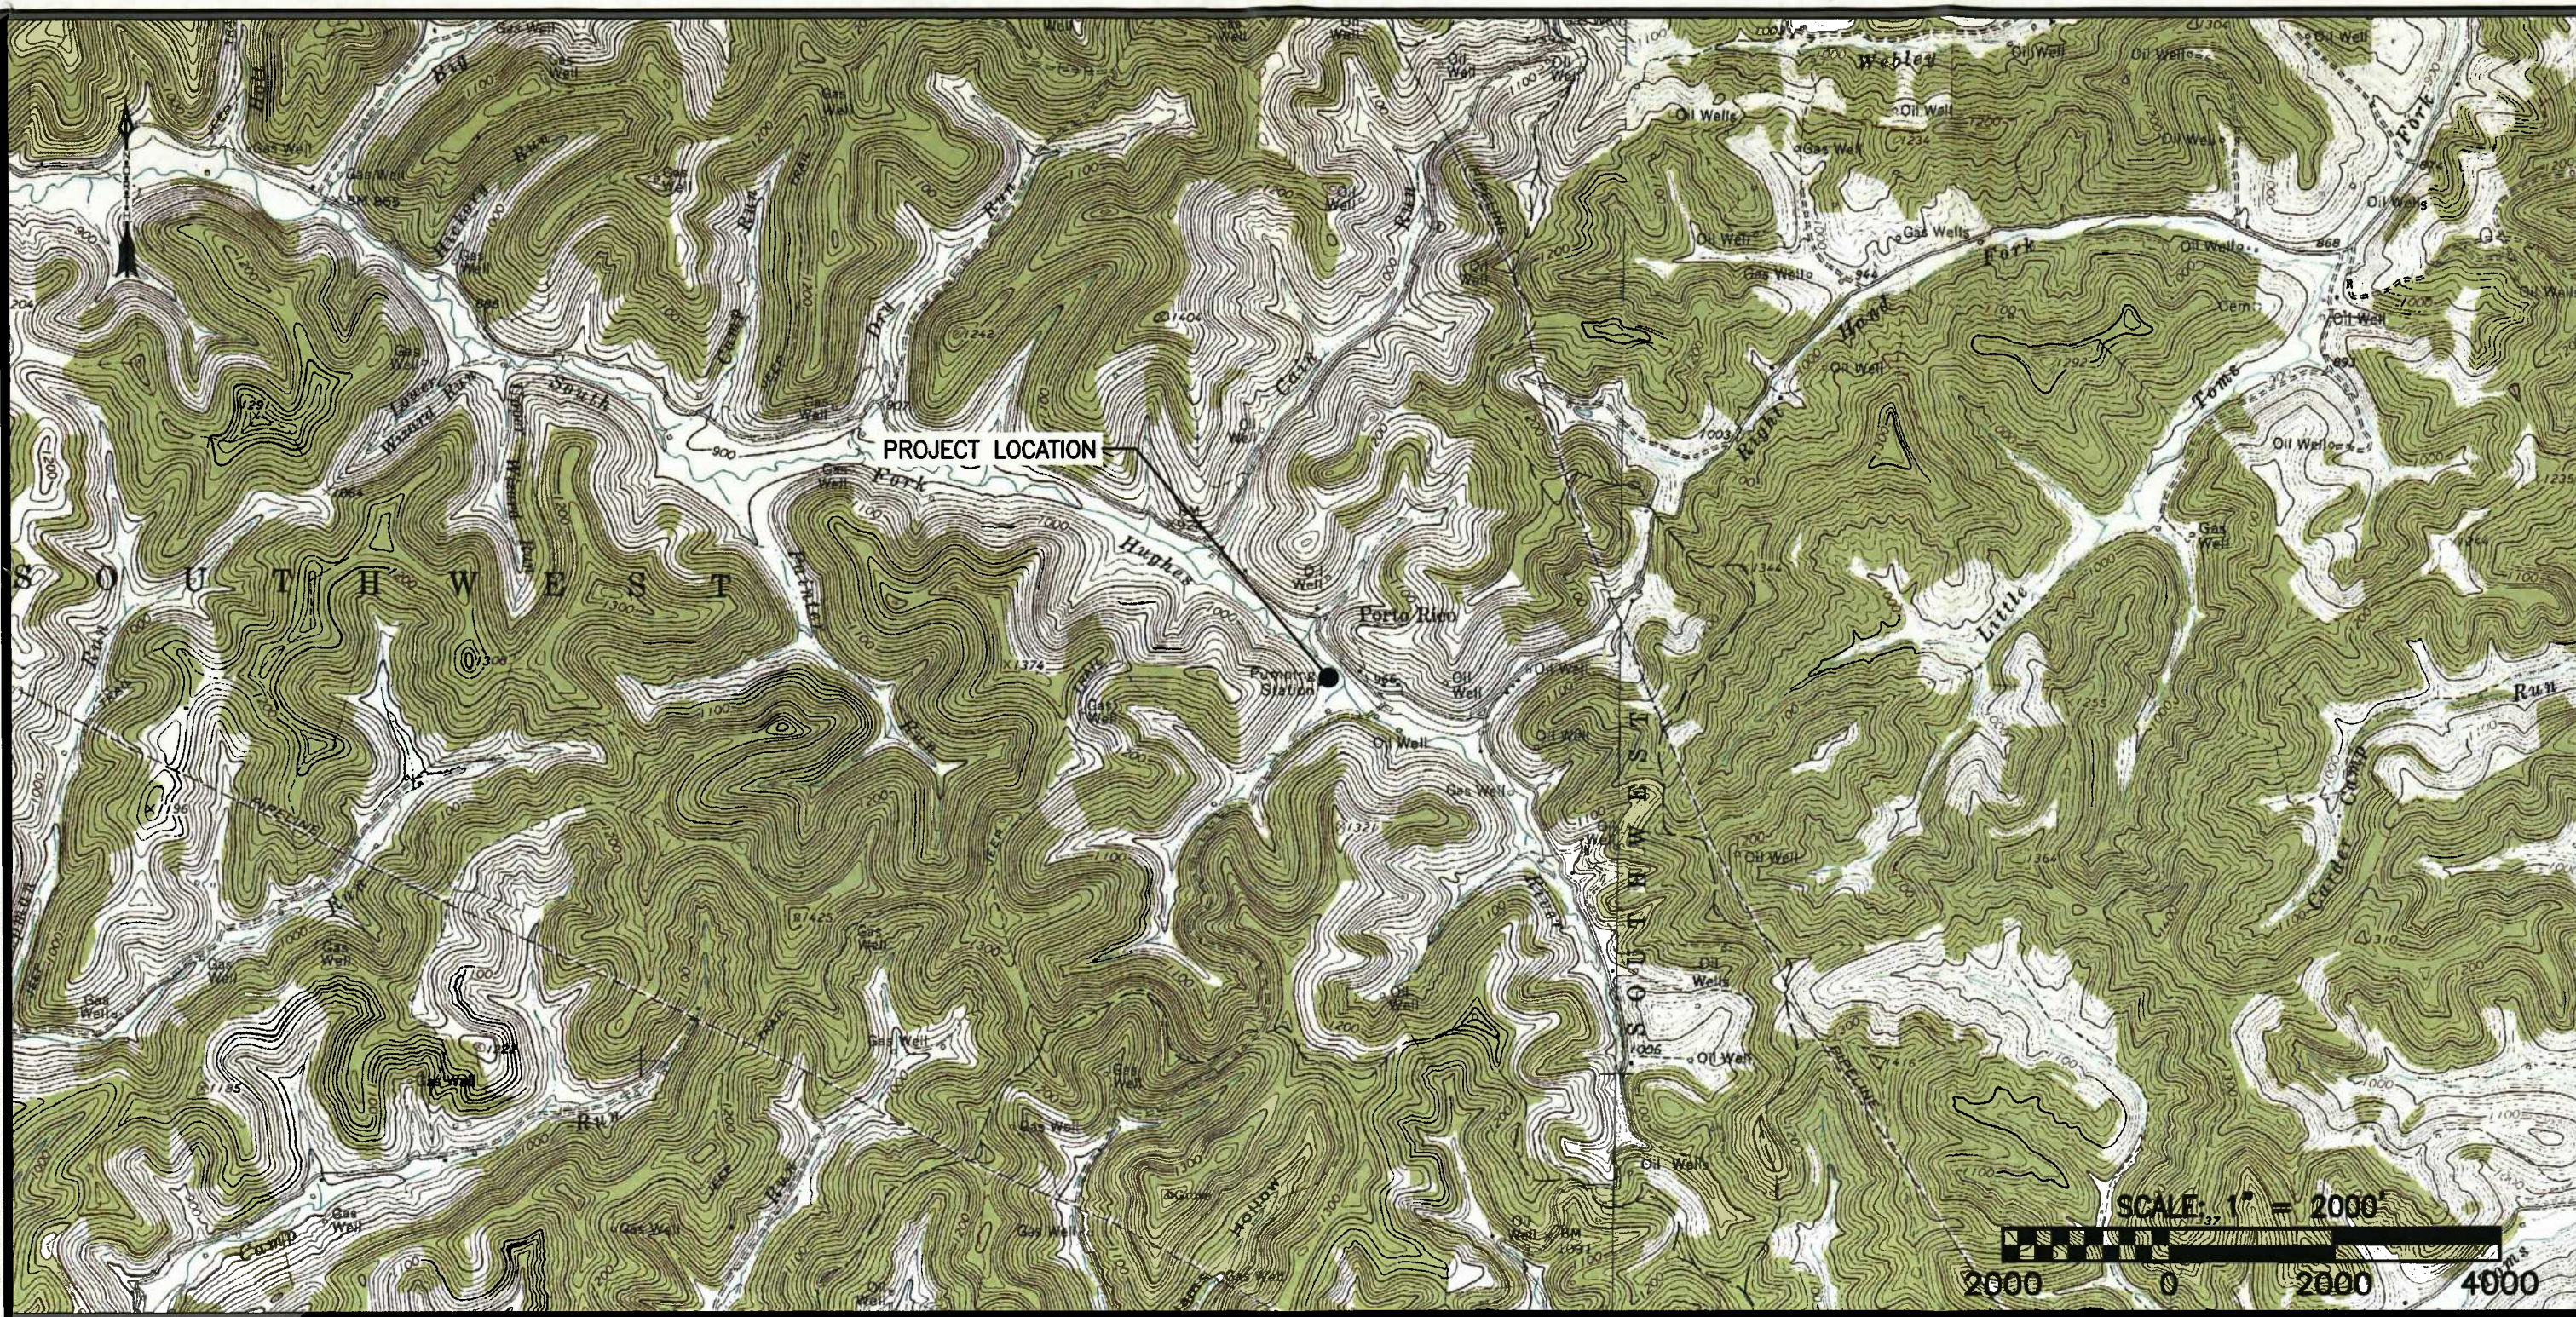


PLOTTED ON: 7/15/2015 1:29:47 PM PLOTTED BY: Shane Fisher PLOT FILE: GAI.stb

NO.:	DATE:	DWN:	CHK:	APV:	DESCRIPTION:

REVISION RECORD

DRAWING TITLE		
FIGURE 1 - PROJECT LOCATION		
PROJECT		CLIENT
2015 MAXWELL COMPRESSOR STATION	gai consultants	DOMINION TRANSMISSION, INC.
DODDRIDGE COUNTY, WV		5000 DOMINION BOULEVARD GLEN ALLEN, VA 23060


DRAWN BY: VENDEVM	CHECKED BY: THOMAMT	APPROVED BY: BERKEME
REVISION	SCALE: AS SHOWN	ISSUE DATE: 07/17/2015
		SHEET NO.: 001 OF 001
GAI FILE NUMBER: C141803-36-000-00-A2-003		
GAI DRAWING NUMBER: C141803-36-000-00-A2-003		

This drawing was produced with computer aided drafting technology and is supported by electronic drawing files. Do not revise this drawing via manual drafting methods.

ISSUING OFFICE: Pittsburgh | 385 E. Waterfront Drive, Homestead, PA 15120

GAI CAD FILE PATH: Z:\Energy\2014\C141803.36 - Dom - Maxwell Station Hyd\CAD\Production Drawings\C141803-36-000-00-A2-003.dwg

© 2015 GAI Consultants, Inc.

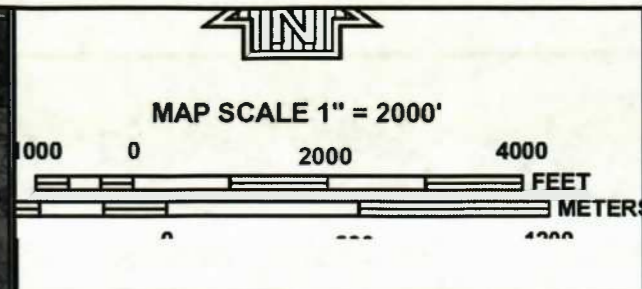

PANEL 0225C

FIRM
FLOOD INSURANCE RATE MAP
DODDRIDGE COUNTY,
WEST VIRGINIA
AND INCORPORATED AREAS

PANEL 225 OF 325
 (SEE MAP INDEX FOR FIRM PANEL LAYOUT)

CONTAINS:

COMMUNITY	NUMBER	PANEL	SUFFIX
DODDRIDGE COUNTY	540024	0225	C


FIGURE 2
FEMA FIRM

Notice to User: The Map Number shown below should be used when placing map orders; the Community Number shown above should be used on insurance applications for the subject community.

MAP NUMBER
 54017C0225C
 MAP REVISED
 OCTOBER 4, 2011
 Federal Emergency Management Agency

This is an official copy of a portion of the above referenced flood map. It was extracted using F-MIT On-Line. This map does not reflect changes or amendments which may have been made subsequent to the date on the title block. For the latest product information about National Flood Insurance Program flood maps check the FEMA Flood Map Store at www.msc.fema.gov

Figure 3 - WV Flood Map

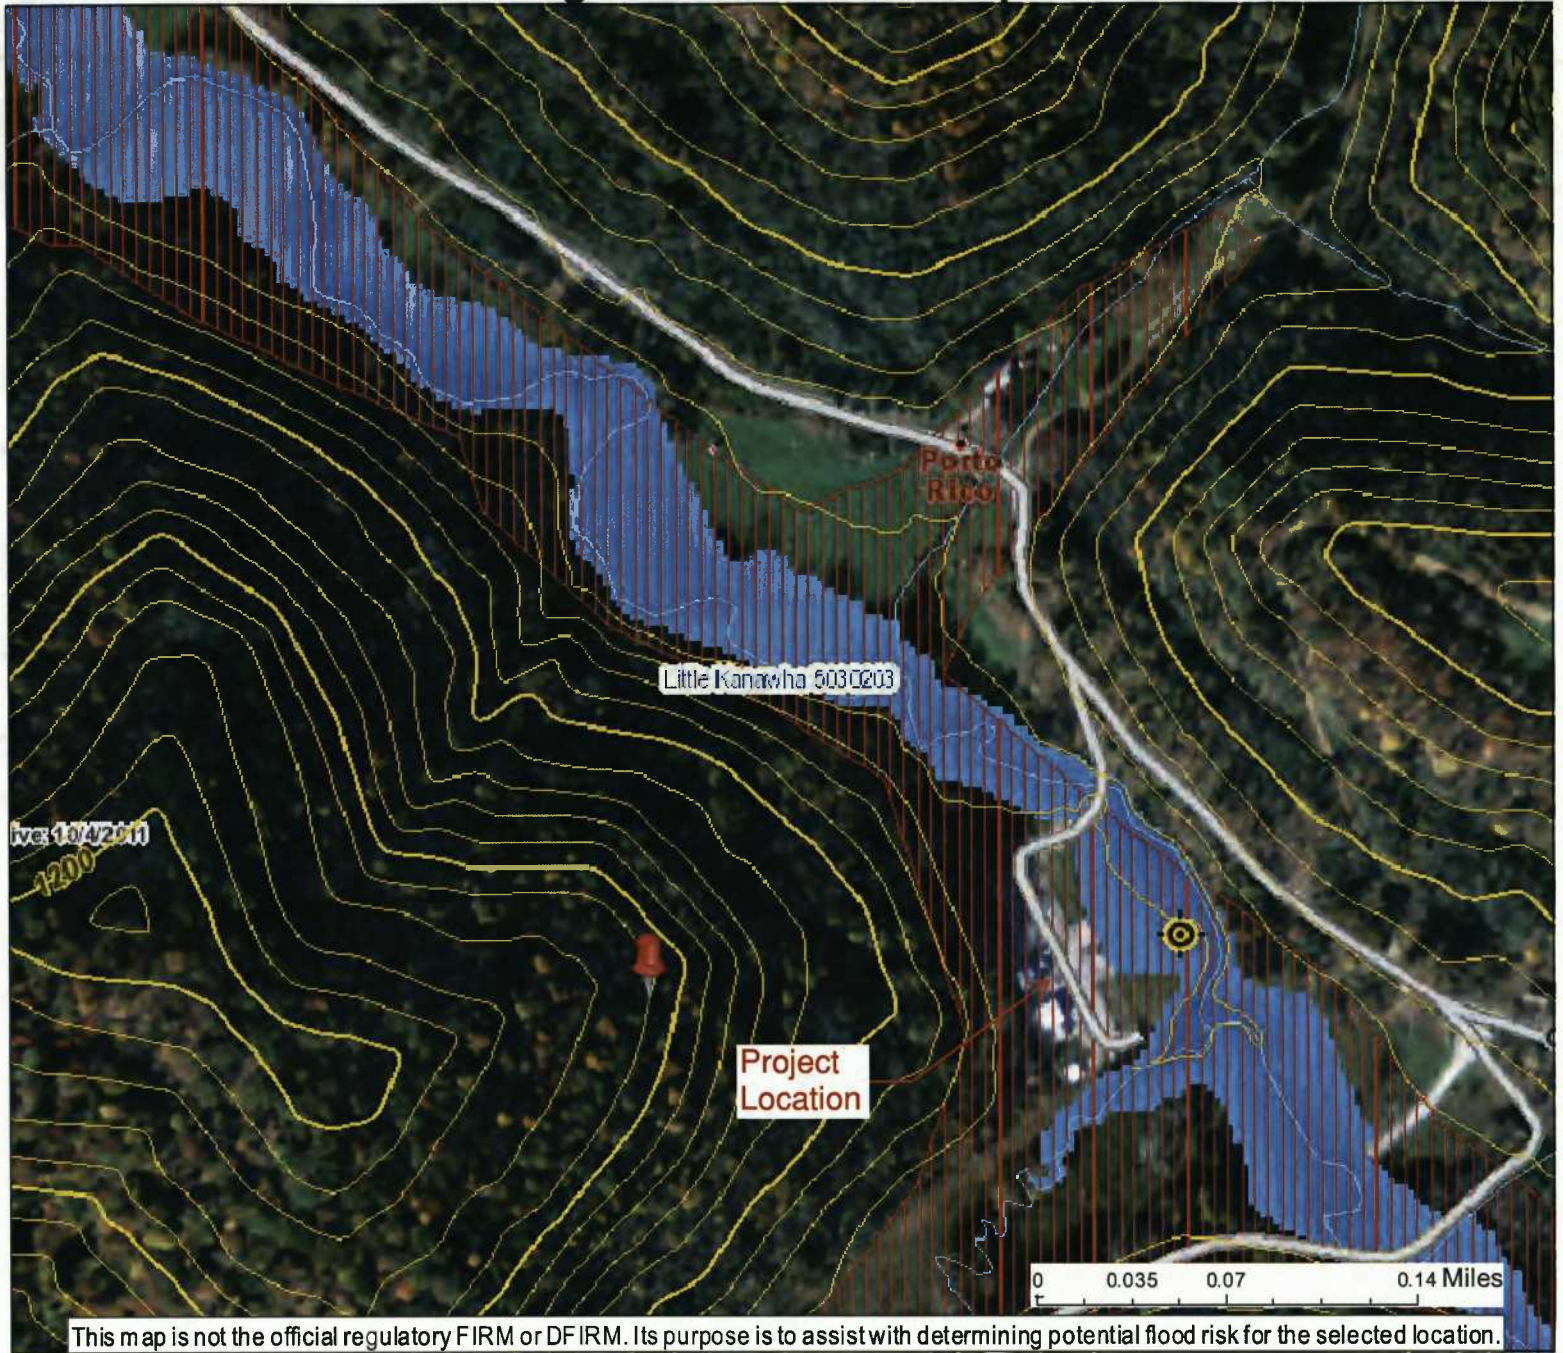

This map is not the official regulatory FIRM or DFIRM. Its purpose is to assist with determining potential flood risk for the selected location.

Location of flood information

User Notes:

2015 Maxwell Compressor Station-New Building

- Cross Section (XS) Lines
- Base Flood Elevation (BFE) Lines
- Floodway

Flood Hazard Zone

- Approximate Study (Zone A)
- Detailed Study (AE, AH, AO)

Disclaimer:

The online map is for use in administering the National Flood Insurance Program. It does not necessarily identify all areas subject to flooding, particularly from local drainage sources of small size. To obtain more detailed information in areas where Base Flood Elevations have been determined, users are encouraged to consult the latest Flood Profile data contained in the official flood insurance study. These studies are available online at www.msc.fema.gov.
 WV Flood Tool (<http://www.MapWV.gov/flood>) is supported by FEMA, WV NFIP Office, and WV GIS Technical Center.

Map created on July 13, 2015

Flood Hazard Area:

Flood Hazard Area: Location is WITHIN the FEMA 100-year floodplain.

Flood Hazard Zone:

A (Advisory A)

Stream:

South Fork Hughes River

FEMA Issued Flood Map: 54017C0225C

Watershed (HUC8): Little Kanawha (5030203)

Advisory Flood Height: About 923 ft

Water Depth:

About 2.2 ft (Source: HEC_RA)

Elevation:

About 921 ft

Location (long, lat):

(80.761771 W, 39.179945 N)

Location (UTM 17N): (520577, 4336772)

Contacts:

Doddridge

CRS Information:

N/A


Flood Profile:

HEC-RAS Model:

South Fork Hughes River

Parcel Number:

LEGEND



WOODS



MEADOW




DRAINAGE AREA



HYDROLOGIC SOIL BOUNDARY



TIME OF CONCENTRATION

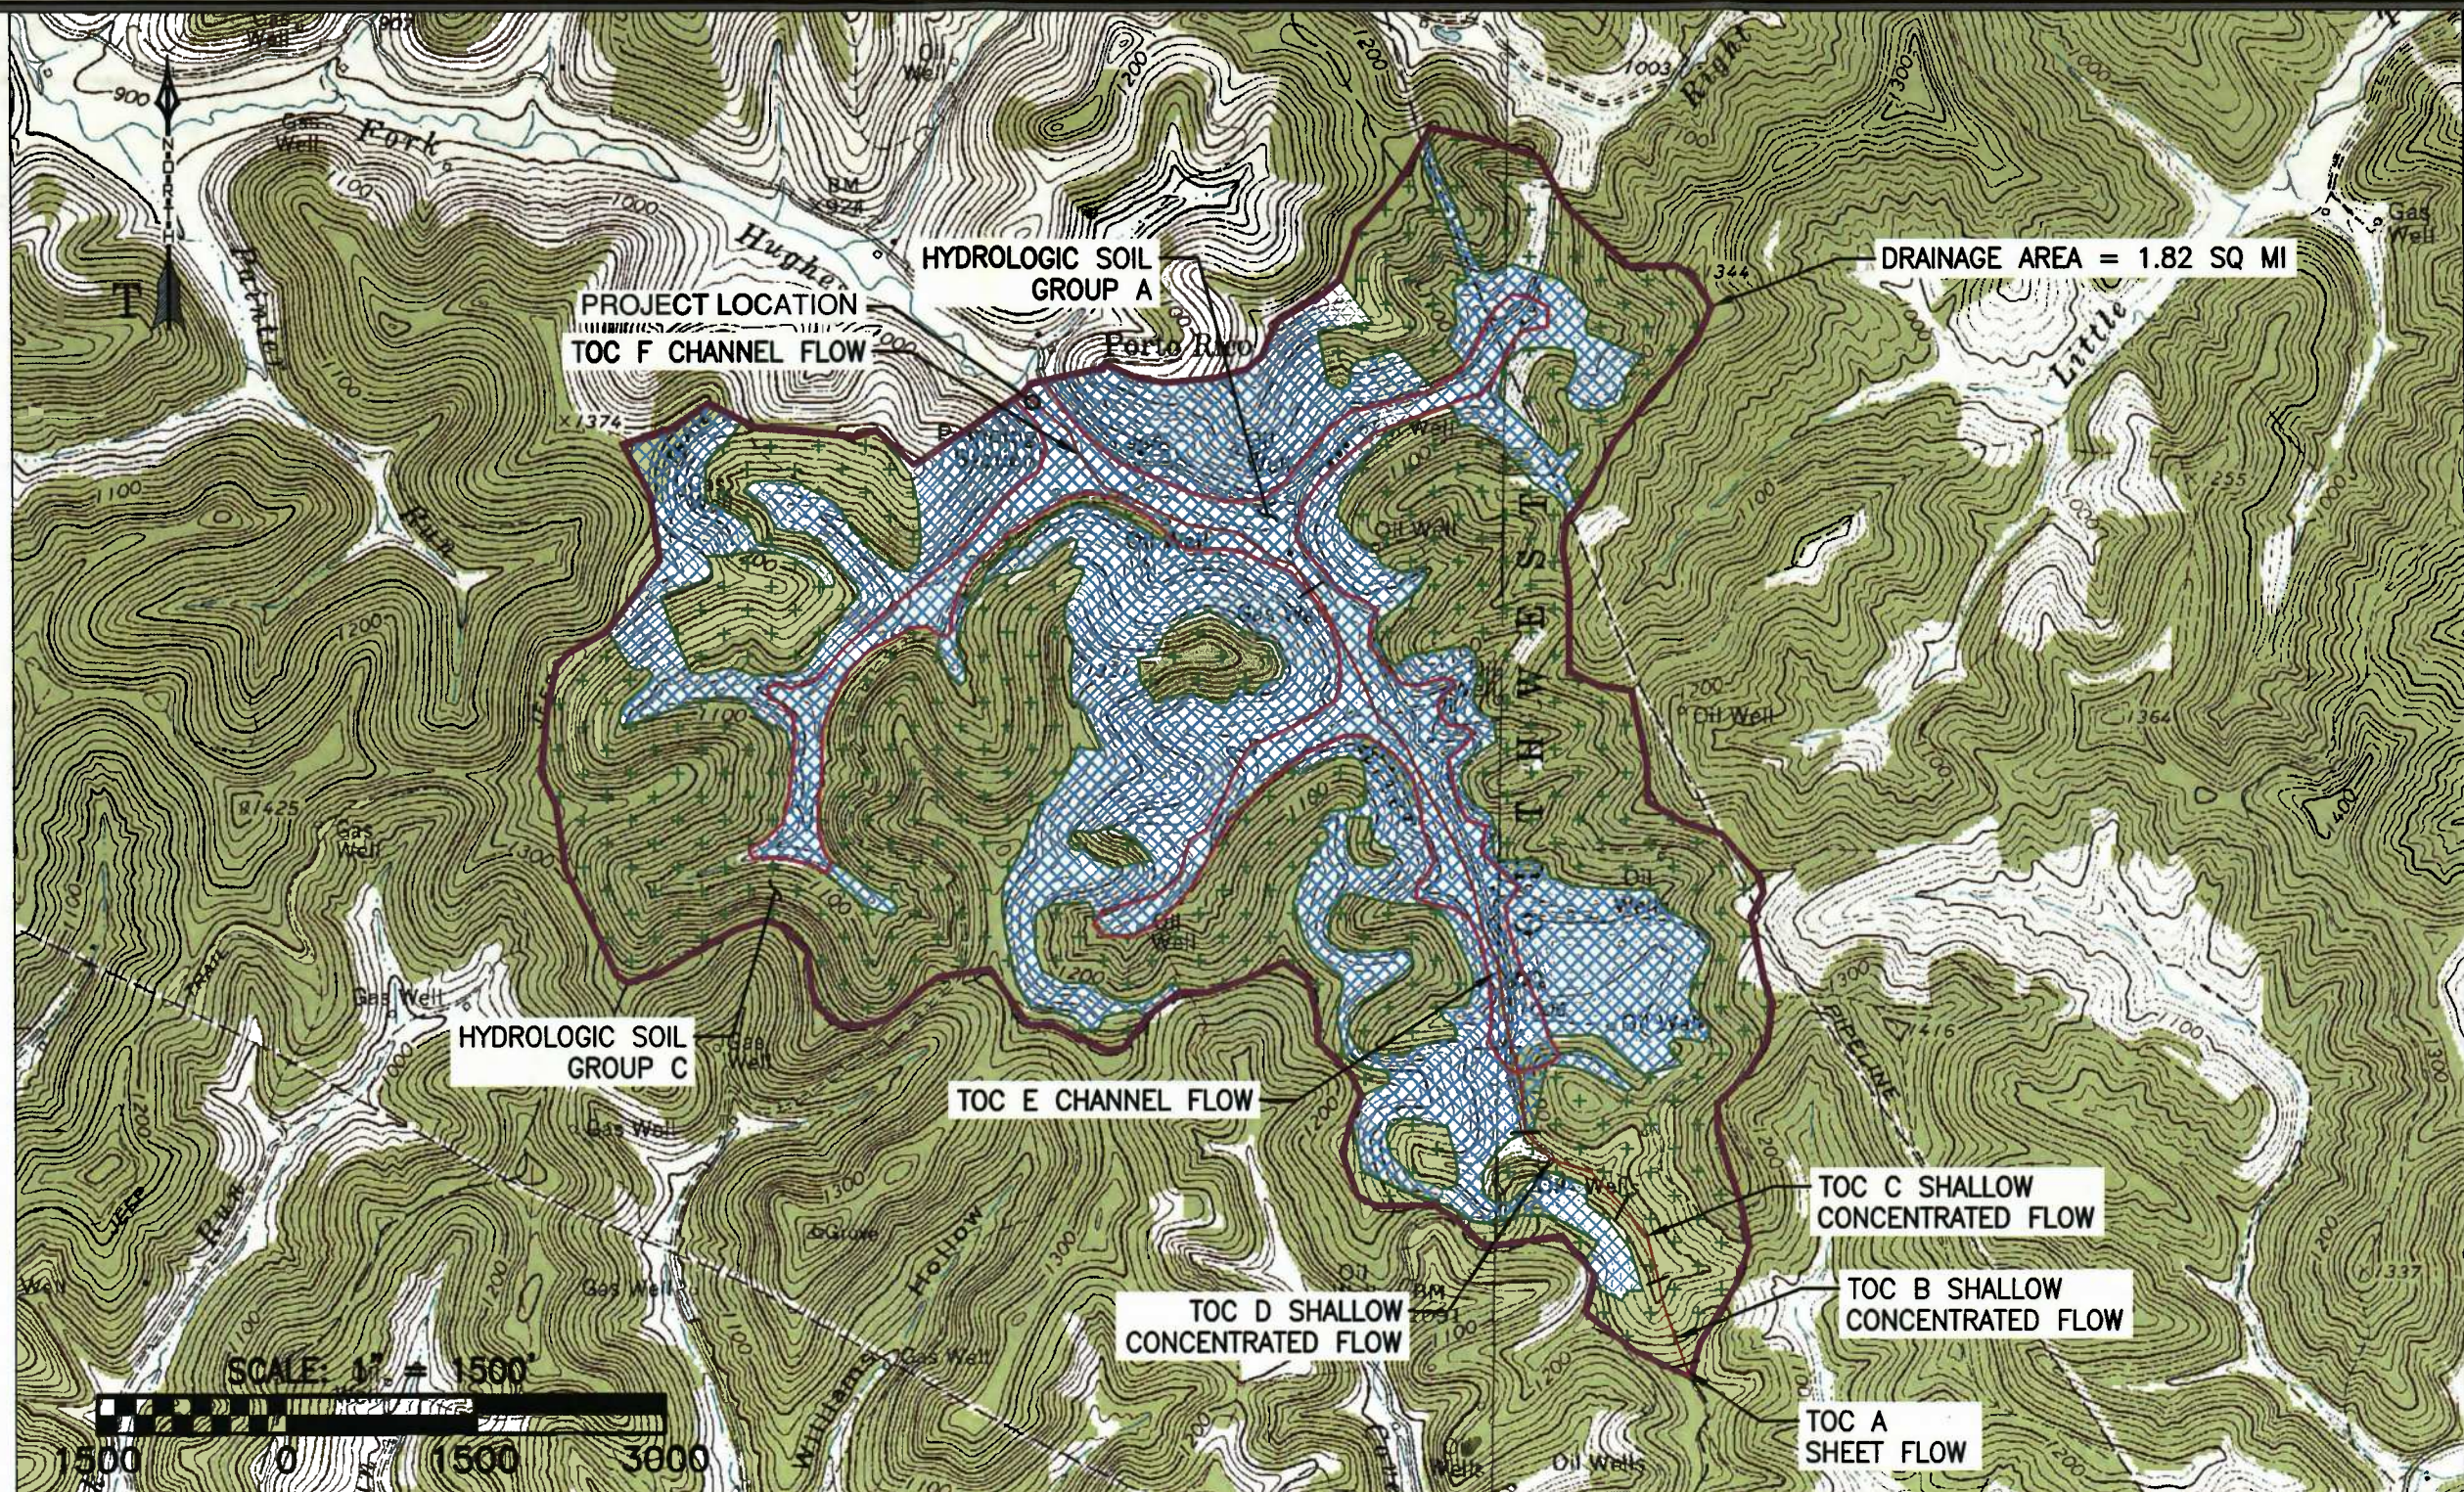

PLOTTED ON: 7/15/2015 1:35:42 PM PLOTTED BY: Shane Fisher PLOT FILE: GAI.stb

NO.:	DATE:	DWN:	CHK:	APV:	DESCRIPTION:

REVISION RECORD

DRAWING TITLE		DRAWN BY:		CHECKED BY:		APPROVED BY:	
FIGURE 4 - DRAINAGE AREA MAP		VENDEVM		THOMAMT		BERKEME	
PROJECT		CLIENT		REVISION		SCALE:	
2015 MAXWELL COMPRESSOR STATION		DOMINION TRANSMISSION, INC.		AS SHOWN		ISSUE DATE:	
DODDRIDGE COUNTY, WV		5000 DOMINION BOULEVARD		SHEET NO.:		07/17/2015	
		GLEN ALLEN, VA 23060		001 OF 001			
				GAI FILE NUMBER:			
				C141803-36-000-00-A2-001			
				GAI DRAWING NUMBER:			
				C141803-36-000-00-A2-001			




gai consultants

This drawing was produced with computer aided drafting technology and is supported by electronic drawing files. Do not revise this drawing via manual drafting methods.

ISSUING OFFICE: Pittsburgh | 385 E. Waterfront Drive, Homestead, PA 15120

GAI CAD FILE PATH: Z:\Energy\2014\C141803.36 - Dom - Maxwell Station Hyd\CAD\Production Drawings\C141803-36-000-00-A2-001.dwg

© 2015 GAI Consultants, Inc.

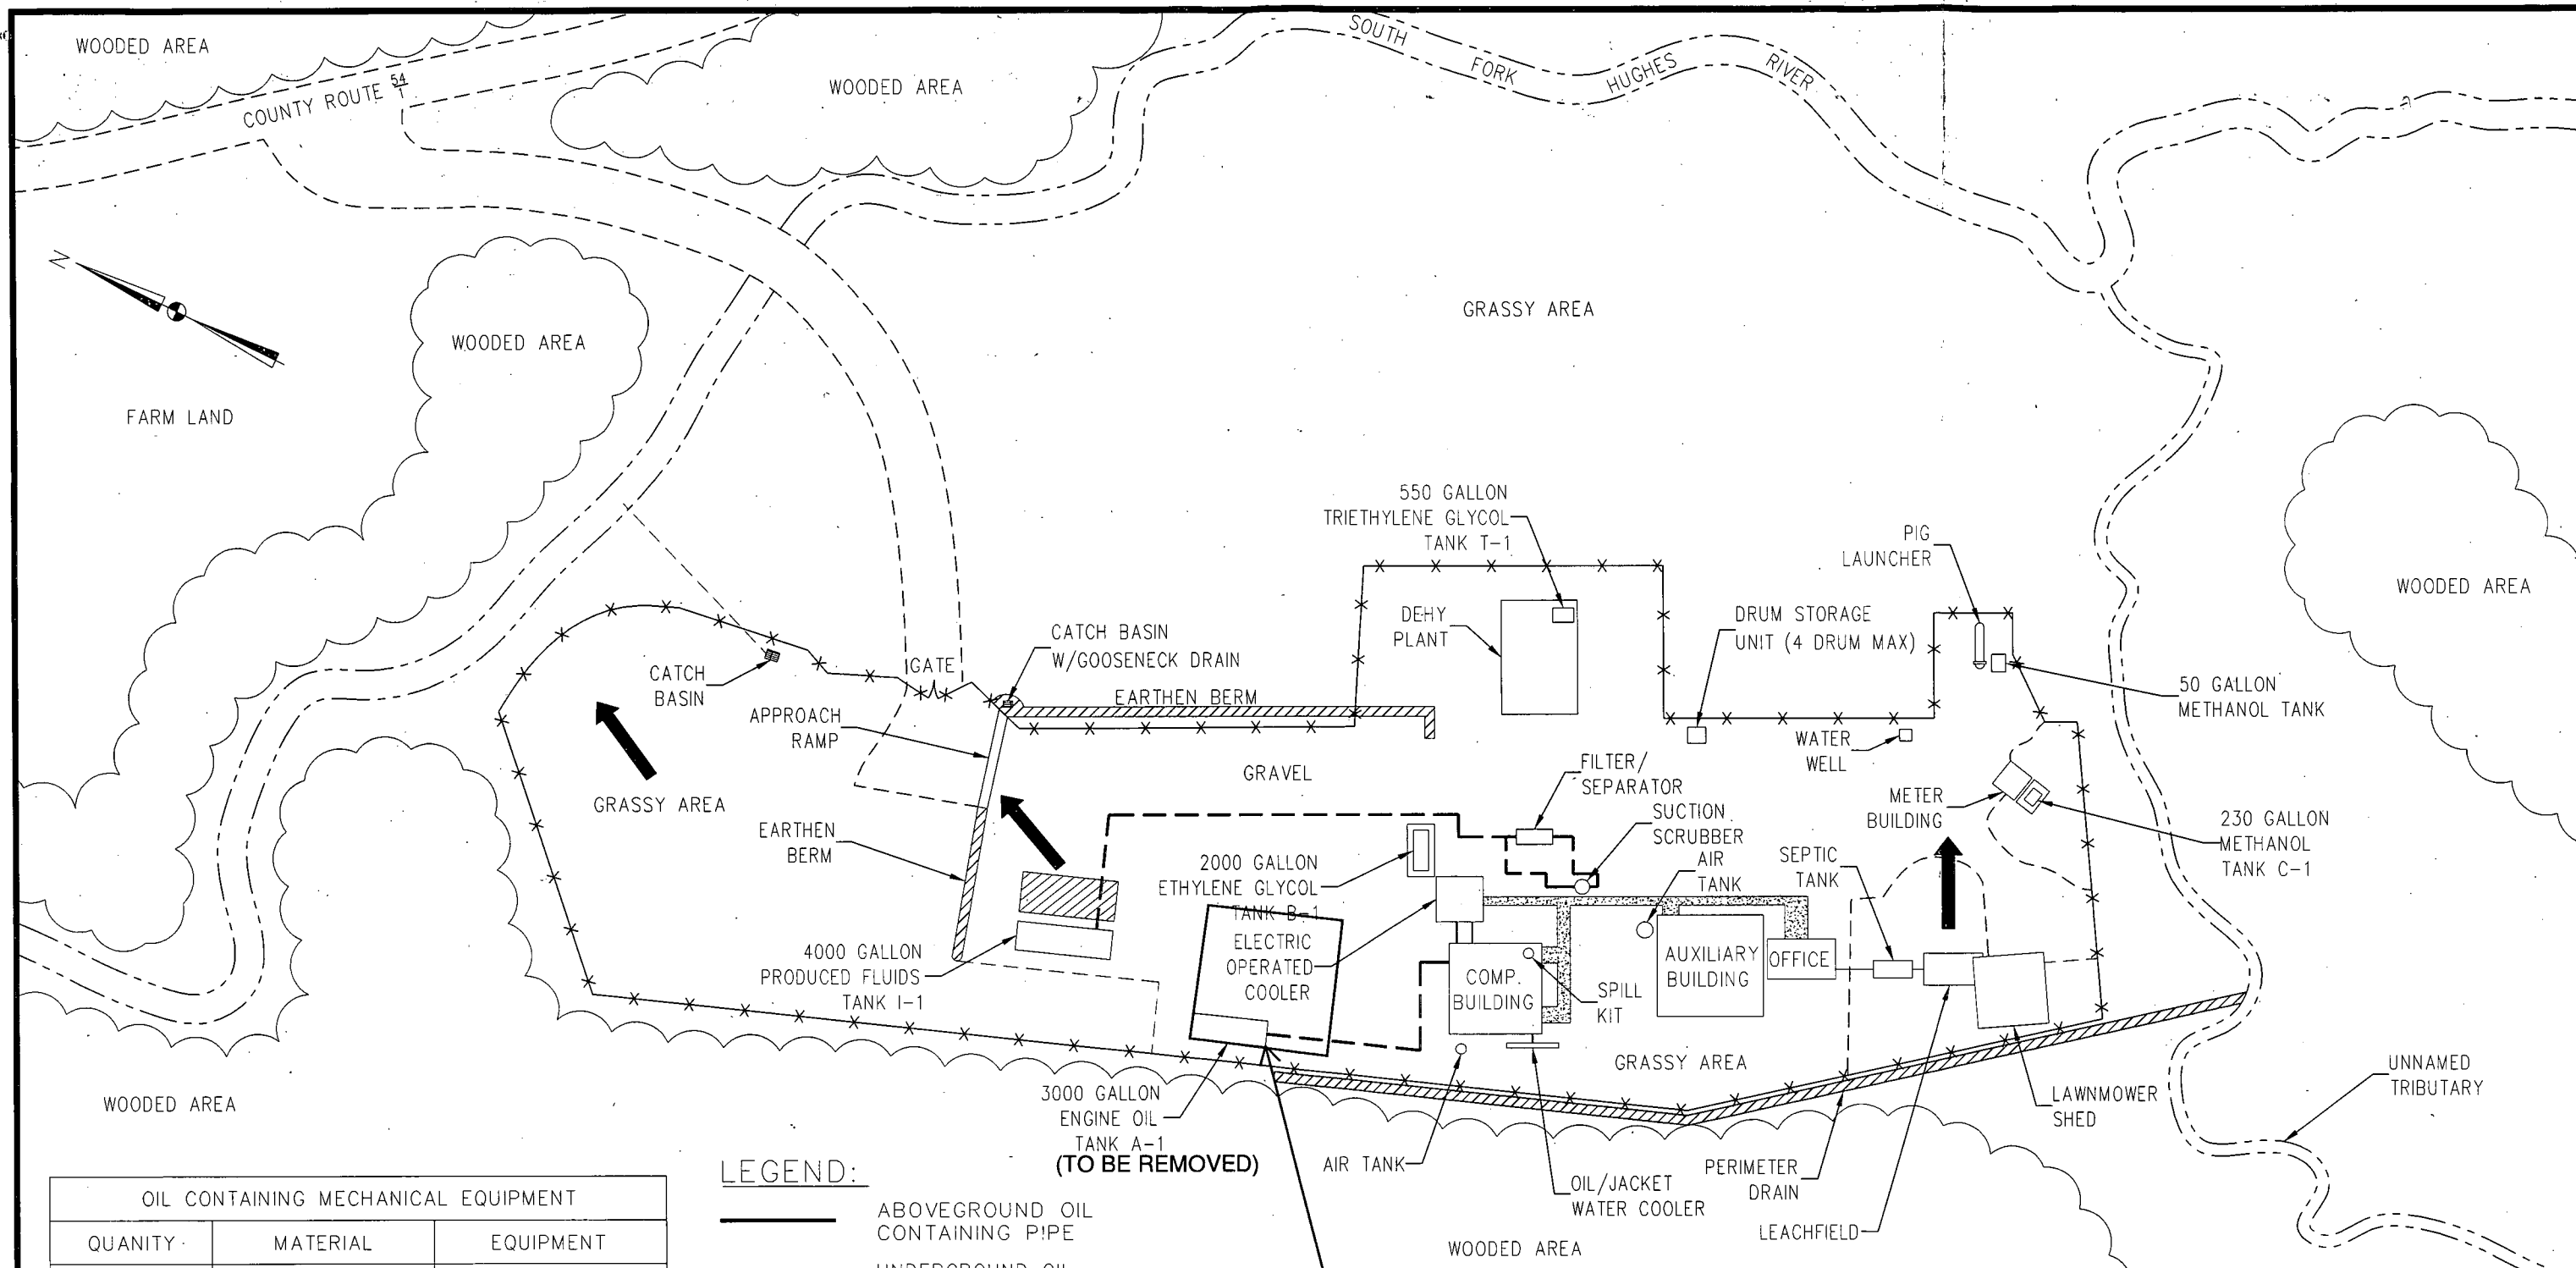


**FIGURE 5
PROJECT SITE PLAN**

NOTE: RED ANNOTATIONS BY GAI ARE FOR FIGURE PURPOSES ONLY AND DO NOT REFLECT CONTENTS OF THE ORIGINAL DOMINION SOURCE DRAWING.

OIL CONTAINING MECHANICAL EQUIPMENT		
QUANTITY	MATERIAL	EQUIPMENT
61 GALLON	PRODUCED FLUIDS	FILTER SEPARATOR
529 GALLON	PRODUCED FLUIDS	SUCTION SCRUBBER
55 GALLON	HYDRAULIC OIL	HYDRAULIC COOLER
108 GALLON	LUBE OIL	COMPRESSOR BLDG.

- LEGEND:**
- ABOVEGROUND OIL CONTAINING PIPE
 - UNDERGROUND OIL CONTAINING PIPE
 - FLOW DIRECTION
 - TRUCK LOADING/ UNLOADING



SYM.	DATE	BY	REVISION DESCRIPTION	PRJ/TSK	APP.	SCALE	DATE
						1" = 50'	
						DRAWN	09/14/07
4	11/05/14	TBB	SCALED, ADDED BAR SCALE, ADDED ADJACENT PROPERTIES, & REVISED NORTH ARROW			CHECKED	
3	11/07/12	MPR	UPDATED PER TIM JACKSONS MARK UPS			APP. FOR BID	
2	05/25/10	JDB	UPDATED PER RUSS EVANS MARK UPS			APP. FOR CONST.	
1	04/16/10	JDB	UPDATED PER RUSS EVANS MARK UPS			TOWN: OXFORD, WV	COUNTY: DODDRIDGE

Dominion Transmission, Inc.
 445 West Main St. Clarksburg, West Virginia 26301 / Phone: (304) 623-8000

FOR: **MAXWELL COMPRESSOR STATION**

TITLE: **ENVIRONMENTAL EMERGENCY SITE PLAN**

DIR: DOCUMENTUM	GROUP	DWG. NO.	REV.
FILE: PRJ/TSK:	PD	X3201A	4

July 16, 2015

Project C141803.36, Task 001

ATTACHMENT 2

Photographs



Photograph 1. Stream Reach in Project Area (Looking Upstream)



Photograph 2. Floodplain Separating Stream and Gravel Compressor Area, Stream Located in Trees on Left Side of Photograph (Looking Upstream)



Photograph 3. Hillside beyond Station and Proposed Building Location



Photograph 4. Existing Culvert Crossing at Site Entrance (Looking Upstream)



Photograph 5. Stream Reach Downstream of Culvert Crossing and Proposed Building Location (Looking Downstream)



Photograph 6. Proposed Building Location (Building will Replace Existing Tank)

ATTACHMENT 3 Hydrologic Calculations



Subject: Dominion – 2015 Maxwell Compressor Station-Hydrologic Calculations

By: THOMAMT Date: 07/09/2015 Project #: C141803.36

Chkd By: BERKEME Date: 07/09/2015 Sheet #: _____ of _____

OBJECTIVE:

This analysis will estimate peak flow for the 100-year storm event for a floodplain analysis in Doddridge County, West Virginia.

REFERENCES:

1. West Virginia Department of Transportation, Division of Highways (WVDOH), Drainage Manual, 3rd Edition with May 2, 2012 Revisions.
2. United States Geological Survey (USGS), Scientific Investigations Report (SIR) 2010-5033. 2010.
3. United States Department of Agriculture, Natural Resources Conservation Service (NRCS), 1986. Technical Release 55 (TR-55), Urban Hydrology for Small Watersheds, Second Edition, June 1986.
4. NOAA Atlas 14, Volume 2, Version 3. Point Precipitation Frequency Estimates for Charleston, West Virginia, US. Latitude 39.1799, Longitude -80.7625.
5. United States Department of Agriculture (USDA), Natural Resources Conservation Service (NRCS) Web Soil Survey, Doddridge County West Virginia.
6. Hyrdaflow Hydrographs by InteliSOLVE, Version 8.0.0.3, 2004.

FLOOD INFORMATION:

The Project is located in Federal Emergency Management Agency (FEMA) Zone A, which is defined as an area where approximate methods are used to determine the 100-year flood boundaries and no detailed hydraulic analysis or Base Flood Elevations (BFEs) are determined.

HYDROLOGIC ANALYSIS:

The drainage area to South Fork Hughes River at the Crossing is approximately 1.82 square miles (1,163 acres). The drainage area and project site are shown on the Drainage Area Map (sheet 3).

No stream gages exist on South Fork Hughes River. Peak flows for the current study are computed using the USGS Regression (SIR 2010-5033) and NRCS TR-55 methods in accordance with Section 4.3.4 of the WVDOH Drainage Manual. The computer program Hydraflow Hydrographs was used to estimate flow rates for the TR-55 method.

The drainage area and time of concentration flow path are shown on Sheet 3 of this calculation set. Time of Concentration was determined using worksheet 3 from the TR-55 Manual.

INPUT DATA:

Rainfall (From NOAA Atlas 14):

2-yr, 24 hour = 2.57 in (for use in Time of Concentration Calculation)
 100-yr, 24 hour = 5.17 in



Subject: Dominion – 2015 Maxwell Compressor Station-Hydrologic Calculations

By: THOMAMT Date: 07/09/2015 Project #: C141803.36

Chkd By: BERKEME Date: 07/09/2015 Sheet #: _____ of _____

Soil Types were determined to be Type A and C from the USDA Soil Map and information on Sheets 7-11. Land use was determined from the USDA mapping and aerial imagery and consists of woodlands.

Runoff Curve Number Coefficients (WVDOH Drainage Manual, Table 4-9 and 4-10)

Woods Only (Good Condition), Type C Soils = 70

Meadow, Type C Soils = 71






Meadow, Type A Soils = 30


RESULTS:

The Table below summarizes the flow rates estimated using each method. The detailed analyses can be found in the following pages.

Method	PEAK FLOWS (cfs)
	100-year
USGS Regression (Unadjusted)	834
USGS Regression (Adjusted for Error)	1,096
TR-55	1,192

Per Section 4.4.4.2 of the WVDOH Manual, because the drainage area is less than 10 square miles, the USGS method is not recommended to be used for design. Thus, the USGS flows (with and without the suggested prediction error) are provided for comparison only. The TR-55 flows are within 10% of the USGS flows adjusted for error and have been adopted for design.

- LEGEND**
-  WOODS
 -  MEADOW
 -  DRAINAGE AREA
 -  HYDROLOGIC SOIL BOUNDARY
 -  TIME OF CONCENTRATION

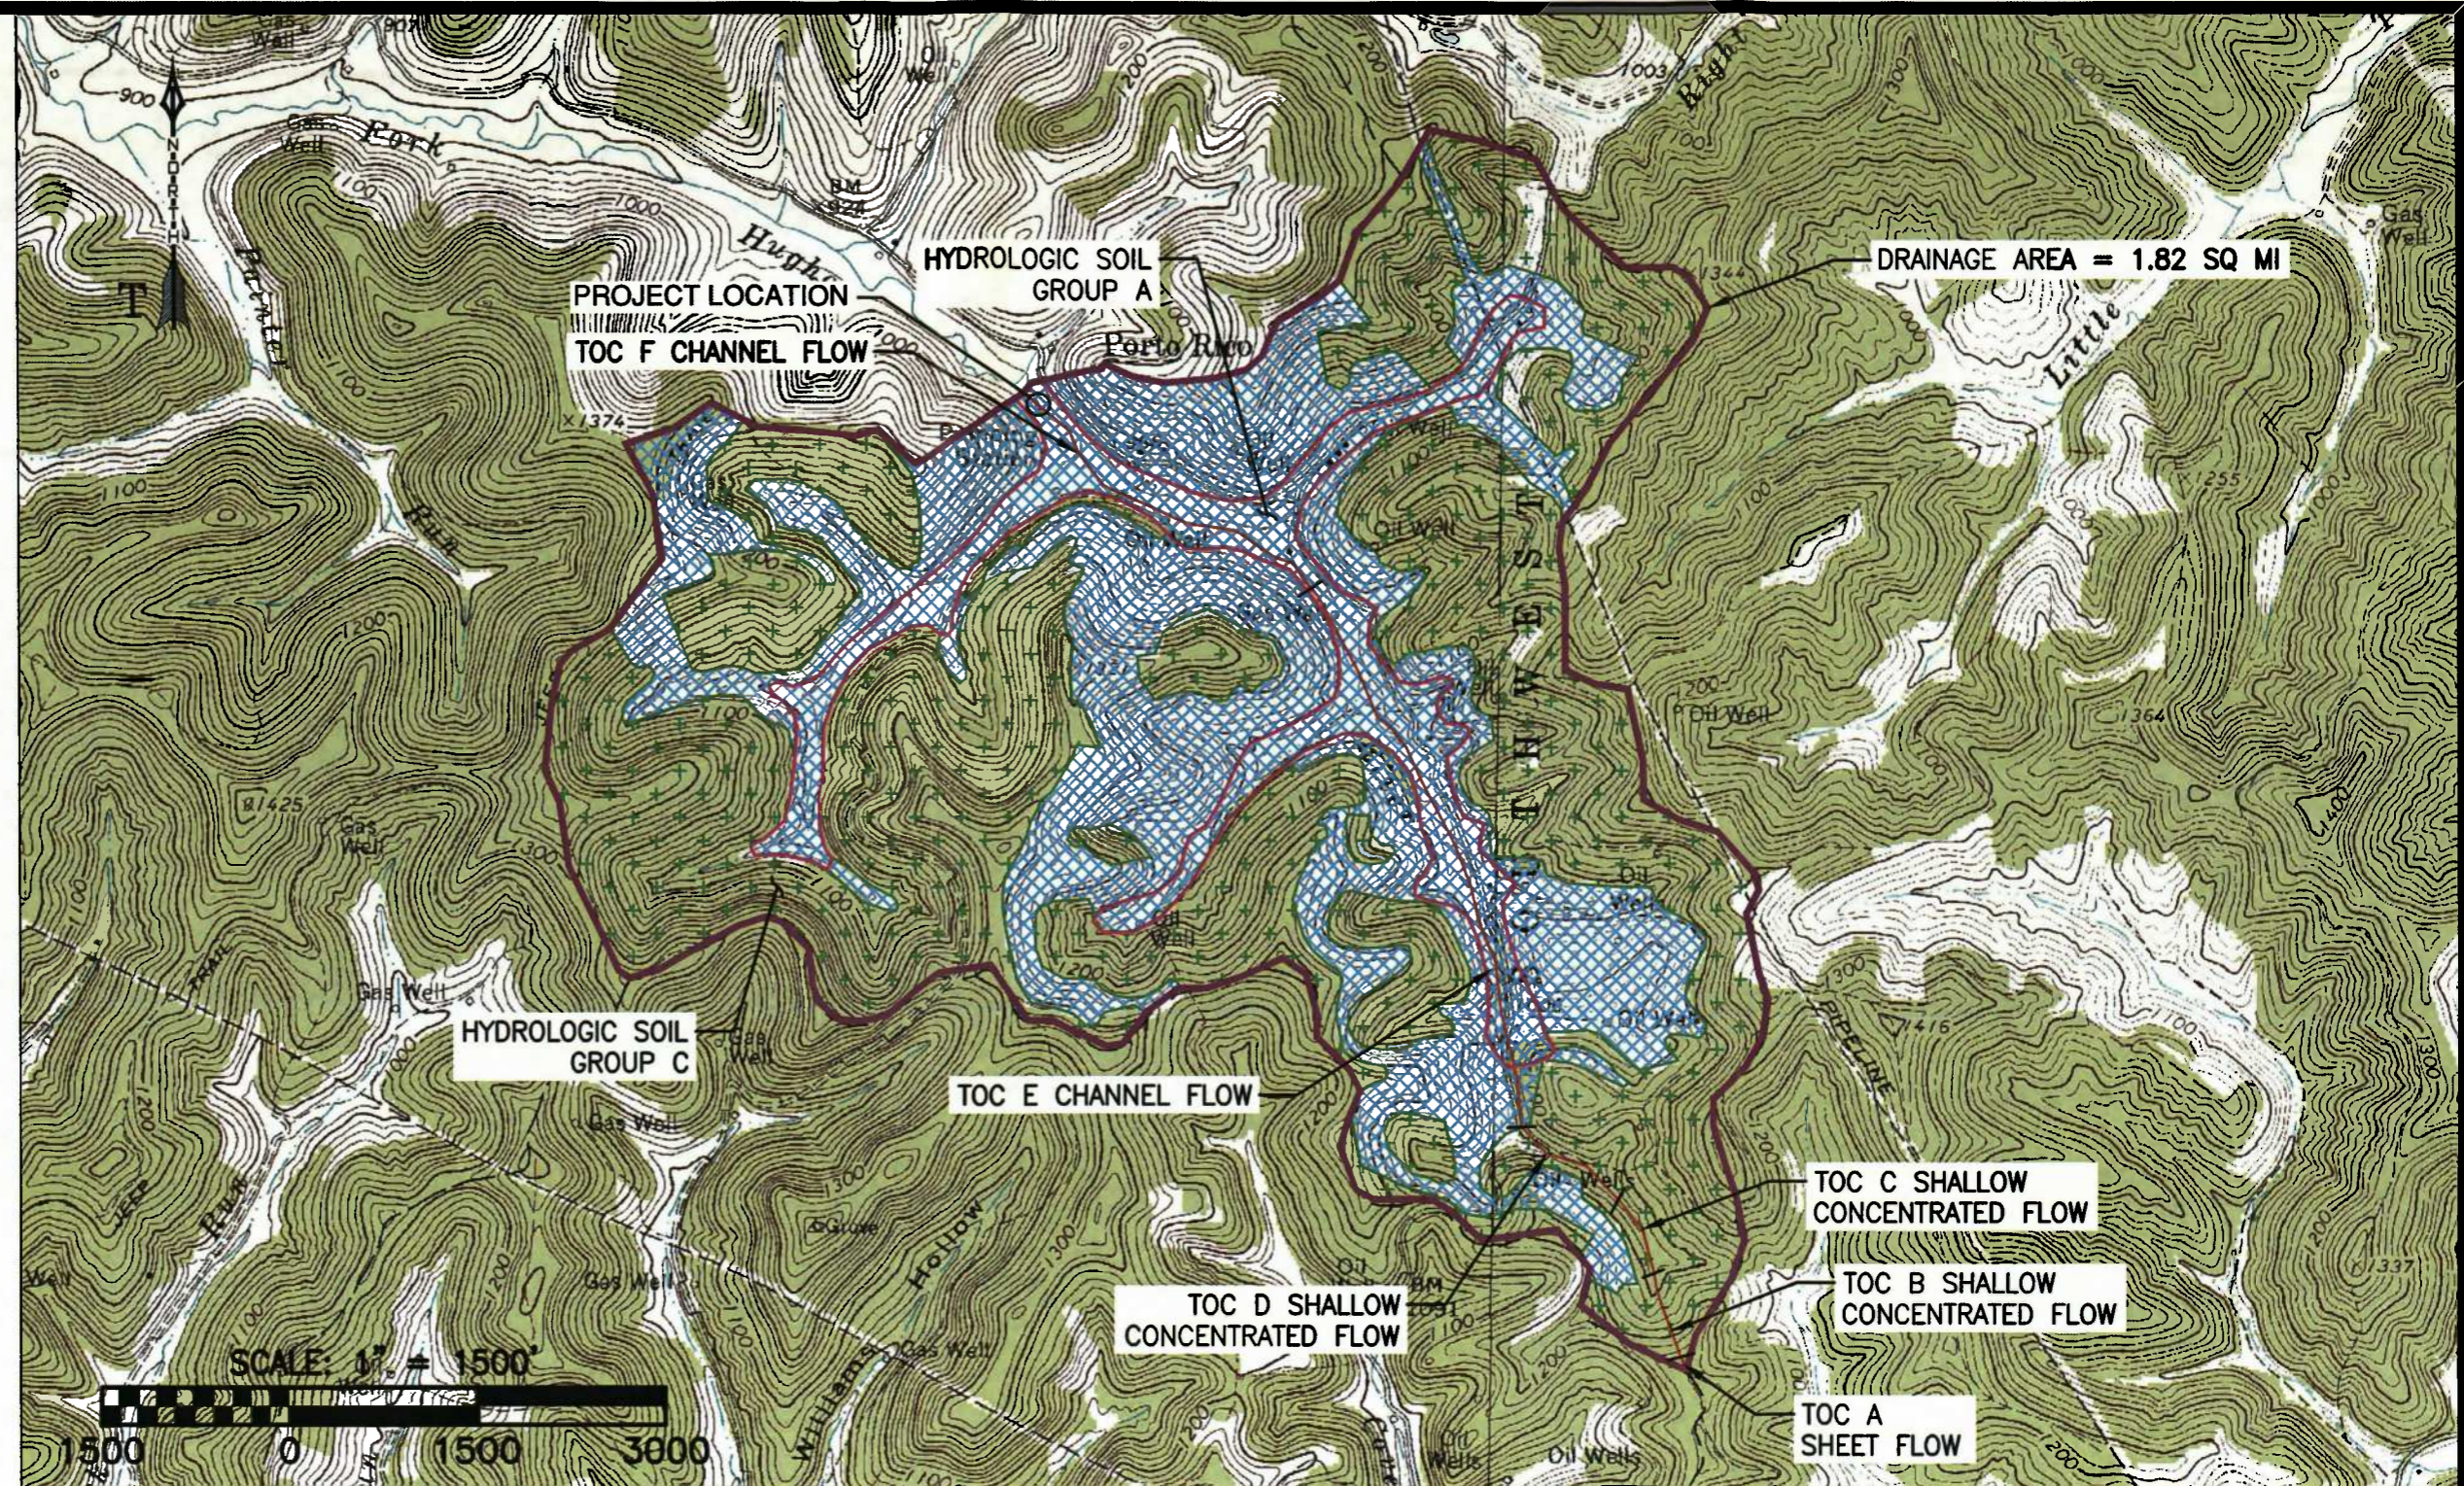


PLOTTED ON: 7/15/2015 1:35:42 PM PLOTTED BY: Shane Fisher PLOT FILE: GAI.stb

NO.:	DATE:	DWN:	CHK:	APV:	DESCRIPTION:

REVISION RECORD

DRAWING TITLE		
FIGURE 4 - DRAINAGE AREA MAP		
PROJECT	 gai consultants	CLIENT
2015 MAXWELL COMPRESSOR STATION		DOMINION TRANSMISSION, INC.
DODDRIDGE COUNTY, WV		5000 DOMINION BOULEVARD GLEN ALLEN, VA 23060

DRAWN BY:	CHECKED BY:	APPROVED BY:
VENDEVM	THOMAMT	BERKEME
REVISION	SCALE:	ISSUE DATE:
	AS SHOWN	07/17/2015
	SHEET NO.:	001 OF 001
GAI FILE NUMBER:		
C141803-36-000-00-A2-001		
GAI DRAWING NUMBER:		
C141803-36-000-00-A2-001		

This drawing was produced with computer aided drafting technology and is supported by electronic drawing files. Do not revise this drawing via manual drafting methods.

ISSUING OFFICE: Pittsburgh | 385 E. Waterfront Drive, Homestead, PA 15120

GAI CAD FILE PATH: Z:\Energy\2014\C141803.36 - Dom - Maxwell Station Hyd\CAD\Production Drawings\C141803-36-000-00-A2-001.dwg

© 2015 GAI Consultants, Inc.



Subject: Dominion – 2015 Maxwell Compressor Station-Hydrologic Calculations

By: THOMAMT Date: 07/09/2015 Project #: C141803.36

Chkd By: BERKEME Date: 07/09/2015 Sheet #: _____ of _____

Rainfall Data



NOAA Atlas 14, Volume 2, Version 3
Location name: Pullman, West Virginia, US*
Latitude: 39.1799°, Longitude: -80.7625°
Elevation: 924 ft*
 * source: Google Maps



POINT PRECIPITATION FREQUENCY ESTIMATES

G.M. Bonnin, D. Martin, B. Lin, T. Parzybok, M.Yekta, and D. Riley

NOAA, National Weather Service, Silver Spring, Maryland

[PF tabular](#) | [PF graphical](#) | [Maps & aerals](#)

PF tabular

PDS-based point precipitation frequency estimates with 90% confidence intervals (in inches)¹										
Duration	Average recurrence interval (years)									
	1	2	5	10	25	50	100	200	500	1000
5-min	0.332 (0.301-0.366)	0.396 (0.360-0.438)	0.475 (0.431-0.524)	0.534 (0.485-0.589)	0.610 (0.550-0.670)	0.666 (0.600-0.732)	0.720 (0.645-0.789)	0.774 (0.691-0.847)	0.844 (0.750-0.922)	0.895 (0.792-0.976)
10-min	0.516 (0.468-0.568)	0.619 (0.562-0.684)	0.738 (0.670-0.814)	0.825 (0.748-0.909)	0.933 (0.842-1.03)	1.01 (0.909-1.11)	1.08 (0.972-1.19)	1.16 (1.03-1.26)	1.24 (1.10-1.36)	1.30 (1.15-1.42)
15-min	0.632 (0.573-0.696)	0.756 (0.688-0.836)	0.906 (0.822-0.999)	1.02 (0.920-1.12)	1.15 (1.04-1.27)	1.25 (1.13-1.37)	1.35 (1.21-1.48)	1.44 (1.28-1.57)	1.55 (1.38-1.69)	1.63 (1.44-1.78)
30-min	0.836 (0.758-0.921)	1.01 (0.920-1.12)	1.24 (1.13-1.37)	1.41 (1.28-1.55)	1.63 (1.47-1.79)	1.79 (1.61-1.96)	1.94 (1.74-2.13)	2.10 (1.87-2.29)	2.29 (2.04-2.51)	2.44 (2.16-2.66)
60-min	1.02 (0.926-1.13)	1.24 (1.13-1.37)	1.56 (1.41-1.72)	1.79 (1.63-1.98)	2.11 (1.90-2.32)	2.36 (2.12-2.59)	2.60 (2.33-2.85)	2.85 (2.54-3.11)	3.17 (2.82-3.47)	3.43 (3.03-3.74)
2-hr	1.19 (1.07-1.32)	1.44 (1.31-1.61)	1.80 (1.63-2.00)	2.08 (1.88-2.31)	2.47 (2.21-2.72)	2.77 (2.47-3.05)	3.08 (2.74-3.38)	3.39 (3.00-3.71)	3.82 (3.35-4.18)	4.15 (3.63-4.54)
3-hr	1.27 (1.15-1.41)	1.53 (1.38-1.71)	1.92 (1.73-2.13)	2.21 (1.99-2.46)	2.63 (2.35-2.91)	2.95 (2.63-3.26)	3.30 (2.92-3.63)	3.64 (3.21-4.00)	4.12 (3.60-4.51)	4.51 (3.91-4.93)
6-hr	1.52 (1.38-1.69)	1.83 (1.66-2.03)	2.27 (2.05-2.51)	2.62 (2.36-2.89)	3.11 (2.79-3.42)	3.50 (3.13-3.85)	3.92 (3.49-4.29)	4.35 (3.85-4.75)	4.96 (4.34-5.40)	5.44 (4.73-5.92)
12-hr	1.80 (1.64-1.99)	2.16 (1.97-2.38)	2.64 (2.40-2.91)	3.04 (2.76-3.35)	3.60 (3.26-3.96)	4.07 (3.66-4.45)	4.55 (4.07-4.97)	5.07 (4.50-5.52)	5.79 (5.08-6.28)	6.38 (5.55-6.91)
24-hr	2.16 (1.99-2.35)	2.57 (2.37-2.80)	3.11 (2.86-3.39)	3.55 (3.26-3.86)	4.16 (3.81-4.52)	4.66 (4.26-5.05)	5.17 (4.71-5.60)	5.71 (5.18-6.17)	6.45 (5.82-6.95)	7.03 (6.32-7.57)
2-day	2.54 (2.36-2.74)	3.01 (2.80-3.25)	3.60 (3.34-3.88)	4.08 (3.78-4.40)	4.74 (4.38-5.10)	5.26 (4.86-5.66)	5.80 (5.34-6.23)	6.34 (5.82-6.80)	7.08 (6.48-7.59)	7.66 (6.98-8.20)
3-day	2.73 (2.55-2.94)	3.24 (3.02-3.48)	3.86 (3.60-4.14)	4.35 (4.05-4.67)	5.02 (4.66-5.38)	5.55 (5.15-5.94)	6.09 (5.63-6.51)	6.63 (6.11-7.08)	7.35 (6.75-7.84)	7.91 (7.24-8.43)
4-day	2.93 (2.74-3.14)	3.46 (3.24-3.71)	4.11 (3.85-4.41)	4.63 (4.32-4.95)	5.31 (4.95-5.67)	5.85 (5.44-6.23)	6.38 (5.92-6.79)	6.91 (6.40-7.35)	7.62 (7.03-8.09)	8.15 (7.50-8.65)
7-day	3.58 (3.37-3.80)	4.22 (3.97-4.48)	4.95 (4.65-5.25)	5.51 (5.18-5.84)	6.23 (5.85-6.60)	6.79 (6.36-7.18)	7.33 (6.86-7.75)	7.86 (7.34-8.31)	8.53 (7.95-9.02)	9.03 (8.40-9.54)
10-day	4.13 (3.91-4.37)	4.87 (4.60-5.15)	5.64 (5.33-5.97)	6.24 (5.89-6.59)	7.00 (6.60-7.39)	7.57 (7.12-7.99)	8.12 (7.63-8.56)	8.64 (8.11-9.11)	9.30 (8.71-9.80)	9.77 (9.14-10.3)
20-day	5.86 (5.56-6.18)	6.87 (6.51-7.25)	7.86 (7.45-8.28)	8.59 (8.14-9.06)	9.52 (9.01-10.0)	10.2 (9.64-10.7)	10.8 (10.2-11.4)	11.4 (10.8-12.0)	12.1 (11.4-12.8)	12.7 (11.9-13.3)
30-day	7.43 (7.06-7.82)	8.68 (8.24-9.14)	9.81 (9.31-10.3)	10.7 (10.1-11.2)	11.7 (11.1-12.3)	12.4 (11.8-13.1)	13.1 (12.4-13.8)	13.8 (13.0-14.5)	14.5 (13.7-15.3)	15.0 (14.2-15.8)
45-day	9.56 (9.10-10.0)	11.1 (10.6-11.7)	12.4 (11.8-13.0)	13.4 (12.8-14.1)	14.6 (13.9-15.3)	15.4 (14.7-16.2)	16.2 (15.4-17.0)	16.9 (16.0-17.7)	17.7 (16.7-18.5)	18.2 (17.2-19.1)
60-day	11.6 (11.1-12.1)	13.4 (12.8-14.0)	14.9 (14.2-15.6)	16.0 (15.3-16.7)	17.3 (16.5-18.0)	18.2 (17.4-19.0)	19.0 (18.1-19.8)	19.7 (18.8-20.6)	20.5 (19.6-21.4)	21.1 (20.1-22.0)

¹ Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS). Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values. Please refer to NOAA Atlas 14 document for more information.

[Back to Top](#)

PF graphical



Subject: Dominion – 2015 Maxwell Compressor Station-Hydrologic Calculations

By: THOMAMT Date: 07/09/2015 Project #: C141803.36

Chkd By: BERKEME Date: 07/09/2015 Sheet #: _____ of _____

Soil Data

Soil Information for All Uses

Soil Properties and Qualities

The Soil Properties and Qualities section includes various soil properties and qualities displayed as thematic maps with a summary table for the soil map units in the selected area of interest. A single value or rating for each map unit is generated by aggregating the interpretive ratings of individual map unit components. This aggregation process is defined for each property or quality.

Soil Qualities and Features

Soil qualities are behavior and performance attributes that are not directly measured, but are inferred from observations of dynamic conditions and from soil properties. Example soil qualities include natural drainage, and frost action. Soil features are attributes that are not directly part of the soil. Example soil features include slope and depth to restrictive layer. These features can greatly impact the use and management of the soil.

Hydrologic Soil Group

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.


Custom Soil Resource Report

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.


Custom Soil Resource Report Map—Hydrologic Soil Group

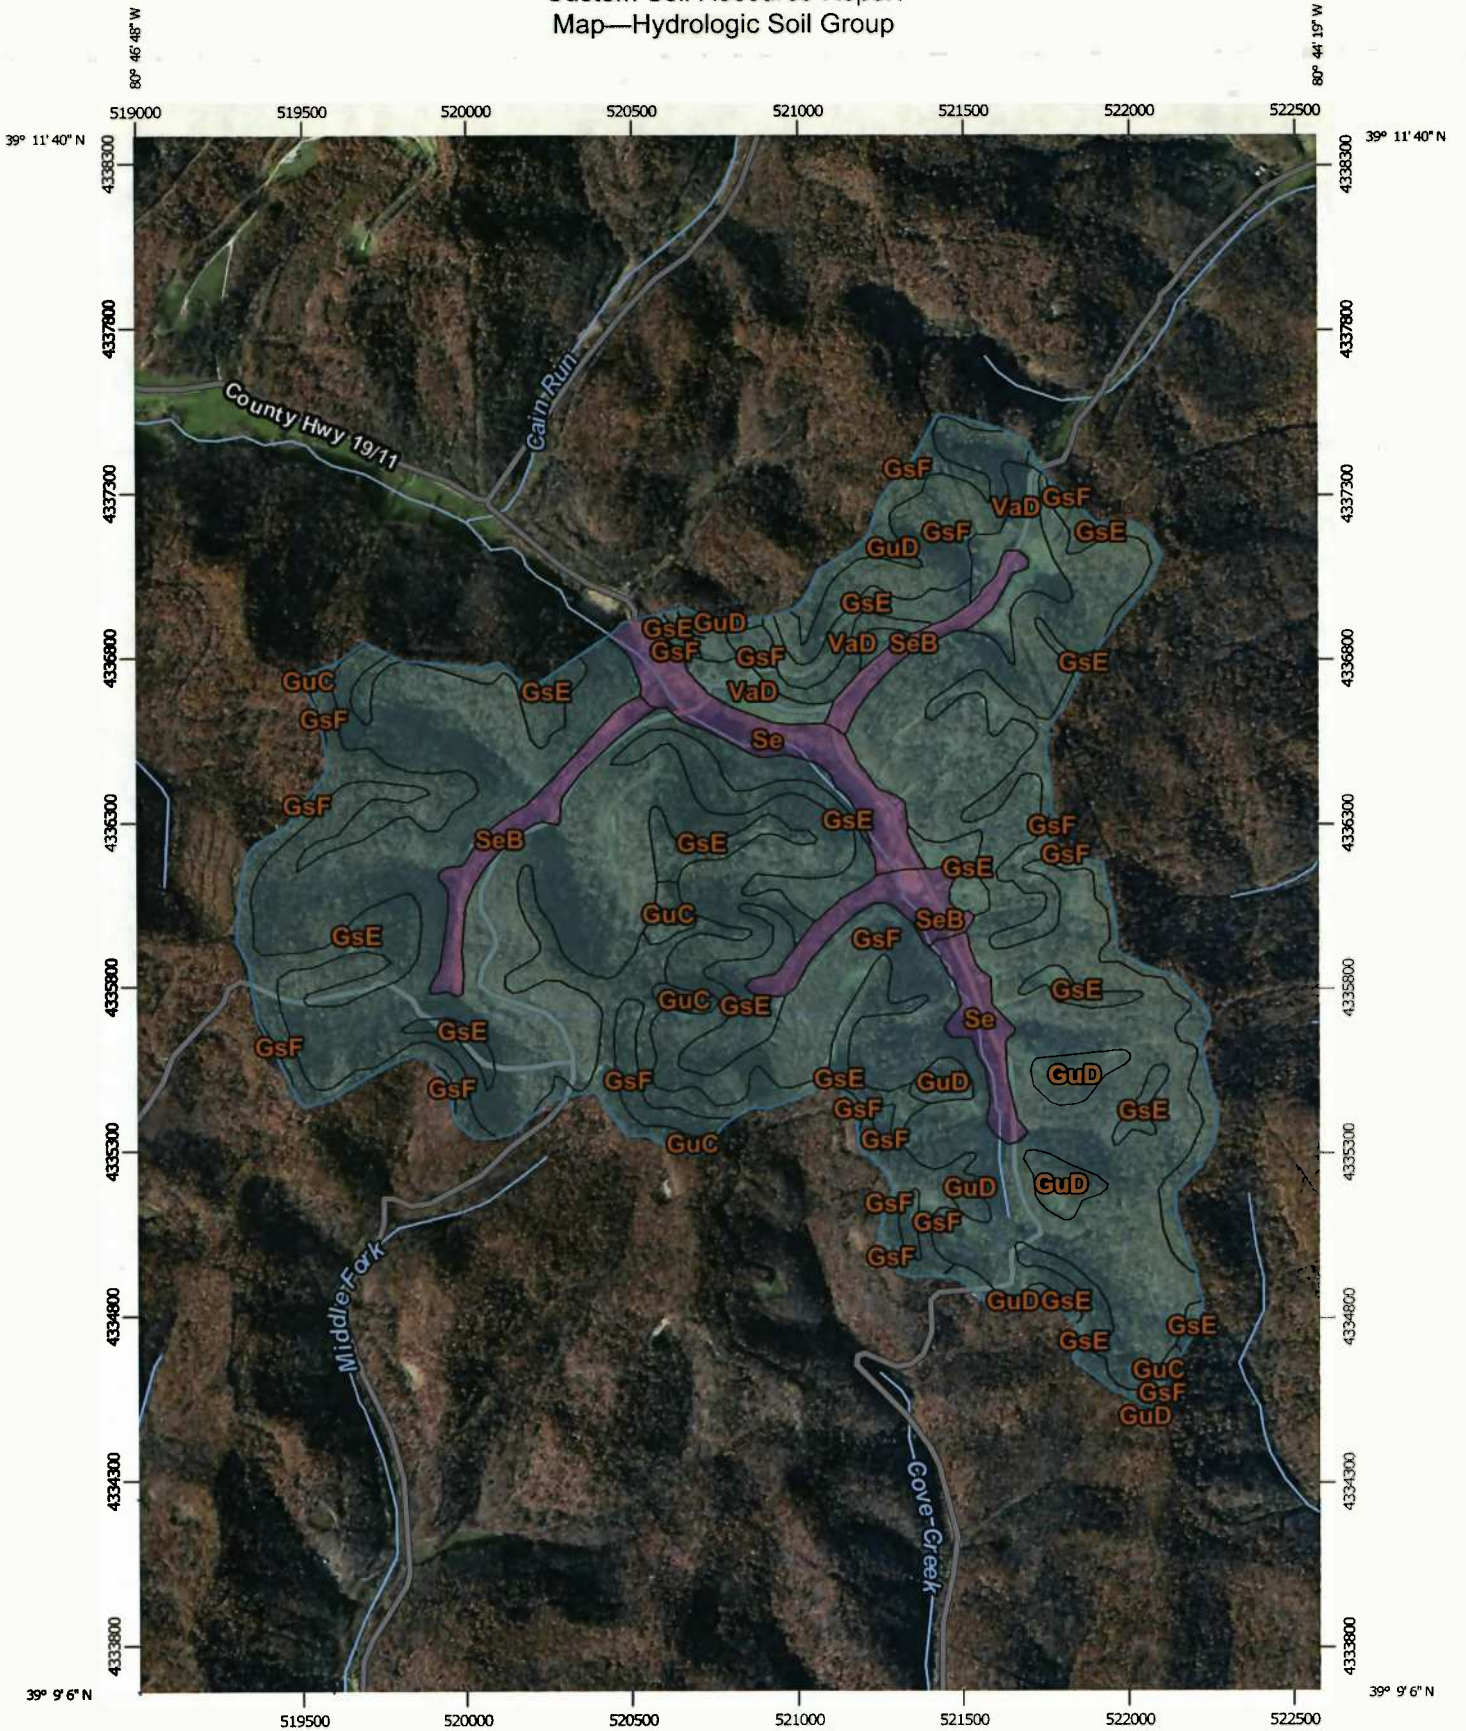

80° 46' 48" W



Map Scale: 1:23,000 if printed on A portrait (8.5" x 11") sheet.




Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 17N WGS84

Custom Soil Resource Report







MAP LEGEND

Area of Interest (AOI)









 Area of Interest (AOI)

Soils

Soil Rating Polygons





 A
 A/D
 B
 B/D
 C
 C/D
 D
 Not rated or not available

Soil Rating Lines

 A
 A/D
 B
 B/D
 C
 C/D
 D
 Not rated or not available

Soil Rating Points





 A
 A/D
 B
 B/D

 C
 C/D
 D
 Not rated or not available


Water Features

 Streams and Canals

Transportation

 Rails
 Interstate Highways
 US Routes
 Major Roads
 Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
 Web Soil Survey URL: <http://websoilsurvey.nrcs.usda.gov>
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Doddridge County, West Virginia
 Survey Area Data: Version 10, Sep 25, 2014

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Oct 8, 2011—Oct 25, 2011

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Custom Soil Resource Report

Table—Hydrologic Soil Group

Hydrologic Soil Group— Summary by Map Unit — Doddridge County, West Virginia (WV017)				
Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
GsE	Gilpin-Peabody complex, 15 to 35 percent slopes, very stony	C	279.1	24.0%
GsF	Gilpin-Peabody complex, 35 to 70 percent slopes, very stony	C	697.2	59.9%
GuC	Gilpin-Upshur silt loams, 8 to 15 percent slopes	C	11.7	1.0%
GuD	Gilpin-Upshur silt loams, 15 to 25 percent slopes	C	43.8	3.8%
Se	Sensabaugh silt loam	A	50.8	4.4%
SeB	Sensabaugh silt loam, 3 to 8 percent slopes, rarely flooded	A	48.9	4.2%
VaD	Vandalia silt loam, 15 to 25 percent slopes	C	31.7	2.7%
Totals for Area of Interest			1,163.3	100.0%

Rating Options—Hydrologic Soil Group*Aggregation Method: Dominant Condition**Component Percent Cutoff: None Specified**Tie-break Rule: Higher*




Subject: Dominion – 2015 Maxwell Compressor Station-Hydrologic Calculations

By: THOMAMT Date: 07/09/2015 Project #: C141803.36

Chkd By: BERKEME Date: 07/09/2015 Sheet #: _____ of _____

USGS Method (SIR 2010-5033)

Project: Dominion - 2015 Maxwell Compressor Station	By: THOMAMT	Date: 7/9/2015	 gai consultants
Location: Downstream of Proposed Structure	Checked: BERKEME	Date: 7/9/2015	

Method:
Use the United States Geological Survey (USGS) Regression Method to determine 100-year peak flow rates at the Project Site in Kanawha County, WV.

- References:**
- 1) West Virginia Department of Transportation, Division of Highways (WVDOH), Drainage Manual, 3rd Edition with May 2, 2012 Revisions.
 - 2) United States Geological Survey (USGS) Scientific Investigations Report (SIR) 2010-5033 (2010).

Calculations:

Region		Drainage Area Limitations (sq. miles)
Eastern Panhandle		0.21 - 1,461
Central Mountains		0.10 - 1,619
Western Plateaus	X	0.13 - 1,516

Equations (Ref. 1, Table 4-14)

$$Q_{100} = 557 * A^{0.674}$$

Drainage Area (A) sq. miles
1.82

Flow (Q) cfs


100-year	834
----------	-----

*Add standard prediction error since watershed size is less than 10 sq. miles (Ref. 1)


100-year Error: 31.4 (Ref. 1, Table 4-14)

Adjusted Flow (Q) cfs


100-year	1,096	Adjusted Flow (Q) cfs = Flow (Q) x 1.314
----------	-------	--

Project: Dominion - 2015 Maxwell Compressor Station	By: THOMAMT	Date: 7/9/2015	 gai consultants
Location: Downstream of Proposed Structure	Checked: BERKEME	Date: 7/9/2015	

**Map 4-10
Hydrologic Regions in West Virginia**

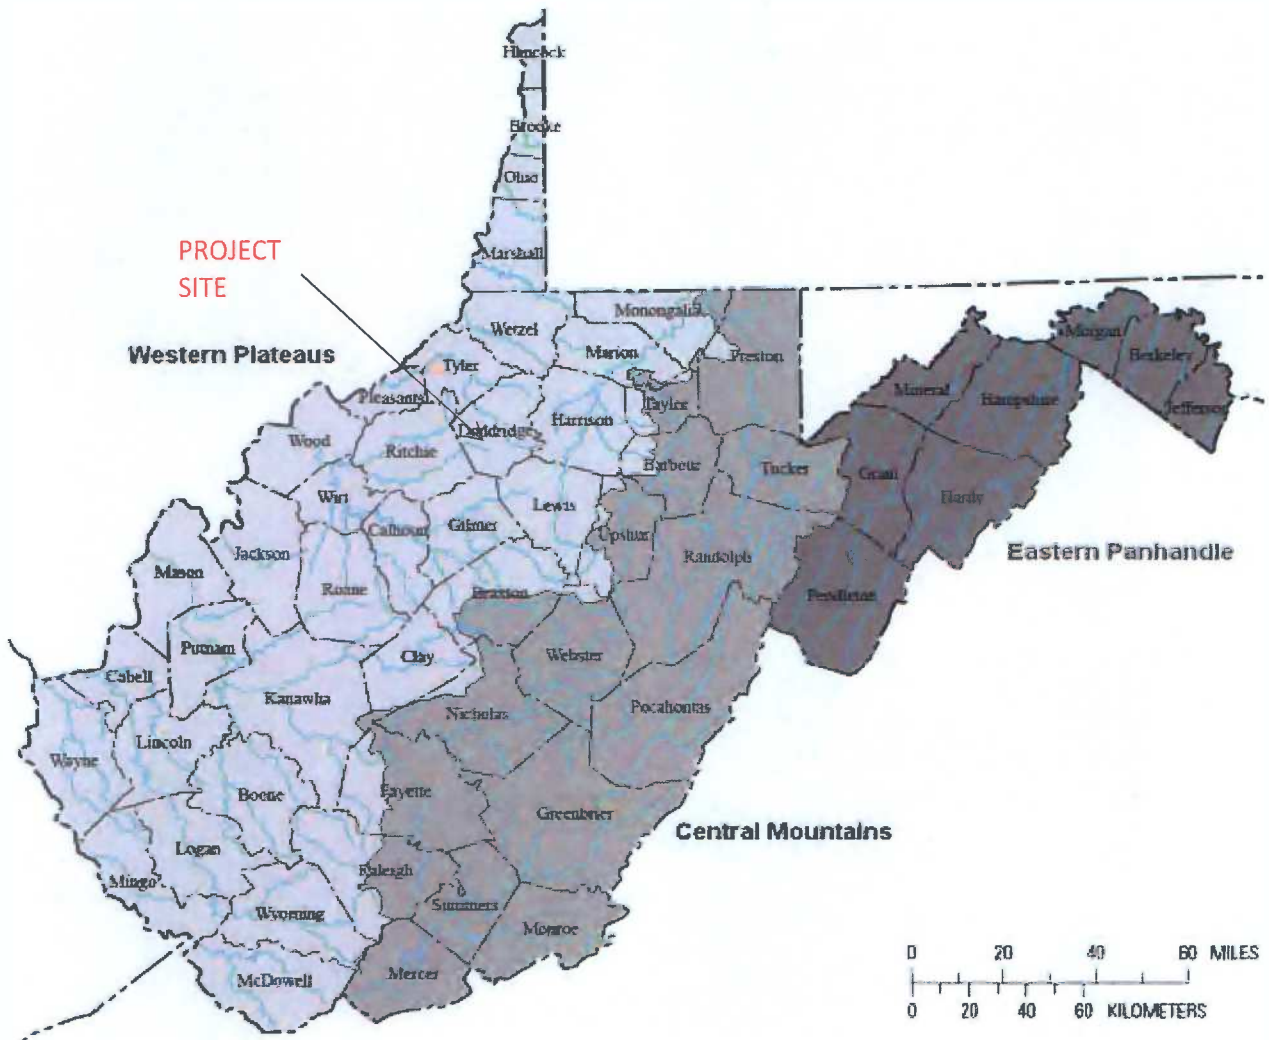

Source: USGS Scientific Investigations Report 2010-5033 (2010)

Project: Dominion - 2015 Maxwell Compressor Station	By: THOMAMT	Date: 7/9/2015	 gai consultants
Location: Downstream of Proposed Structure	Checked: BERKEME	Date: 7/9/2015	

**Table 4-14
USGS Regional Regression Equations for Rural Areas (2010)**

DRAINAGE AREA (A) IS IN SQUARE MILES					
1 MILE ² = 640 ACRES					
1 MILE ² = 27,878,400 SQUARE FEET					
RECURRENCE INTERVAL OR RETURN PERIOD	EXCEEDENCE PROBABILITY OR FREQUENCY	REGRESSION EQUATION	STANDARD ERROR OF MODEL IN PERCENT	AVERAGE STANDARD ERROR OF SAMPLING IN	AVERAGE PREDICTION ERROR IN PERCENT
EASTERN PANHANDLE REGION					
1.1	90%	29.6 A ^{0.818}	43.4	10.3	44.8
1.5	67%	46.4 A ^{0.828}	35.7	8.9	36.9
2	50%	59.8 A ^{0.832}	32.1	8.6	33.4
5	20%	105 A ^{0.838}	25.6	8.9	27.2
10	10%	145 A ^{0.842}	22.5	9.5	24.5
25	4%	204 A ^{0.848}	19.7	10.3	22.4
50	2%	254 A ^{0.852}	18.6	11.1	21.7
100	1%	307 A ^{0.855}	18.3	11.6	21.7
200	0.50%	365 A ^{0.859}	18.4	12.4	22.4
500	0.20%	447 A ^{0.864}	19.4	13.5	23.8
CENTRAL MOUNTAINS REGION					
1.1	90%	33.4 A ^{0.914}	40.0	8.3	41.0
1.5	67%	53.8 A ^{0.887}	34.6	7.3	35.4
2	50%	69.4 A ^{0.873}	33.4	7.3	34.2
5	20%	116 A ^{0.845}	34.1	8.0	35.1
10	10%	153 A ^{0.831}	36.3	8.6	37.4
25	4%	206 A ^{0.816}	39.9	9.8	41.2
50	2%	250 A ^{0.807}	42.9	10.6	44.4
100	1%	297 A ^{0.800}	46.2	11.3	47.9
200	0.50%	347 A ^{0.793}	49.7	12.0	51.5
500	0.20%	420 A ^{0.785}	54.3	13.1	56.3
WESTERN PLATEAUS REGION					
1.1	90%	56.9 A ^{0.763}	38.2	7.6	39.1
1.5	67%	97.8 A ^{0.741}	33.4	6.5	34.1
2	50%	129 A ^{0.730}	31.6	6.1	32.2
5	20%	221 A ^{0.710}	29.3	6.5	30.0
10	10%	292 A ^{0.699}	28.9	6.5	29.7
25	4%	391 A ^{0.688}	29.4	7.3	30.3
50	2%	472 A ^{0.681}	30.2	7.6	31.3
100	1%	557 A ^{0.674}	31.4	8.0	32.5
200	0.50%	647 A ^{0.668}	32.7	8.3	33.9
500	0.20%	775 A ^{0.661}	34.8	8.9	36.1

Source: USGS SIR Report 2010-5033 (2010)



Subject: Dominion – 2015 Maxwell Compressor Station-Hydrologic Calculations

By: THOMAMT Date: 07/09/2015 Project #: C141803.36

Chkd By: BERKEME Date: 07/09/2015 Sheet #: _____ of _____

TR-55 Method

Project: Maxwell Compressor Station Existing Conditions C141803.36	By: VENDEVN	Date: 7/9/2015
Location: Doddridge County, WV	Checked: THOMAMT	Date: 7/9/2015

Check one: Present Developed


Hydrologic Group	Cover Description	CN			Area	Product of CN x Area
		Table 4-9*	Figure 2-3	Figure 2-4	<input checked="" type="checkbox"/> Acres <input type="checkbox"/> miles ² <input type="checkbox"/> %	
C	Forested- Woods Only (Good Condition)	70			671.2	46984.0
A	Meadow (Good Condition)	30			99.7	2991.0
C	Meadow (Good Condition)	71			392.4	27860.4
TOTALS					1163.3	77835.4

CN (weighted) = Total Product / Total Area

CN	67
-----------	-----------

*From WVDOH "Drainage Manual", 2007 Edition, Addendum December 2012.

Return Period in years	100
24-hr Rainfall Depth, P in inches	5.17

Project: Maxwell Compressor Station Existing Conditions	By: BERKEME	Date: 7/13/2015	
Location: Doddridge County, WV	Checked: THOMAMT	Date: 7/13/2015	

Check one: Present Under Development Developed

Sheet Flow

Segment ID	A	
Surface Description.....	Woods	
Manning's Roughness Coefficient, n	0.6	(TR-55, Table 3-1)
Flow Length, L.....	100	ft
Two-year 24-hour Rainfall, P ₂	2.57	in (NOAA Atlas 14)
Land Slope, s.....	0.100	ft/ft
Travel Time, T _t = (0.007*(n*L) ^{0.8}) / (P ₂ ^{0.5} *s ^{0.4}).....	0.2902	hrs

Shallow Concentrated Flow

Segment ID	B	C	D	
Surface Description (Paved / Unpaved).....	Unpaved	Unpaved	Unpaved	
Surface Description Coefficient, C.....	16.13	16.13	16.13	
Flow Length, L.....	708	667	1005	ft
Watercourse Slope, s.....	0.254	0.055	0.020	ft/ft
Average Velocity, V = C*s ^{0.5}	8.14	3.78	2.28	ft/sec
Travel Time, T _t = (L) / (3600*V).....	0.024	0.049	0.122	hrs

Channel Flow

Segment ID	E	F	
Section Base, b.....	8	10	ft
Section Depth, d.....	2.5	3	ft
Section Side Slope, z.....	2	2	
Cross Sectional Flow Area, a = b*d + z*d ²	32.5	48	sq ft
Wetted Perimeter, p _w = b + (2*d)*(z ² + 1) ^{0.5}	19.18	23.42	ft
Hydraulic Radius, r = a / p _w	1.69	2.05	ft
Channel Slope, s.....	0.016	0.007	ft/ft
Manning's Roughness Coefficient, n.....	0.045	0.045	
Average Velocity, V = (1.49*r ^{2/3} *s ^{1/2}) / (n).....	5.96	4.56	ft/sec
Flow Length, L.....	4726	2866	ft
Travel Time, T _t = (L) / (3600*V).....	0.2201	0.1746	hrs

Time of Concentration

Sheet Flow T _t	0.2902	hrs
Shallow Concentrated Flow T _t	0.1955	hrs
Channel Flow T _t	0.3947	hrs
Time of Concentration, T _c	0.88	hrs
	53	mins

Hydrograph Plot

Hydraflow Hydrographs by Intelisolve

Monday, Jul 13 2015, 11:25 AM

Hyd. No. 1

Maxwell Compressor Station-Existing Conditions


Hydrograph type = SCS Runoff
Storm frequency = 100 yrs
Drainage area = 1163.000 ac
Basin Slope = 0.0 %
Tc method = USER
Total precip. = 5.17 in
Storm duration = 24 hrs

Peak discharge = 1192.24 cfs
Time interval = 6 min
Curve number = 67
Hydraulic length = 0 ft
Time of conc. (Tc) = 53.00 min
Distribution = Type II
Shape factor = 484

Hydrograph Volume = 8,115,735 cuft

Maxwell Compressor Station-Existing Conditions

Hyd. No. 1 -- 100 Yr

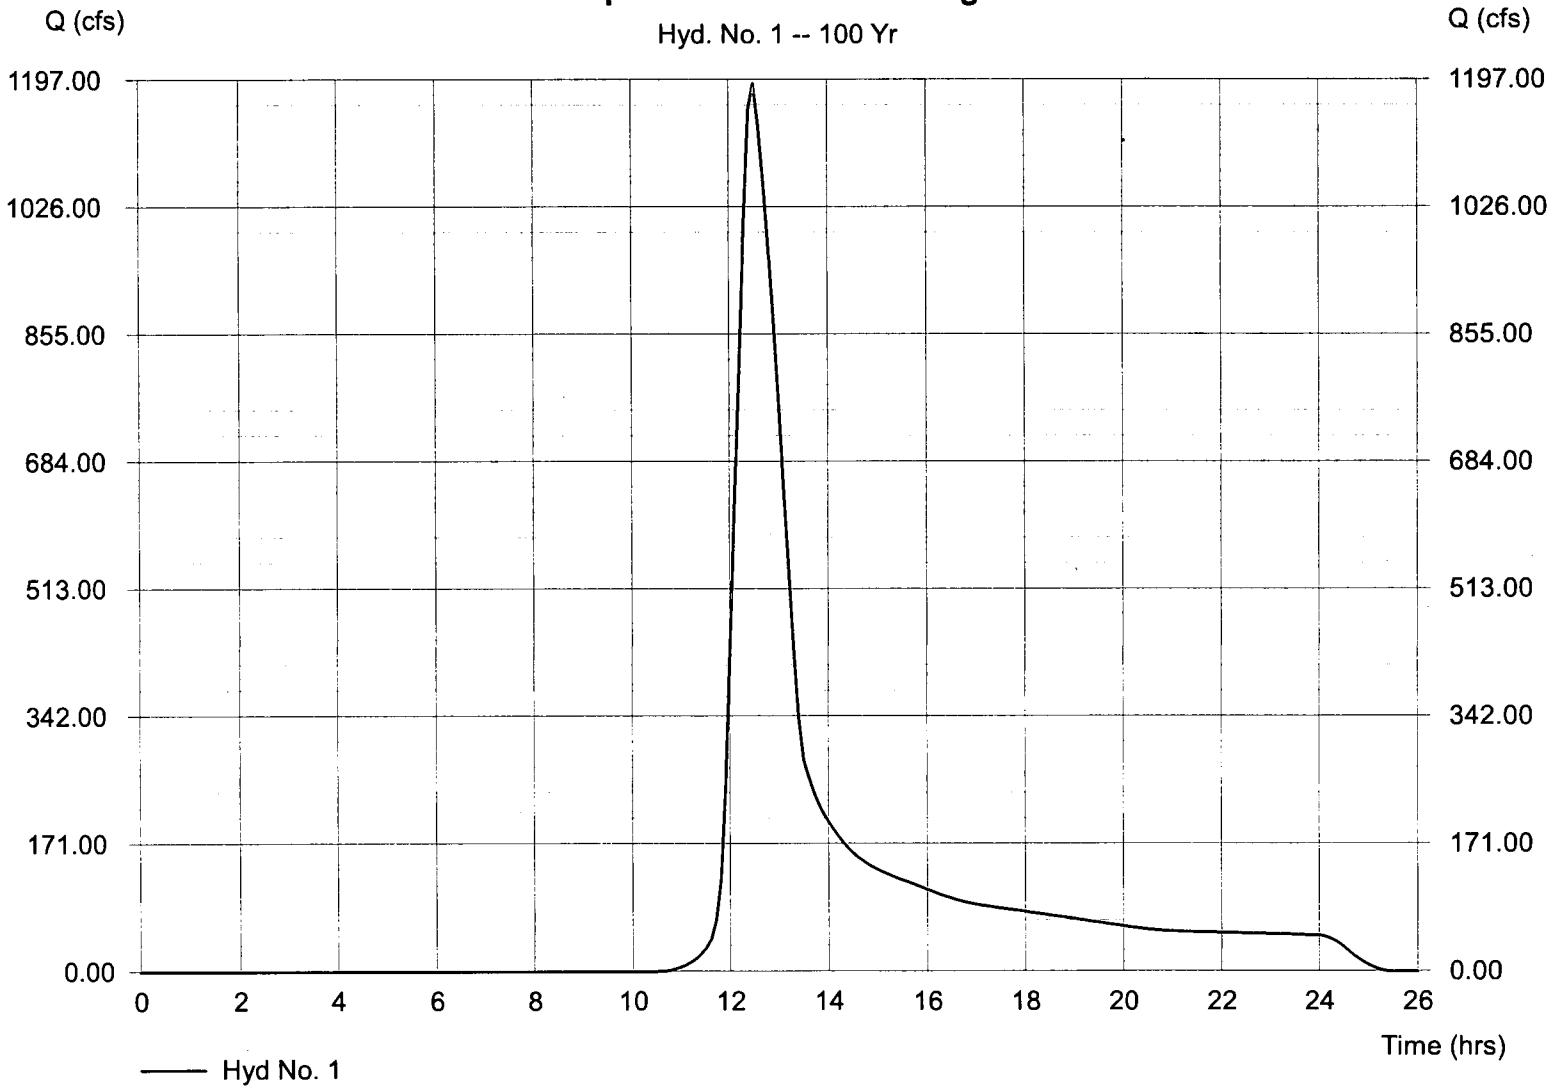

ATTACHMENT 4 Hydraulic Calculations

Subject: Dominion-2015 Maxwell Compressor Station – New Building, Doddridge County, WV
Hydraulic Calculations for Floodplain Development Application

By: BerkeME Date: 07/09/2015 Project #: C141803.36
Chkd By: ThomaMT Date: 07/13/2015 Sheet #: _____ of _____



gai consultants

OBJECTIVE:

Create the existing and proposed conditions hydraulic models in HEC-RAS for South Fork Hughes River upstream and downstream of the project area.

REFERENCES:

1. HEC-RAS Version 4.1.0, U.S. Army Corps of Engineers, January 2010.
2. Hydrology Calculations –Dominion- 2015 Maxwell Compressor Station- New Building
3. Project mapping and topographic information.
4. Field view notes, 06/30/2015.

METHOD:

HEC-RAS cross sections for the model are developed from a combination of project mapping and field measurement. Hydraulic conditions, including Manning's n values, contraction and expansion coefficients, stream cross section geometry, and culvert modeling methodologies were determined based on field observations, measurement, and engineering judgment and are summarized in this calculation set. Estimated flows are simulated in HEC-RAS and the existing and proposed water surface elevations and velocities are calculated at various locations around the project site.

CROSS SECTIONS:

Seven cross sections (two upstream of the proposed crossing location and five downstream) have been created for the existing conditions model. A cross section location map is provided on sheet 3. The general shape of each cross section was determined from contour interval mapping and field measurement. Locations of existing and proposed structures included in the model were based on mapping provided by Dominion and field verification.

HYDROLOGIC CONDITIONS:

Flow rates at the project site were evaluated using the United States Geological Survey (USGS) method, Scientific Investigations Report (SIR) 2010-5033 and the United States Department of Agriculture (USDA) National Resources Conservation Service (NRCS) TR-55 Method. The TR-55 100-year peak discharge of 1,192 cfs was adopted for the modeling.

BOUNDARY CONDITIONS:

The boundary condition selected for the model was a normal depth at the downstream limit of the reach. The slope was originally estimated to be the slope of the stream bed, and after the first iteration of the model it was adjusted to reflect the slope of the 100-year water surface elevation at the downstream modeling limit (approximately 0.02 ft/ft).

Subject: Dominion–2015 Maxwell Compressor Station – New Building, Doddridge County, WV
Hydraulic Calculations for Floodplain Development Application

By: BerkeME Date: 07/09/2015 Project #: C141803.36
 Chkd By: ThomaMT Date: 07/13/2015 Sheet #: _____ of _____



gai consultants

HYDRAULIC CONDITIONS:

Information concerning the hydraulic conditions was noted during the project's field view. The stream consists of silty mud. The banks are heavily vegetated and the stream has riffles, pools, and several small meanders throughout the reach. Based on observations taken in the field, Manning's n values were estimated to be approximately 0.045 for the channel. The floodplains were vegetated with heavy brush, and a Manning's n of 0.10 was selected for these areas. The existing compressor station is a fenced gravel area, and a Manning's n of 0.075 was selected for the fenced gravel areas due to the fence's ability to become blocked with debris. The existing buildings and structures shown on Figure 5 were modeled as obstructions in the cross section data editor.

The existing culverts (two 4-foot diameter Corrugated Metal Pipe Culverts) and access road crossing downstream of the proposed building was modeled using the HEC-RAS culvert data editor. In the HEC-RAS culvert data editor, an entrance coefficient of 0.9 was used to represent a pipe projecting from fill and Chart # 2 (Corrugated Metal Pipe Culvert) and Scale # 3 (Pipe Projecting from fill) were selected. Expansion contraction coefficients were increased to 0.3 and 0.5 at the upstream and downstream bounding sections, and ineffective flow areas were set to reflect the flow obstruction caused by the proposed access road. Stations for the ineffective flow areas were determined by using an expansion and contraction ratio of 1:1.

PROPOSED CONDITIONS:

There is currently an existing engine oil tank on fill, at the proposed compressor building location (See Figure 5 and Cross Section 46324.2). In the hydraulic model, the two smaller obstructions representing the existing tank and other structure were modified to represent one larger obstruction for the proposed 42' x 42' building. The Proposed Conditions hydraulic model is identical to the Existing Conditions model in all other locations.

RESULTS:

The results of the existing conditions HEC-RAS Hydraulic model are included at the end of this calculation. The proposed structure shows no increase in 100-year water surface elevations or velocity over existing conditions. Information provided includes the summary table, culvert output table, the profile of South Fork Hughes River within the studied reach, and the cross section plots for the entire model.

The HEC-RAS notes and warning messages for the model have been reviewed and considered. Input data has been checked for consistency with field conditions and design experience, as has the solutions provided by HEC-RAS.



PLOTTED ON: 7/15/2015 8:48:30 AM PLOTTED BY: Mary Beth Berkes PLOT FILE: GAL.stb

NO.:	DATE:	DWN:	CHK:	APV:	DESCRIPTION:

REVISION RECORD

DRAWING TITLE		DRAWN BY:	CHECKED BY:	APPROVED BY:
CROSS SECTION LOCATION MAP		BERKEME	THOMAMT	MEDVEDL
PROJECT	CLIENT	REVISION	SCALE:	ISSUE DATE:
2015 MAXWELL COMPRESSOR STATION	DODDRIDGE COUNTY, WV		AS SHOWN	07/17/2015
gai consultants		SHEET NO.:		
		001 OF 001		
DOMINION TRANSMISSION, INC. 5000 DOMINION BOULEVARD GLEN ALLEN, VA 23060		GAI FILE NUMBER:		
2015 MAXWELL COMPRESSOR STATION DODDRIDGE COUNTY, WV		C141803-36-000-00-A2-002		
2015 MAXWELL COMPRESSOR STATION DODDRIDGE COUNTY, WV		GAI DRAWING NUMBER:		
2015 MAXWELL COMPRESSOR STATION DODDRIDGE COUNTY, WV		C141803-36-000-00-A2-001		

This drawing was produced with computer aided drafting technology and is supported by electronic drawing files. Do not revise this drawing via manual drafting methods.

ISSUING OFFICE: Pittsburgh | 385 E. Waterfront Drive, Homestead, PA 15120

GAI CAD FILE PATH: Z:\Energy\2014\C141803.36 - Dom - Maxwell Station Hyd\CAD\Production Drawings\C141803-36-000-00-A2-002.dwg

Subject: Dominion-2015 Maxwell Compressor Station – New Building, Doddridge County, WV
Hydraulic Calculations for Floodplain Development Application

By: BerkeME Date: 07/09/2015 Project #: C141803.36
Chkd By: ThomaMT Date: 07/13/2015 Sheet #: _____ of _____




gai consultants



EXISTING CONDITIONS

HEC-RAS Plan: Existing River: SFHGHRSVR Reach: Main Profile: P100yr


Reach	River Sta	Profile	Q Total (cfs)	Min Ch El (ft)	W.S. Elev (ft)	Crit W.S. (ft)	E.G. Elev (ft)	E.G. Slope (ft/ft)	Vel Chnl (ft/s)	Flow Area (sq ft)	Top Width (ft)	Froude # Chl
Main	45723.6	P100yr	1192.00	913.20	916.04	916.03	917.06	0.020026	8.43	176.28	99.16	0.95
Main	45851.4	P100yr	1192.00	914.39	920.10	920.10	920.88	0.011726	9.35	322.53	182.70	0.77
Main	46014.1	P100yr	1192.00	917.39	924.55	924.55	925.19	0.006028	8.05	417.74	310.76	0.57
Main	46080	Culvert										
Main	46087.4	P100yr	1192.00	917.41	925.52	922.96	925.56	0.000618	2.84	1079.31	298.55	0.19
Main	46324.2	P100yr	1192.00	918.00	925.65		925.70	0.000717	2.95	1025.70	309.83	0.20
Main	46405.6	P100yr	1192.00	917.75	925.63		925.83	0.002135	5.20	609.75	239.27	0.35
Main	46468	P100yr	1192.00	919.00	925.82		925.96	0.002211	4.73	687.43	288.70	0.35

Maxwell Compressor Station Plan: Existing Conditions 7/13/2015

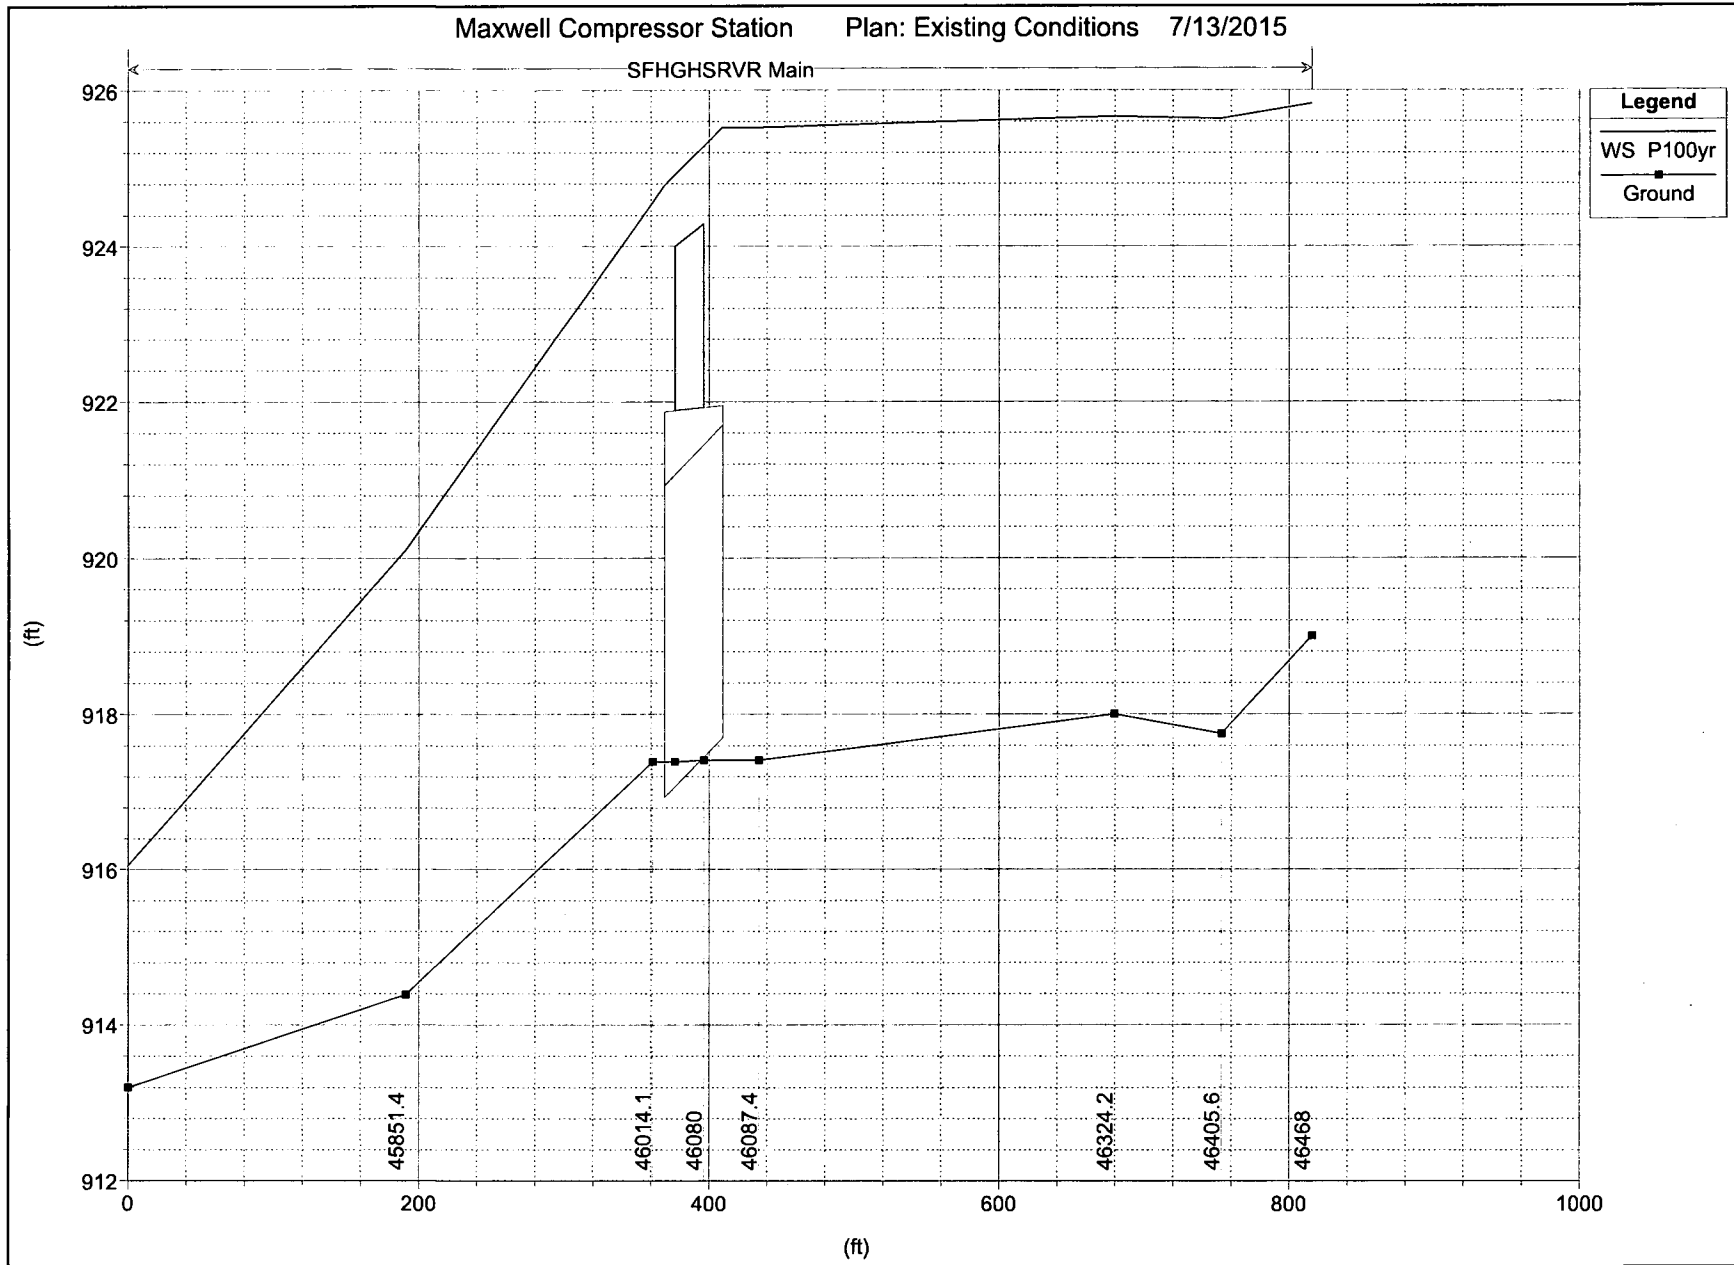


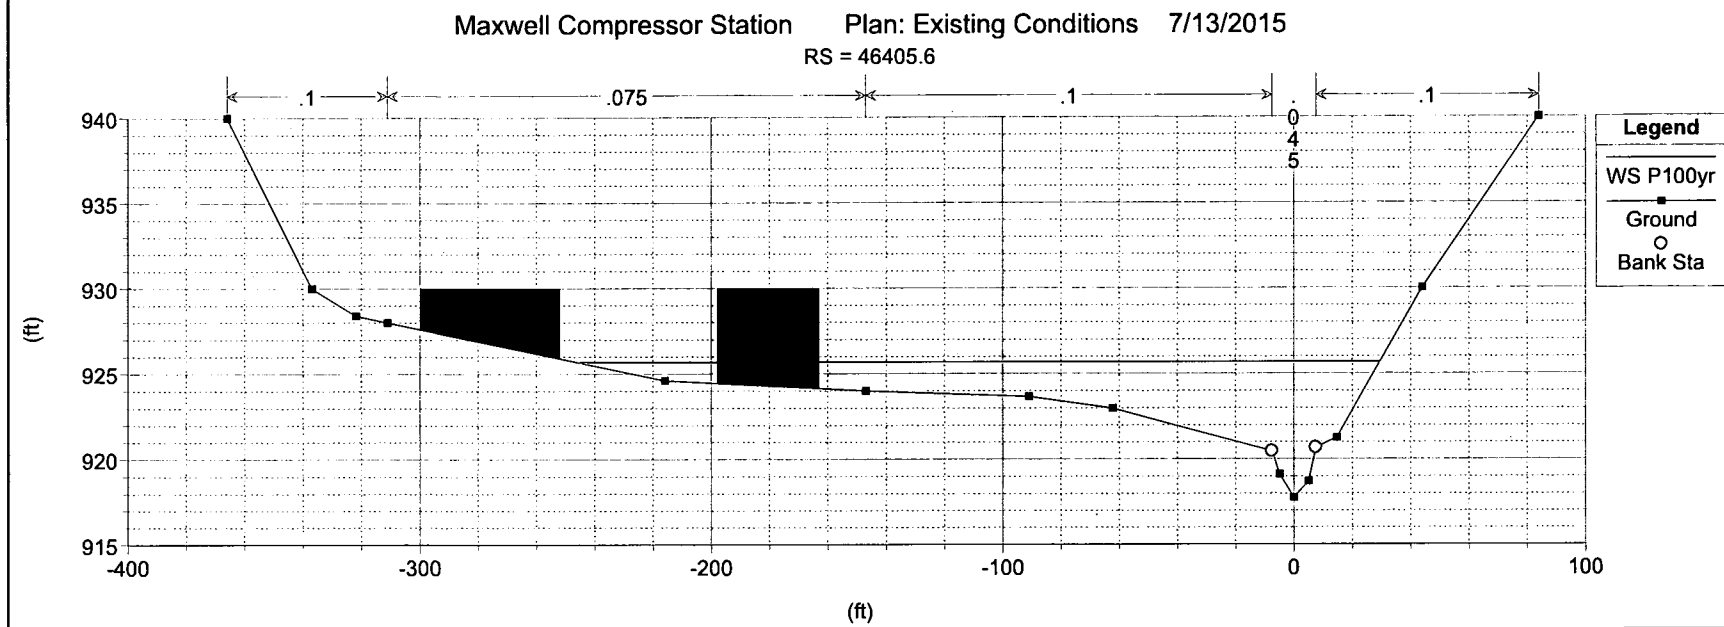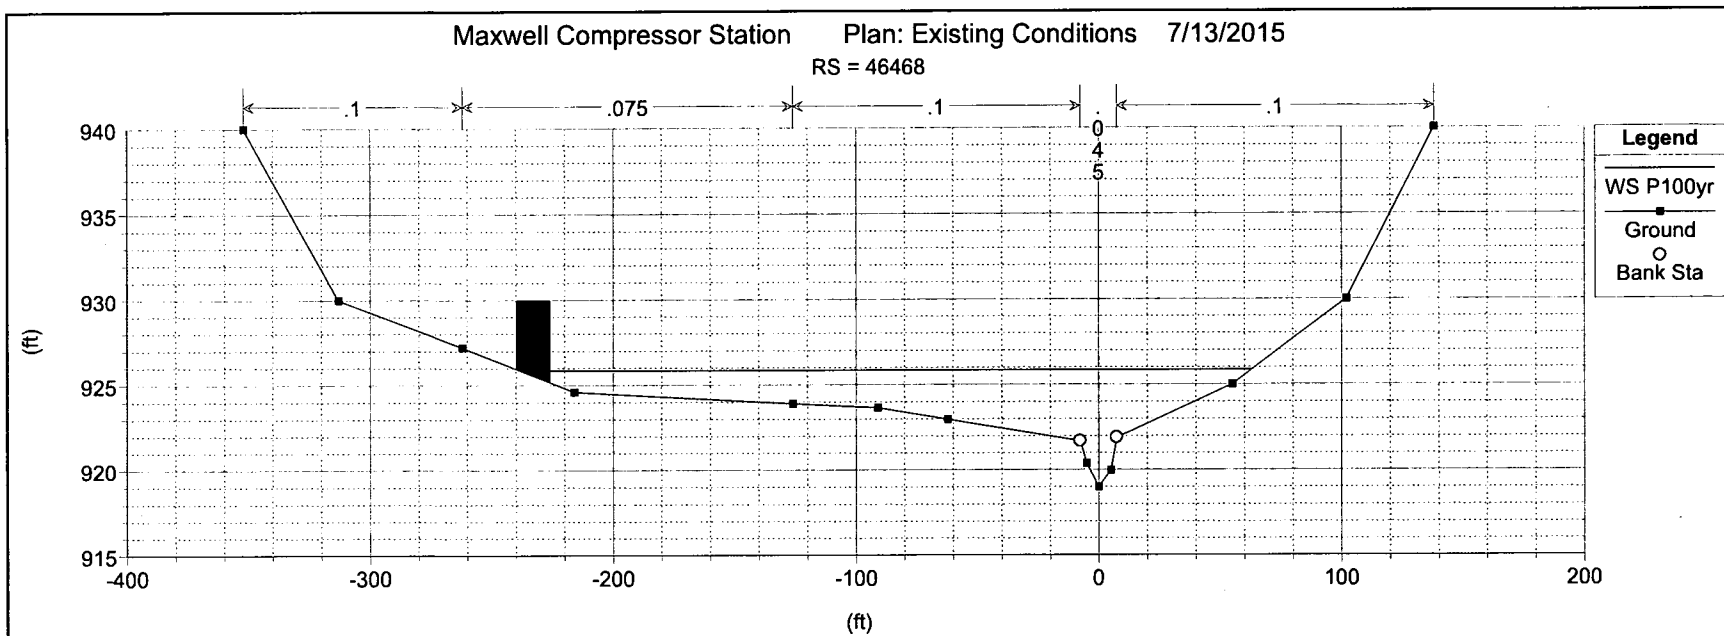

Maxwell Compressor Station Plan: Existing Conditions 7/13/2015
 RS = 46324.2

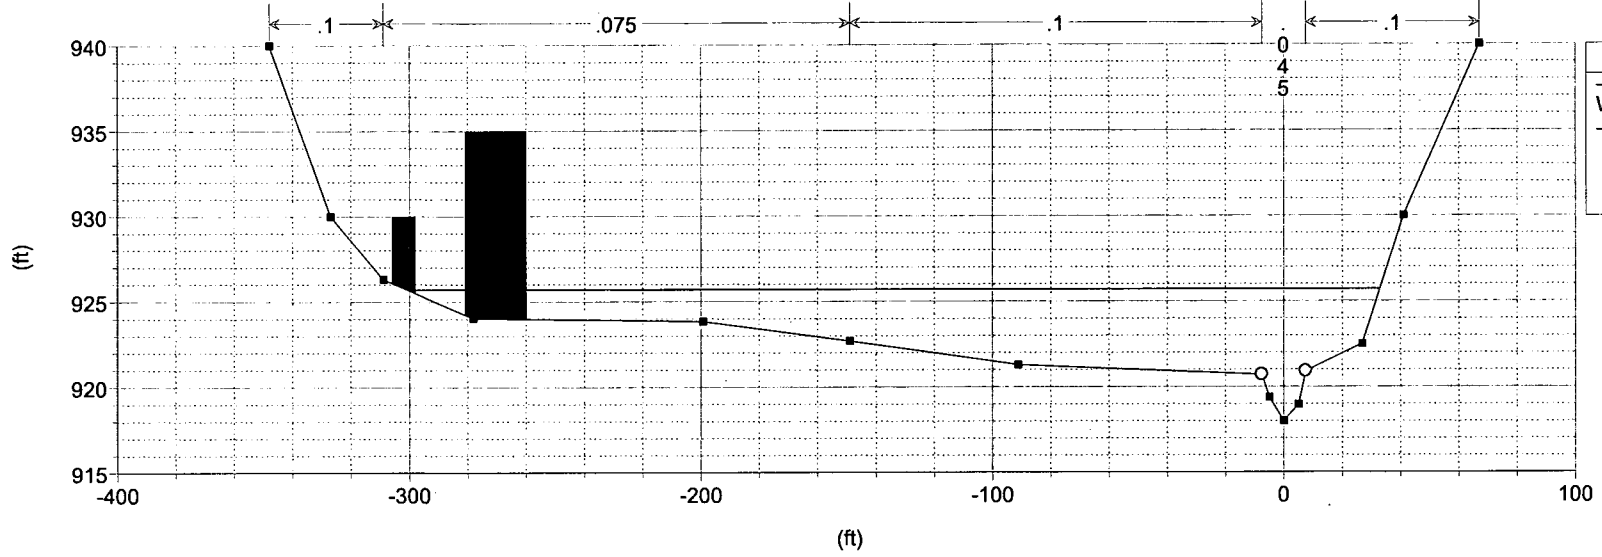


Maxwell Compressor Station Plan: Existing Conditions 7/13/2015
 RS = 46087.4

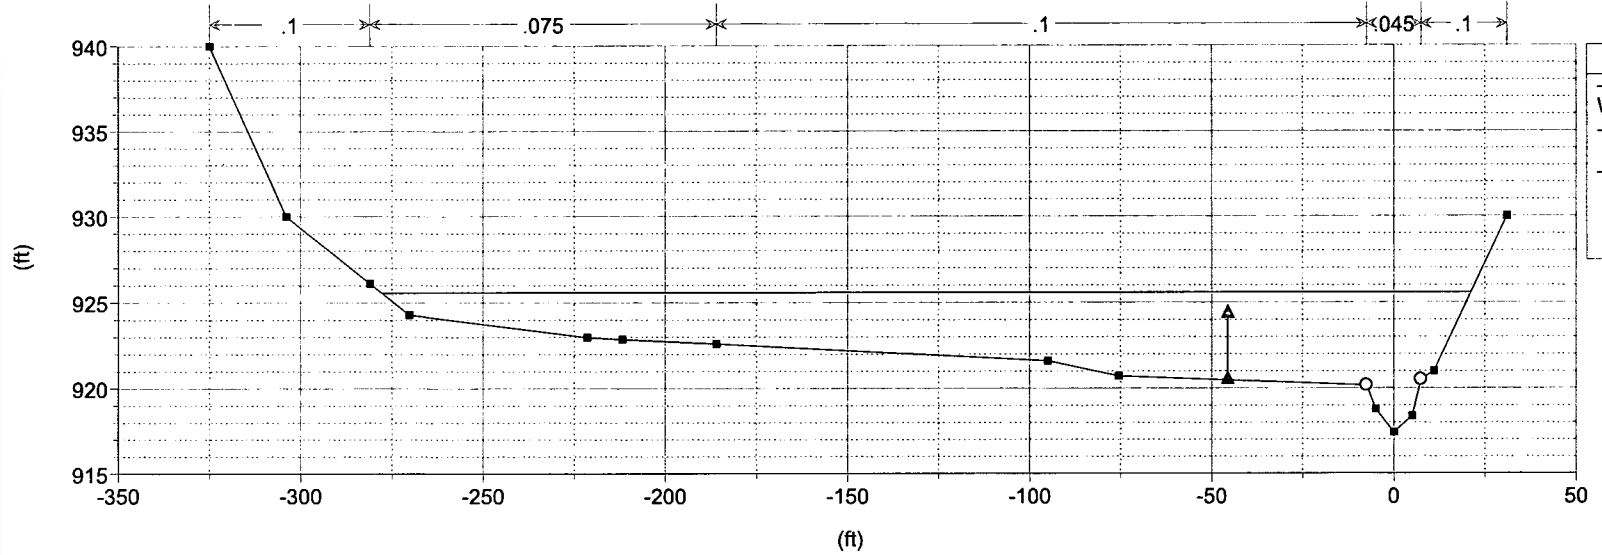


Maxwell Compressor Station Plan: Existing Conditions 7/13/2015

RS = 46080 Culv

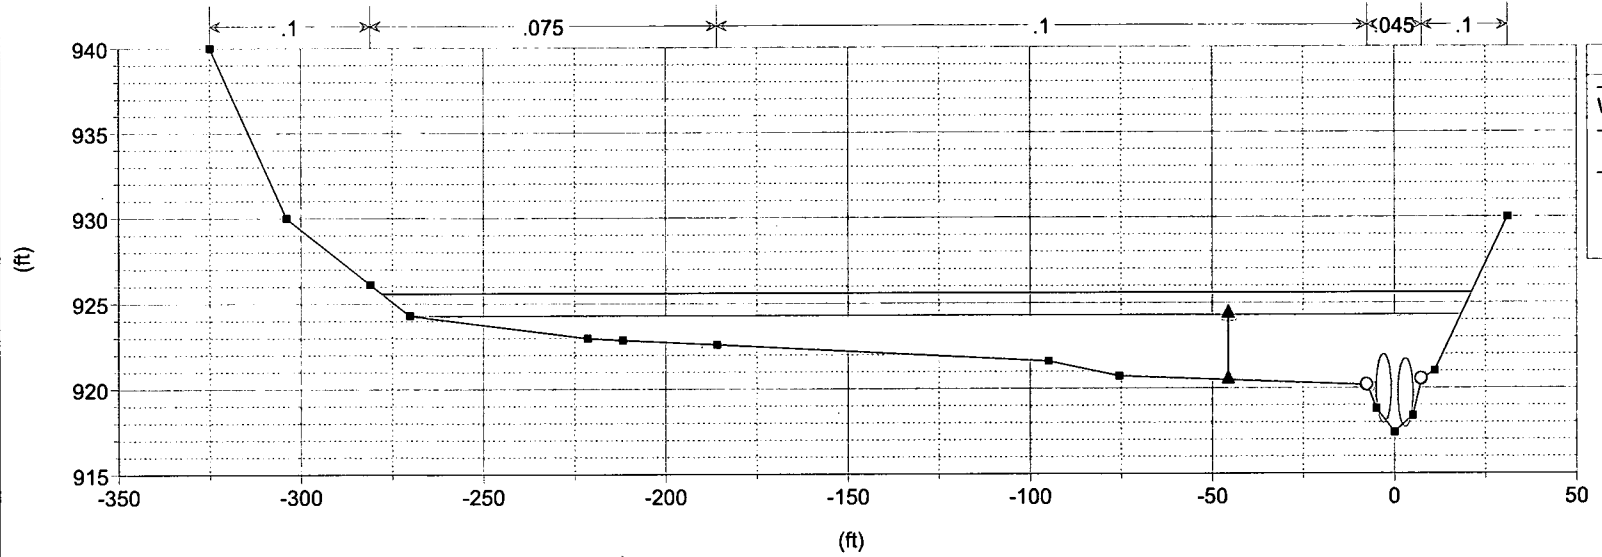


Maxwell Compressor Station Plan: Existing Conditions 7/13/2015


RS = 46080 Culv

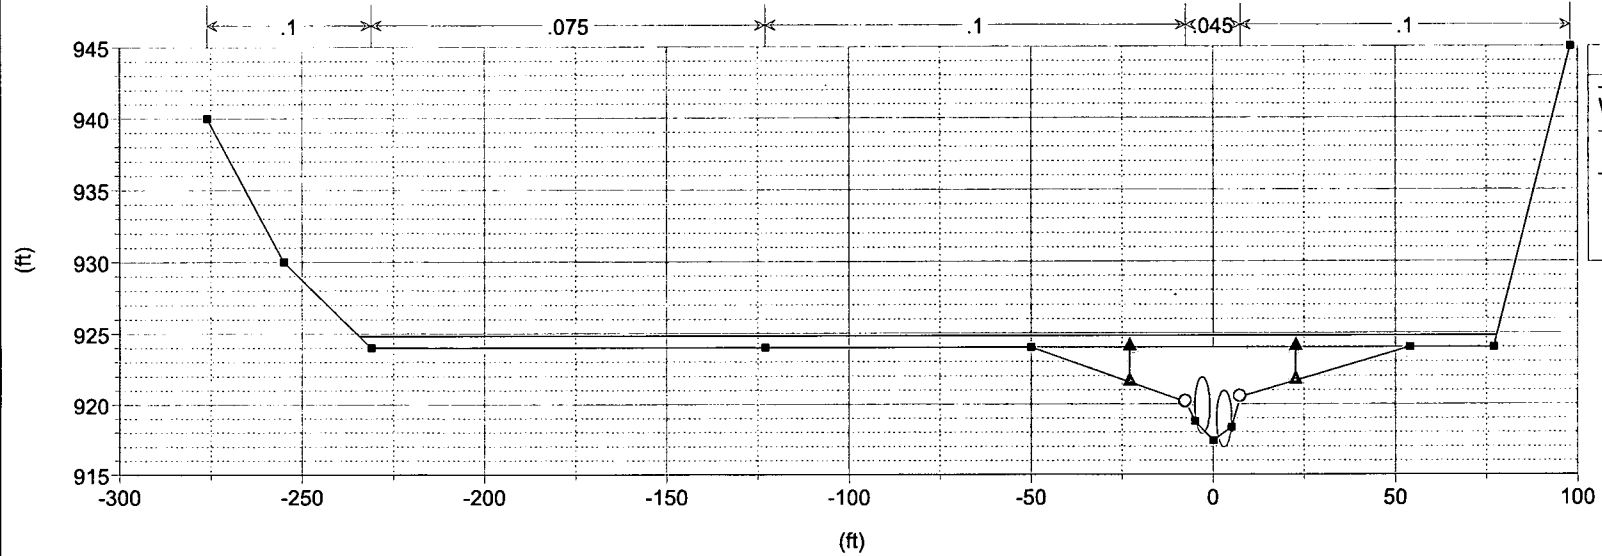

Maxwell Compressor Station Plan: Existing Conditions 7/13/2015
 RS = 46014.1

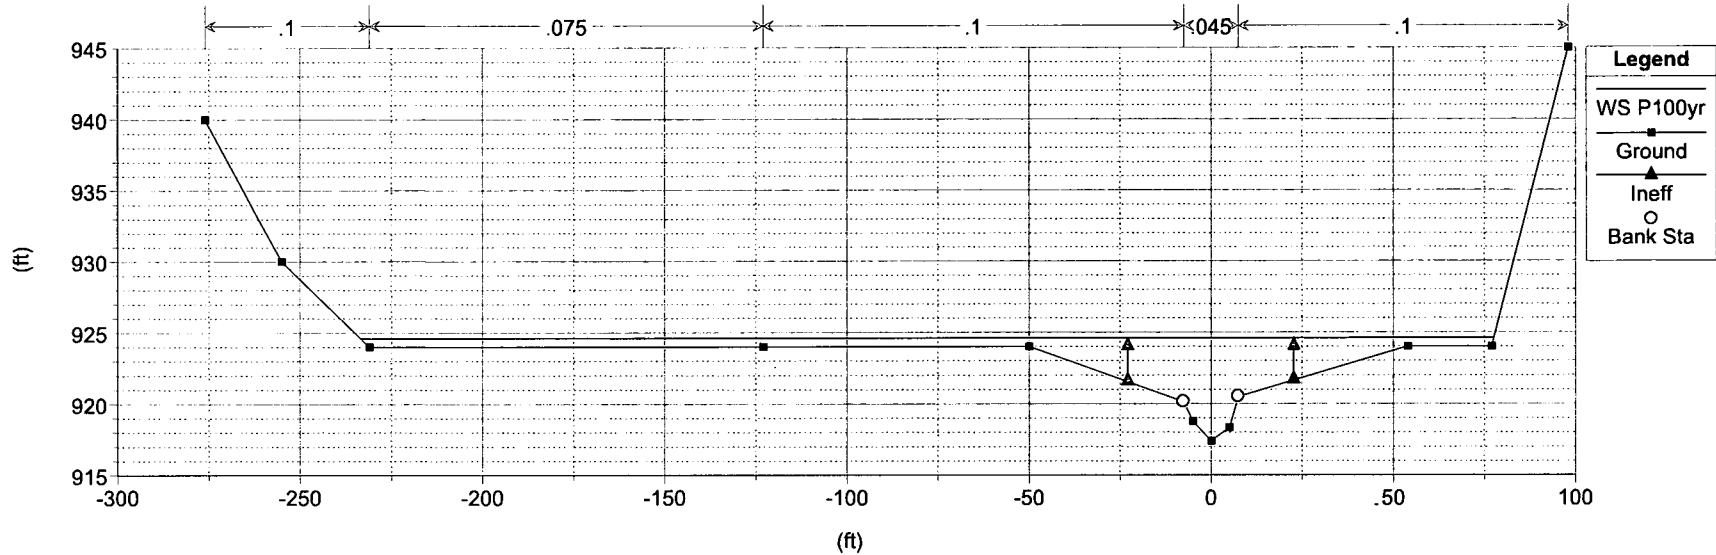


Maxwell Compressor Station Plan: Existing Conditions 7/13/2015
 RS = 45851.4

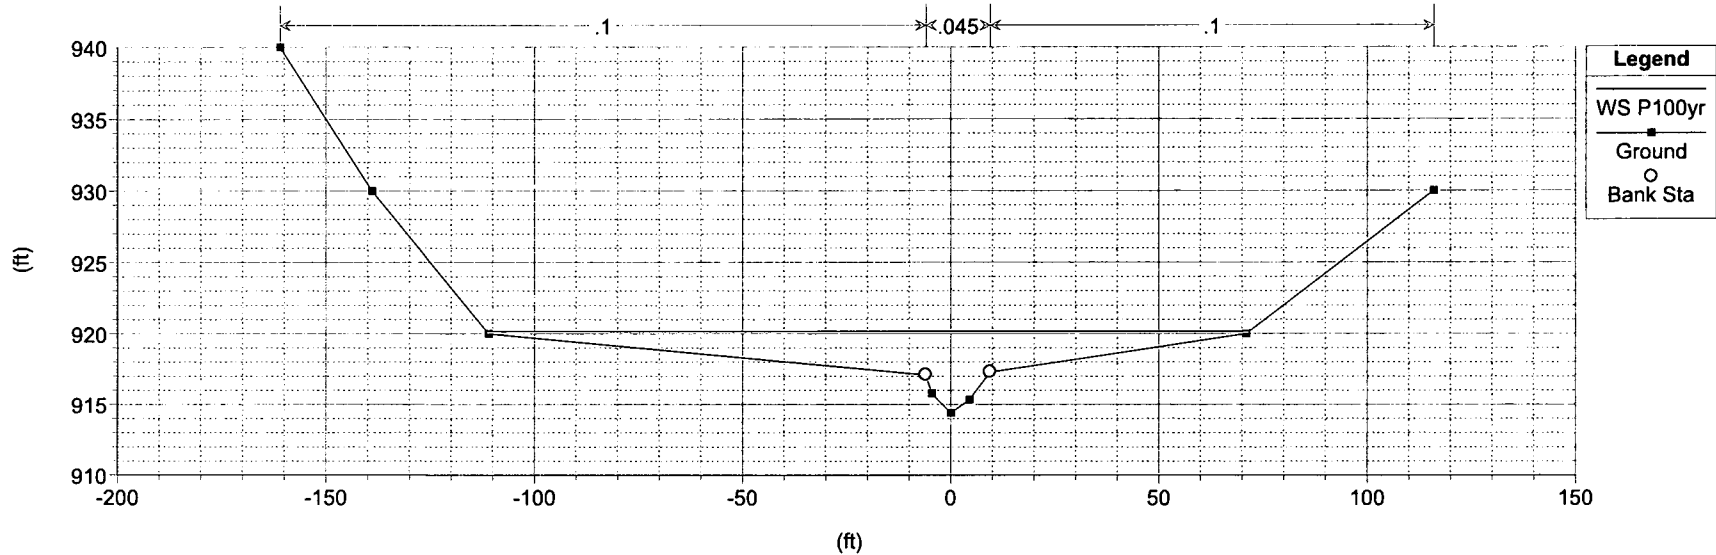

Maxwell Compressor Station Plan: Existing Conditions 7/13/2015

RS = 45723.6

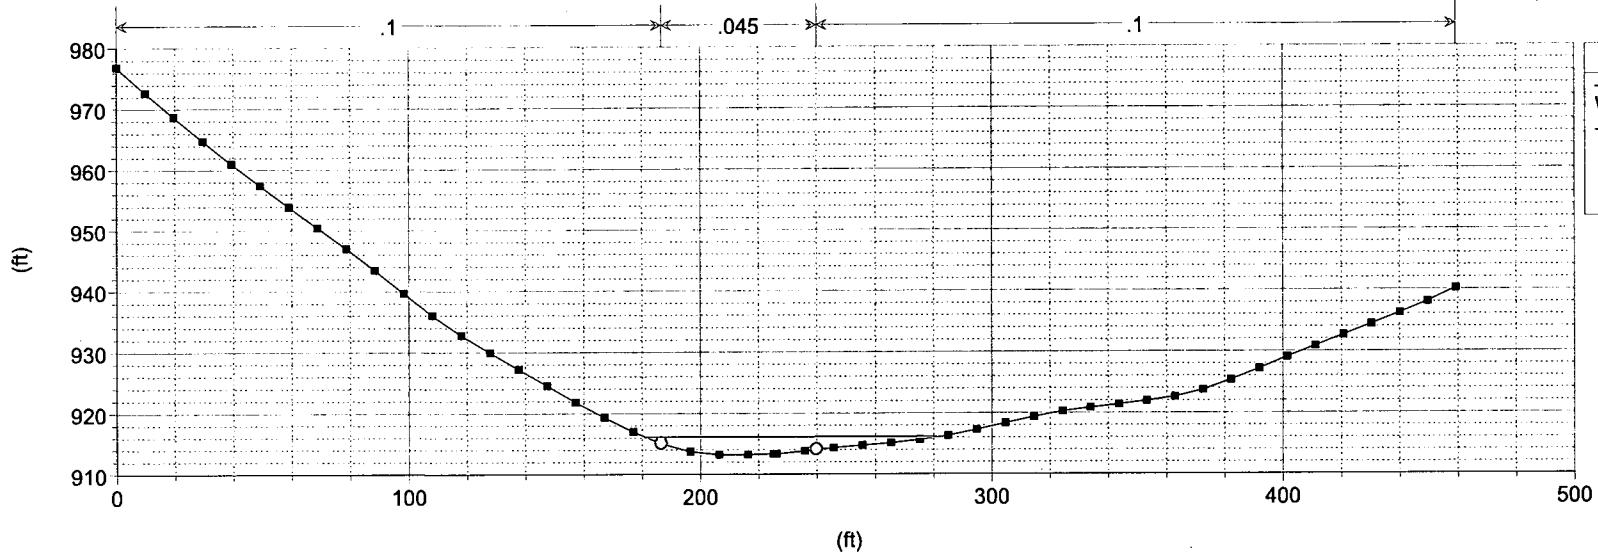

Legend

- WS P100yr
- Ground
- Bank Sta

Existing Conditions.txt

HEC-RAS Version 4.1.0 Jan 2010
 U.S. Army Corps of Engineers
 Hydrologic Engineering Center
 609 Second Street
 Davis, California

```

X   X  XXXXXX   XXXX   XXXX   XX   XXXX
X   X  X       X   X   X   X   X   X
X   X  X       X   X   X   X   X   X
XXXXXXXX XXXX   X       XXX XXXX   XXXXXX   XXXX
X   X  X       X   X   X   X   X   X
X   X  X       X   X   X   X   X   X
X   X  XXXXXX   XXXX   X   X   X   X   XXXXX
    
```

PROJECT DATA

Project Title: Maxwell Compressor Station
 Project File : SFHGHSRVR.prj
 Run Date and Time: 7/13/2015 12:03:11 PM

Project in English units

PLAN DATA

Plan Title: Existing Conditions
 Plan File : z:\Energy\2014\C141803.36 - Dom - Maxwell Station Hyd\Working
 Docs\Hydraulics\HEC-RAS\sfhghsrvr\sfhghsrvr_HEC_RAS\SFHGHSRVR.p02

Geometry Title: Existing Conditions
 Geometry File : z:\Energy\2014\C141803.36 - Dom - Maxwell Station Hyd\working
 Docs\Hydraulics\HEC-RAS\sfhghsrvr\sfhghsrvr_HEC_RAS\SFHGHSRVR.g02

Flow Title : TR-55 Flows
 Flow File : z:\Energy\2014\C141803.36 - Dom - Maxwell Station Hyd\working
 Docs\Hydraulics\HEC-RAS\sfhghsrvr\sfhghsrvr_HEC_RAS\SFHGHSRVR.f02

Plan Summary Information:

Number of: Cross Sections = 7 Multiple Openings = 0
 Culverts = 1 Inline Structures = 0
 Bridges = 0 Lateral Structures = 0

Computational Information

Water surface calculation tolerance = 0.01
 Critical depth calculation tolerance = 0.01
 Maximum number of iterations = 20
 Maximum difference tolerance = 0.3
 Flow tolerance factor = 0.001

Computation Options

Critical depth computed only where necessary
 Conveyance Calculation Method: At breaks in n values only
 Friction Slope Method: Average Conveyance
 Computational Flow Regime: Subcritical Flow

FLOW DATA

Flow Title: TR-55 Flows
 Flow File : z:\Energy\2014\C141803.36 - Dom - Maxwell Station Hyd\Working
 Docs\Hydraulics\HEC-RAS\sfhghsrvr\sfhghsrvr_HEC_RAS\SFHGHSRVR.f02

Flow Data (cfs)

River	Reach	RS	P100yr
SFHGHSRVR	Main	46468	1192

Boundary Conditions

River	Reach	Profile	Upstream	Downstream
SFHGHSRVR	Main	P100yr		Normal S = 0.02

GEOMETRY DATA

Geometry Title: Existing Conditions
 Geometry File : z:\Energy\2014\C141803.36 - Dom - Maxwell Station Hyd\Working

Existing Conditions.txt

Docs\Hydraulics\HEC-RAS\sfhghsrvr\sfhghsrvr_HEC_RAS\SFHGHSRVR.g02

CROSS SECTION

RIVER: SFHGHSRVR
REACH: Main RS: 46468

INPUT
Description:
Station Elevation Data num= 15

Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev
-352	940	-313	930	-262	927.2	-216	924.59	-126	923.9
-91	923.65	-62.2	922.98	-7.5	921.7	-5	920.37	0	919
5	919.96	7.5	921.9	55	925	102	930	138	940

Manning's n Values num= 5

Sta	n Val	Sta	n Val	Sta	n Val	Sta	n Val	Sta	n Val
-352	.1	-262	.075	-126	.1	-7.5	.045	7.5	.1

Bank Sta: Left Right Lengths: Left Channel Right Coeff Contr. Expan.

Left	Right	Left	Channel	Right	Coeff	Contr.	Expan.
-7.5	7.5	50	62.4	53	.1	.3	

Blocked Obstructions num= 1

Sta L	Sta R	Elev
-240	-226	930

CROSS SECTION

RIVER: SFHGHSRVR
REACH: Main RS: 46405.6

INPUT
Description:
Station Elevation Data num= 16

Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev
-366	940	-337	930	-321.8	928.4	-311	928	-216	924.59
-147	924	-91	923.65	-62.2	922.98	-7.5	920.45	-5	919.13
0	917.75	5	918.71	7.5	920.65	14.7	921.25	44	930
84	940								

Manning's n Values num= 5

Sta	n Val	Sta	n Val	Sta	n Val	Sta	n Val	Sta	n Val
-366	.1	-311	.075	-147	.1	-7.5	.045	7.5	.1

Bank Sta: Left Right Lengths: Left Channel Right Coeff Contr. Expan.

Left	Right	Left	Channel	Right	Coeff	Contr.	Expan.
-7.5	7.5	72	74	79	.1	.3	

Blocked Obstructions num= 2

Sta L	Sta R	Elev
-300	-252	930
	-198	-163

CROSS SECTION

RIVER: SFHGHSRVR
REACH: Main RS: 46324.2

INPUT
Description:
Station Elevation Data num= 15

Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev
-348	940	-327	930	-309	926.3	-278.1	924.03	-199.4	923.85
-149	922.7	-91.2	921.28	-7.5	920.7	-5	919.38	0	918
5	918.96	7.5	920.9	26.9	922.5	41	930	67	940

Manning's n Values num= 5

Sta	n Val	Sta	n Val	Sta	n Val	Sta	n Val	Sta	n Val
-348	.1	-309	.075	-149	.1	-7.5	.045	7.5	.1

Bank Sta: Left Right Lengths: Left Channel Right Coeff Contr. Expan.

Left	Right	Left	Channel	Right	Coeff	Contr.	Expan.
-7.5	7.5	191	245	236	.1	.3	

Blocked Obstructions num= 2

Sta L	Sta R	Elev
-306	-298	930
	-281	-260

CROSS SECTION

RIVER: SFHGHSRVR
REACH: Main RS: 46087.4

INPUT
Description:
Station Elevation Data num= 16

Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev
-325	940	-304	930	-281	926.1	-270.2	924.3	-221.5	922.98
-211.8	922.87	-186	922.6	-95	921.6	-75.5	920.72	-7.5	920.16
-5	918.79	0	917.41	5	918.37	7.5	920.51	11	921

Existing Conditions.txt

31 930

Manning's n Values num= 5
 Sta n Val Sta n Val Sta n Val Sta n Val
 -325 .1 -281 .075 -186 .1 -7.5 .045 7.5 .1

Bank Sta: Left Right Lengths: Left Channel Right Coeff Contr. Expan.
 -7.5 7.5 68 73.3 68.7 .3 .5

Ineffective Flow num= 1
 Sta L Sta R Elev Permanent
 -325 -45.5 924.3 F

CULVERT

RIVER: SFHGHSRVR
 REACH: Main RS: 46080

INPUT

Description:

Distance from Upstream XS = 38
 Deck/Roadway width = 20
 Weir Coefficient = 2.6

Upstream Deck/Roadway Coordinates

num= 2
 Sta Hi Cord Lo Cord Sta Hi Cord Lo Cord
 -270.2 924.3 100 924.3

Upstream Bridge Cross Section Data

Station Elevation Data num= 16
 Sta Elev Sta Elev Sta Elev Sta Elev Sta Elev
 -325 940 -304 930 -281 926.1 -270.2 924.3 -221.5 922.98
 -211.8 922.87 -186 922.6 -95 921.6 -75.5 920.72 -7.5 920.16
 -5 918.79 0 917.41 5 918.37 7.5 920.51 11 921
 31 930

Manning's n Values num= 5
 Sta n Val Sta n Val Sta n Val Sta n Val Sta n Val
 -325 .1 -281 .075 -186 .1 -7.5 .045 7.5 .1

Bank Sta: Left Right Coeff Contr. Expan.
 -7.5 7.5 .3 .5

Ineffective Flow num= 1
 Sta L Sta R Elev Permanent
 -325 -45.5 924.3 F

Downstream Deck/Roadway Coordinates

num= 2
 Sta Hi Cord Lo Cord Sta Hi Cord Lo Cord
 -50 924 71 924

Downstream Bridge Cross Section Data

Station Elevation Data num= 13
 Sta Elev Sta Elev Sta Elev Sta Elev Sta Elev
 -276 940 -255 930 -231 924 -123 924 -50 924
 -7.5 920.14 -5 918.77 0 917.39 5 918.35 7.5 920.49
 54 924 77 924 98 945

Manning's n Values num= 5
 Sta n Val Sta n Val Sta n Val Sta n Val Sta n Val
 -276 .1 -231 .075 -123 .1 -7.5 .045 7.5 .1

Bank Sta: Left Right Coeff Contr. Expan.
 -7.5 7.5 .3 .5

Ineffective Flow num= 2
 Sta L Sta R Elev Permanent
 -276 -22.8 924 F
 22.8 98 924 F

Upstream Embankment side slope = 0 horiz. to 1.0 vertical
 Downstream Embankment side slope = 0 horiz. to 1.0 vertical
 Maximum allowable submergence for weir flow = .98
 Elevation at which weir flow begins =
 Energy head used in spillway design =
 Spillway height used in design =
 Weir crest shape = Broad Crested

Number of Culverts = 2

Culvert Name Shape Rise Span
 Culvert #1 Circular 4
 FHWA Chart # 2 - Corrugated Metal Pipe Culvert
 FHWA Scale # 3 - Pipe projecting from fill
 Solution Criteria = Highest U.S. EG
 Culvert Upstrm Dist Length Top n Bottom n Depth Blocked Entrance Loss Coef Exit Loss Coef
 25 40 .022 .022 0 .9 1
 Upstream Elevation = 917.95
 Centerline Station = -3

Existing Conditions.txt

Station Elevation Data				num=	10				
Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev
-161	940	-139	930	-111	920	-6	917.09	-4.5	915.77
0	914.39	4.5	915.35	9.5	917.29	71	920	116	930

Manning's n Values				num=	3			
Sta	n Val	Sta	n Val	Sta	n Val	Sta	n Val	
-161	.1	-6	.045	9.5	.1			

Bank Sta:	Left	Right	Lengths:	Left Channel	Right	Coeff	Contr.	Expan.
	-6	9.5		138	191		.1	.3

CROSS SECTION

RIVER: SFHGHRSVR
 REACH: Main RS: 45723.6

INPUT

Description:

Station Elevation Data				num=	50				
Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev
0	976.89	9.8	972.73	19.6	968.69	29.5	964.78	39.3	961
49.1	957.4	59	953.91	68.8	950.47	78.6	947	88.4	943.4
98.3	939.69	108.1	936	117.9	932.81	127.8	929.94	137.6	927.23
147.4	924.5	157.2	921.83	167	919.37	176.9	917.01	186.7	915.02
196.5	913.77	206.4	913.24	216.2	913.2	225	913.31	226	913.32
235.8	913.81	240	914.03	245.7	914.32	255.5	914.73	265.3	915.1
275.2	915.64	285	916.34	294.8	917.3	304.6	918.32	314.4	919.32
324.3	920.23	333.9	920.81	343.6	921.37	353.2	921.91	362.8	922.58
372.5	923.68	382.1	925.3	391.8	927.16	401.4	929.04	411.1	930.85
420.7	932.63	430.3	934.4	440	936.19	449.6	938.04	459.3	940.19

Manning's n Values				num=	3			
Sta	n Val	Sta	n Val	Sta	n Val	Sta	n Val	
0	.1	186.7	.045	240	.1			

Bank Sta:	Left	Right	Lengths:	Left Channel	Right	Coeff	Contr.	Expan.
	186.7	240		0	0		.1	.3

SUMMARY OF MANNING'S N VALUES

River: SFHGHRSVR

Reach	River Sta.	n1	n2	n3	n4	n5
Main	46468	.1	.075	.1	.045	.1
Main	46405.6	.1	.075	.1	.045	.1
Main	46324.2	.1	.075	.1	.045	.1
Main	46087.4	.1	.075	.1	.045	.1
Main	46080	Culvert				
Main	46014.1	.1	.075	.1	.045	.1
Main	45851.4	.1	.045	.1		
Main	45723.6	.1	.045	.1		

SUMMARY OF REACH LENGTHS

River: SFHGHRSVR

Reach	River Sta.	Left	Channel	Right
Main	46468	50	62.4	53
Main	46405.6	72	74	79
Main	46324.2	191	245	236
Main	46087.4	68	73.3	68.7
Main	46080	Culvert		
Main	46014.1	175	170	156
Main	45851.4	138	191	121
Main	45723.6	0	0	0

SUMMARY OF CONTRACTION AND EXPANSION COEFFICIENTS

River: SFHGHRSVR

Reach	River Sta.	Contr.	Expan.
Main	46468	.1	.3
Main	46405.6	.1	.3
Main	46324.2	.1	.3
Main	46087.4	.3	.5

			Existing Conditions.txt
Main	46080	Culvert	
Main	46014.1	.3	.5
Main	45851.4	.1	.3
Main	45723.6	.1	.3

Subject: Dominion-2015 Maxwell Compressor Station – New Building, Doddridge County, WV
Hydraulic Calculations for Floodplain Development Application

By: BerkeME Date: 07/09/2015 Project #: C141803.36

Chkd By: ThomaMT Date: 07/13/2015 Sheet #: _____ of _____




gai consultants

PROPOSED CONDITIONS


HEC-RAS River: SFHGHSRVR Reach: Main Profile: P100yr

Reach	River Sta	Profile	Plan	Q Total (cfs)	Min Ch El (ft)	W.S. Elev (ft)	Crit W.S. (ft)	E.G. Elev (ft)	E.G. Slope (ft/ft)	Vel Chnl (ft/s)	Flow Area (sq ft)	Top Width (ft)	Froude # Chl
Main	45723.6	P100yr	Existing	1192.00	913.20	916.04	916.03	917.06	0.020026	8.43	176.28	99.16	0.95
Main	45723.6	P100yr	Proposed	1192.00	913.20	916.04	916.03	917.06	0.020026	8.43	176.28	99.16	0.95
Main	45851.4	P100yr	Existing	1192.00	914.39	920.10	920.10	920.88	0.011726	9.35	322.53	182.70	0.77
Main	45851.4	P100yr	Proposed	1192.00	914.39	920.10	920.10	920.88	0.011726	9.35	322.53	182.70	0.77
Main	46014.1	P100yr	Existing	1192.00	917.39	924.55	924.55	925.19	0.006028	8.05	417.74	310.76	0.57
Main	46014.1	P100yr	Proposed	1192.00	917.39	924.55	924.55	925.19	0.006028	8.05	417.74	310.76	0.57
Main	46080			Culvert									
Main	46087.4	P100yr	Existing	1192.00	917.41	925.52	922.96	925.56	0.000618	2.84	1079.31	298.55	0.19
Main	46087.4	P100yr	Proposed	1192.00	917.41	925.52	922.96	925.56	0.000618	2.84	1079.31	298.55	0.19
Main	46324.2	P100yr	Existing	1192.00	918.00	925.65		925.70	0.000717	2.95	1025.70	309.83	0.20
Main	46324.2	P100yr	Proposed	1192.00	918.00	925.65		925.70	0.000724	2.96	1012.34	292.83	0.20
Main	46405.6	P100yr	Existing	1192.00	917.75	925.63		925.83	0.002135	5.20	609.75	239.27	0.35
Main	46405.6	P100yr	Proposed	1192.00	917.75	925.63		925.83	0.002133	5.20	610.04	239.31	0.35
Main	46468	P100yr	Existing	1192.00	919.00	925.82		925.96	0.002211	4.73	687.43	288.70	0.35
Main	46468	P100yr	Proposed	1192.00	919.00	925.82		925.96	0.002209	4.73	687.73	288.71	0.35

Maxwell Compressor Station Plan: 1) Existing 7/13/2015 2) Proposed 7/13/2015

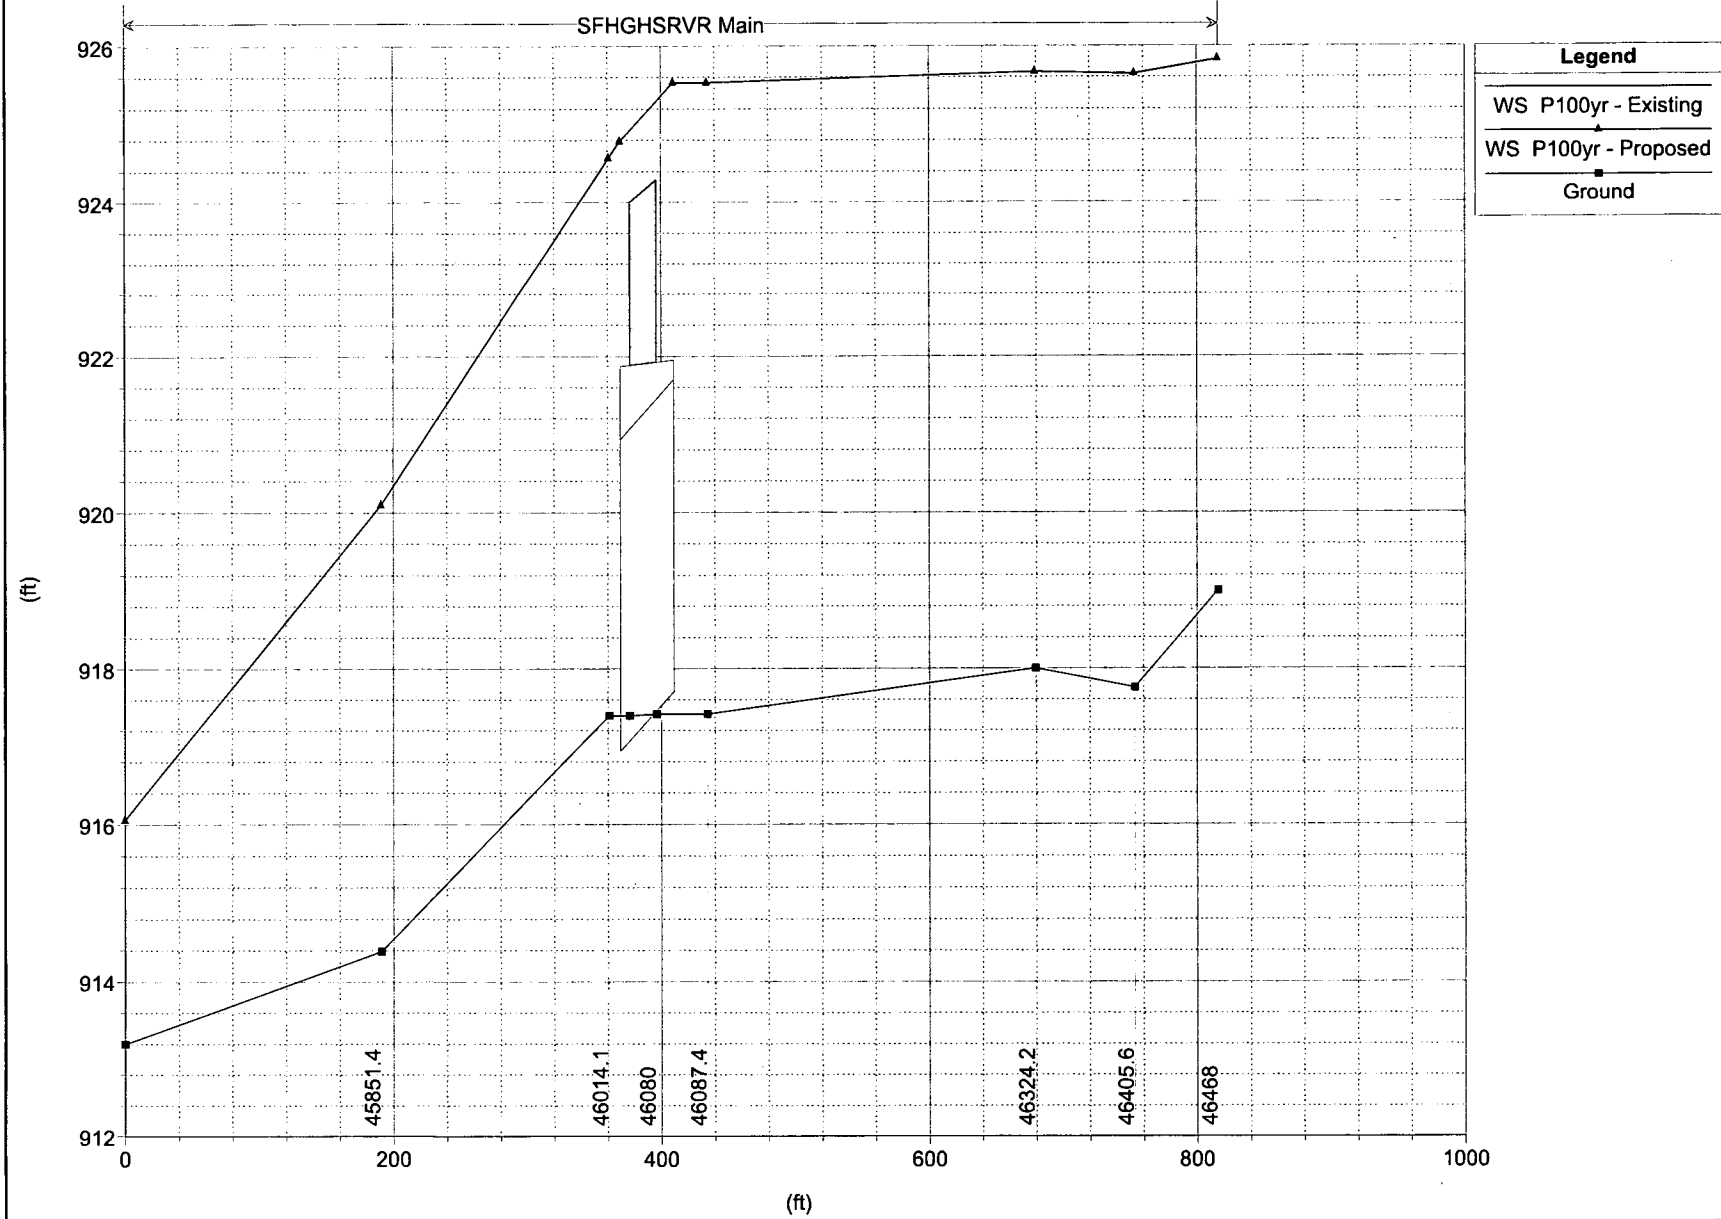

Maxwell Compressor Station Plan: Proposed Conditions 7/13/2015
 RS = 46324.2

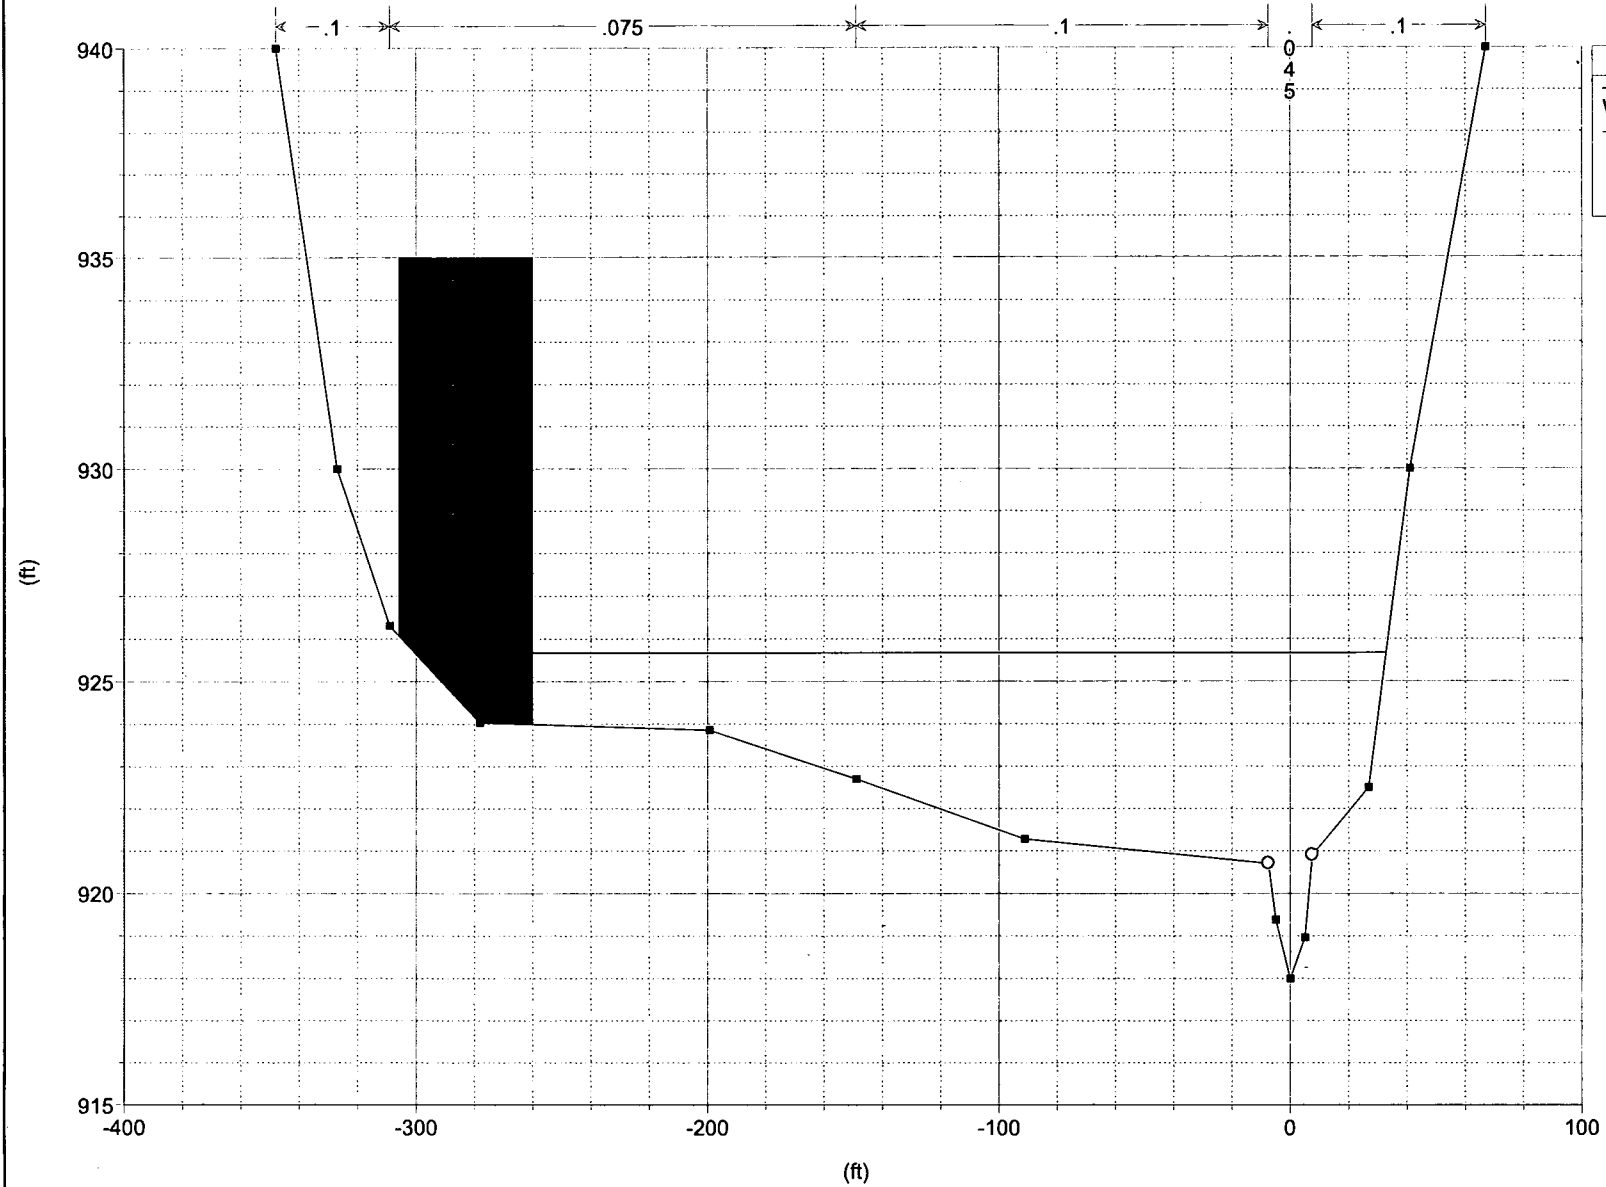

Legend

- WS P100yr
- Ground
- Bank Sta

Proposed Conditions.txt

HEC-RAS Version 4.1.0 Jan 2010
 U.S. Army Corps of Engineers
 Hydrologic Engineering Center
 609 Second Street
 Davis, California

```

X   X  XXXXXX   XXXX   XXXX   XX   XXXX
X   X  X       X  X   X  X   X  X   X
X   X  X       X  X   X  X   X  X   X
XXXXXXX XXXX   X       XXX XXXX   XXXXXX   XXXX
X   X  X       X  X   X  X   X  X   X
X   X  X       X  X   X  X   X  X   X
X   X  XXXXXX   XXXX   X  X   X  X   XXXXXX
    
```

PROJECT DATA

Project Title: Maxwell Compressor Station
 Project File : SFHGHSRVR.prj
 Run Date and Time: 7/13/2015 1:13:09 PM

Project in English units

PLAN DATA

Plan Title: Proposed Conditions
 Plan File : z:\Energy\2014\C141803.36 - Dom - Maxwell Station Hyd\working
 Docs\Hydraulics\HEC-RAS\sfhghsrvr\sfhghsrvr_HEC_RAS\SFHGHSRVR.p03

Geometry Title: Proposed Conditions
 Geometry File : z:\Energy\2014\C141803.36 - Dom - Maxwell Station Hyd\working
 Docs\Hydraulics\HEC-RAS\sfhghsrvr\sfhghsrvr_HEC_RAS\SFHGHSRVR.g04

Flow Title : TR-55 Flows
 Flow File : z:\Energy\2014\C141803.36 - Dom - Maxwell Station Hyd\working
 Docs\Hydraulics\HEC-RAS\sfhghsrvr\sfhghsrvr_HEC_RAS\SFHGHSRVR.f02

Plan Summary Information:

Number of: Cross Sections = 7 Multiple Openings = 0
 Culverts = 1 Inline Structures = 0
 Bridges = 0 Lateral Structures = 0

Computational Information

Water surface calculation tolerance = 0.01
 Critical depth calculation tolerance = 0.01
 Maximum number of iterations = 20
 Maximum difference tolerance = 0.3
 Flow tolerance factor = 0.001

Computation Options

Critical depth computed only where necessary
 Conveyance Calculation Method: At breaks in n values only
 Friction Slope Method: Average Conveyance
 Computational Flow Regime: Subcritical Flow

FLOW DATA

Flow Title: TR-55 Flows
 Flow File : z:\Energy\2014\C141803.36 - Dom - Maxwell Station Hyd\working
 Docs\Hydraulics\HEC-RAS\sfhghsrvr\sfhghsrvr_HEC_RAS\SFHGHSRVR.f02

Flow Data (cfs)

River	Reach	RS	P100yr
SFHGHSRVR	Main	46468	1192

Boundary Conditions

River	Reach	Profile	Upstream	Downstream
SFHGHSRVR	Main	P100yr		Normal S = 0.02

GEOMETRY DATA

Geometry Title: Proposed Conditions
 Geometry File : z:\Energy\2014\C141803.36 - Dom - Maxwell Station Hyd\working

Proposed Conditions.txt

Docs\Hydraulics\HEC-RAS\sfhghsrvr\sfhghsrvr_HEC_RAS\SFHGHSRVR.g04

CROSS SECTION

RIVER: SFHGHSRVR
REACH: Main RS: 46468

INPUT
Description:
Station Elevation Data num= 15

Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev
-352	940	-313	930	-262	927.2	-216	924.59	-126	923.9
-91	923.65	-62.2	922.98	-7.5	921.7	-5	920.37	0	919
5	919.96	7.5	921.9	55	925	102	930	138	940

Manning's n Values num= 5

Sta	n Val	Sta	n Val	Sta	n Val	Sta	n Val	Sta	n Val
-352	.1	-262	.075	-126	.1	-7.5	.045	7.5	.1

Bank Sta: Left Right Lengths: Left Channel Right Coeff Contr. Expan.

Left	Right	Left	Channel	Right	Coeff	Contr.	Expan.
-7.5	7.5	50	62.4	53	.1	.3	

Blocked Obstructions num= 1

Sta L	Sta R	Elev
-240	-226	930

CROSS SECTION

RIVER: SFHGHSRVR
REACH: Main RS: 46405.6

INPUT
Description:
Station Elevation Data num= 16

Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev
-366	940	-337	930	-321.8	928.4	-311	928	-216	924.59
-147	924	-91	923.65	-62.2	922.98	-7.5	920.45	-5	919.13
0	917.75	5	918.71	7.5	920.65	14.7	921.25	44	930
84	940								

Manning's n Values num= 5

Sta	n Val	Sta	n Val	Sta	n Val	Sta	n Val	Sta	n Val
-366	.1	-311	.075	-147	.1	-7.5	.045	7.5	.1

Bank Sta: Left Right Lengths: Left Channel Right Coeff Contr. Expan.

Left	Right	Left	Channel	Right	Coeff	Contr.	Expan.
-7.5	7.5	72	74	79	.1	.3	

Blocked Obstructions num= 2

Sta L	Sta R	Elev
-300	-252	930

CROSS SECTION

RIVER: SFHGHSRVR
REACH: Main RS: 46324.2

INPUT
Description:
Station Elevation Data num= 15

Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev
-348	940	-327	930	-309	926.3	-278.1	924.03	-199.4	923.85
-149	922.7	-91.2	921.28	-7.5	920.7	-5	919.38	0	918
5	918.96	7.5	920.9	26.9	922.5	41	930	67	940

Manning's n Values num= 5

Sta	n Val	Sta	n Val	Sta	n Val	Sta	n Val	Sta	n Val
-348	.1	-309	.075	-149	.1	-7.5	.045	7.5	.1

Bank Sta: Left Right Lengths: Left Channel Right Coeff Contr. Expan.

Left	Right	Left	Channel	Right	Coeff	Contr.	Expan.
-7.5	7.5	191	245	236	.1	.3	

Blocked Obstructions num= 1

Sta L	Sta R	Elev
-306	-260	935

CROSS SECTION

RIVER: SFHGHSRVR
REACH: Main RS: 46087.4

INPUT
Description:
Station Elevation Data num= 16

Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev
-325	940	-304	930	-281	926.1	-270.2	924.3	-221.5	922.98
-211.8	922.87	-186	922.6	-95	921.6	-75.5	920.72	-7.5	920.16
-5	918.79	0	917.41	5	918.37	7.5	920.51	11	921

Proposed Conditions.txt

31 930

Manning's n Values	num=	5							
Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val
-325 .1	-281 .075	-186 .1	-7.5 .045	7.5 .1					

Bank Sta: Left	Right	Lengths: Left	Channel	Right	Coeff	Contr.	Expan.
-7.5	7.5	68	73.3	68.7	.3	.5	

Ineffective Flow	num=	1
Sta L Sta R Elev	Permanent	F
-325 -45.5 924.3		

CULVERT

RIVER: SFHGHSRVR
 REACH: Main RS: 46080

INPUT
 Description:
 Distance from Upstream XS = 38
 Deck/Roadway width = 20
 Weir Coefficient = 2.6
 Upstream Deck/Roadway Coordinates
 num= 2

Sta Hi Cord	Lo Cord	Sta Hi Cord	Lo Cord
-270.2	924.3	100	924.3

Upstream Bridge Cross Section Data
 Station Elevation Data num= 16

Sta Elev	Sta Elev	Sta Elev	Sta Elev	Sta Elev	Sta Elev
-325 940	-304 930	-281 926.1	-270.2 924.3	-221.5 922.98	
-211.8 922.87	-186 922.6	-95 921.6	-75.5 920.72	-7.5 920.16	
-5 918.79	0 917.41	5 918.37	7.5 920.51	11 921	
31 930					

Manning's n Values	num=	5							
Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val
-325 .1	-281 .075	-186 .1	-7.5 .045	7.5 .1					

Bank Sta: Left	Right	Coeff	Contr.	Expan.
-7.5	7.5	.3	.5	

Ineffective Flow	num=	1
Sta L Sta R Elev	Permanent	F
-325 -45.5 924.3		

Downstream Deck/Roadway Coordinates
 num= 2

Sta Hi Cord	Lo Cord	Sta Hi Cord	Lo Cord
-50	924	71	924

Downstream Bridge Cross Section Data
 Station Elevation Data num= 13

Sta Elev	Sta Elev	Sta Elev	Sta Elev	Sta Elev	Sta Elev
-276 940	-255 930	-231 924	-123 924	-50 924	
-7.5 920.14	-5 918.77	0 917.39	5 918.35	7.5 920.49	
54 924	77 924	98 945			

Manning's n Values	num=	5							
Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val	Sta n Val
-276 .1	-231 .075	-123 .1	-7.5 .045	7.5 .1					

Bank Sta: Left	Right	Coeff	Contr.	Expan.
-7.5	7.5	.3	.5	

Ineffective Flow	num=	2
Sta L Sta R Elev	Permanent	F
-276 -22.8 924		
22.8 98 924		

Upstream Embankment side slope = 0 horiz. to 1.0 vertical
 Downstream Embankment side slope = 0 horiz. to 1.0 vertical
 Maximum allowable submergence for weir flow = .98
 Elevation at which weir flow begins =
 Energy head used in spillway design =
 Spillway height used in design =
 Weir crest shape = Broad Crested

Number of Culverts = 2

Culvert Name	Shape	Rise	Span						
Culvert #1	Circular	4							
FHWA Chart # 2 - Corrugated Metal Pipe Culvert									
FHWA Scale # 3 - Pipe projecting from fill									
Solution Criteria = Highest U.S. EG									
Culvert Upstrm Dist	Length	Top n	Bottom n	Depth Blocked	Entrance Loss Coef	Exit Loss Coef			
25	40	.022	.022	0	.9	1			
Upstream Elevation	= 917.95								
Centerline Station	= -3								

Proposed Conditions.txt

Station Elevation Data		num= 10		Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev
-161	940	-139	930	-111	920	-6	917.09	-4.5	915.77		
0	914.39	4.5	915.35	9.5	917.29	71	920	116	930		

Manning's n Values		num= 3		Sta	n Val	Sta	n Val	Sta	n Val
-161	.1	-6	.045	9.5	.1				

Bank Sta:	Left	Right	Lengths:	Left Channel	Right	Coeff	Contr.	Expan.
	-6	9.5		138	191		.1	.3

CROSS SECTION

RIVER: SFHGHRSVR
 REACH: Main RS: 45723.6

INPUT

Description:

Station Elevation Data		num= 50		Sta	Elev	Sta	Elev	Sta	Elev	Sta	Elev
0	976.89	9.8	972.73	19.6	968.69	29.5	964.78	39.3	961		
49.1	957.4	59	953.91	68.8	950.47	78.6	947	88.4	943.4		
98.3	939.69	108.1	936	117.9	932.81	127.8	929.94	137.6	927.23		
147.4	924.5	157.2	921.83	167	919.37	176.9	917.01	186.7	915.02		
196.5	913.77	206.4	913.24	216.2	913.2	225	913.31	226	913.32		
235.8	913.81	240	914.03	245.7	914.32	255.5	914.73	265.3	915.1		
275.2	915.64	285	916.34	294.8	917.3	304.6	918.32	314.4	919.32		
324.3	920.23	333.9	920.81	343.6	921.37	353.2	921.91	362.8	922.58		
372.5	923.68	382.1	925.3	391.8	927.16	401.4	929.04	411.1	930.85		
420.7	932.63	430.3	934.4	440	936.19	449.6	938.04	459.3	940.19		

Manning's n Values		num= 3		Sta	n Val	Sta	n Val
0	.1	186.7	.045	240	.1		

Bank Sta:	Left	Right	Lengths:	Left Channel	Right	Coeff	Contr.	Expan.
	186.7	240		0	0		.1	.3

SUMMARY OF MANNING'S N VALUES

River: SFHGHRSVR

Reach	River Sta.	n1	n2	n3	n4	n5
Main	46468	.1	.075	.1	.045	.1
Main	46405.6	.1	.075	.1	.045	.1
Main	46324.2	.1	.075	.1	.045	.1
Main	46087.4	.1	.075	.1	.045	.1
Main	46080	culvert				
Main	46014.1	.1	.075	.1	.045	.1
Main	45851.4	.1	.045	.1		
Main	45723.6	.1	.045	.1		

SUMMARY OF REACH LENGTHS

River: SFHGHRSVR

Reach	River Sta.	Left	Channel	Right
Main	46468	50	62.4	53
Main	46405.6	72	74	79
Main	46324.2	191	245	236
Main	46087.4	68	73.3	68.7
Main	46080	culvert		
Main	46014.1	175	170	156
Main	45851.4	138	191	121
Main	45723.6	0	0	0

SUMMARY OF CONTRACTION AND EXPANSION COEFFICIENTS

River: SFHGHRSVR

Reach	River Sta.	Contr.	Expan.
Main	46468	.1	.3
Main	46405.6	.1	.3
Main	46324.2	.1	.3
Main	46087.4	.3	.5

			Proposed Conditions.txt
Main	46080	Culvert	
Main	46014.1	.3	.5
Main	45851.4	.1	.3
Main	45723.6	.1	.3

ATTACHMENT 2


**DODDRIDGE COUNTY FLOODPLAIN
DEVELOPMENT PERMIT APPLICATION**

**DODDRIDGE COUNTY
FLOODPLAIN DEVELOPMENT PERMIT APPLICATION**

SECTION 1: GENERAL PROVISIONS (APPLICANT TO READ AND SIGN)

1. No work may start until a permit is issued.
2. The permit may be revoked if any false statements are made herein.
3. If revoked, all work must cease until permit is re-issued.
4. Development shall not be used or occupied until a Certificate of Compliance is issued.
5. The permit will expire if no work is commenced within six months of issuance.
6. Applicant is hereby informed that other permits may be required to fulfill local, state, and federal requirements.
7. Applicant hereby gives consent to the Floodplain Administrator/Manager or his/her representative to make inspections to verify compliance.
8. I THE APPLICANT CERTIFY THAT ALL STATEMENTS HEREIN AND IN ATTACHMENTS TO THIS APPLICATION ARE, TO THE BEST OF MY KNOWLEDGE, TRUE AND ACCURATE.

APPLICANT'S SIGNATURE _____



DATE _____

5-20-15

SECTION 2: PROPOSED DEVELOPMENT (TO BE COMPLETED BY APPLICANT).

IF THE APPLICANT IS NOT A NATURAL PERSON, THE NAME, ADDRESS, AND TELEPHONE NUMBER OF A NATURAL PERSON WHO SHALL BE APPOINTED BY THE APPLICANT TO RECEIVE NOTICE PURSUANT TO ANY PROVISION OF THE CURRENT DODDRIDGE COUNTY FLOODPLAIN ORDINANCE.

APPLICANT'S NAME: Dominion Transmission, Inc.

ADDRESS: 5000 Dominion Boulevard, Glen Allen, VA 23060

TELEPHONE NUMBER: (804) 273-3737

CONTRACTOR NAME: LR Builds, Inc. - Sheldon E. Raber, VP

ADDRESS: One Railroad Street, Shinnston, WV 26431

TELEPHONE # (304) 592-2083

WV CONTRACTOR LICENCE # WV000081

ENGINEER'S NAME: Derek Ingle

ADDRESS: 335 US Highway 33W, Weston, WV 26452

TELEPHONE NUMBER: (304) 269-6990

PROJECT LOCATION: GPS Coordinates: 39.1797950367, -80.7624598038

PHYSICAL ADDRESS: South Fork of Hughes River Road (CR 40) in West Union, West Virginia, 26456

NAME OF SURFACE OWNER/OWNERS (IF NOT THE APPLICANT): Dominion Transmission, Inc.

ADDRESS OF SURFACE OWNER/OWNERS (IF NOT THE APPLICANT):

445 West Main St, Clarksburg, WV 26301

DISTRICT: Southwest District

LAND BOOK DESCRIPTION: 5.4 acres & 0.89 acres

DEED BOOK REFERENCE: 5.4 acres - 83/272; 0.89 acres - 162/325

TAX MAP REFERENCE: Doddridge County – Southwest District – Map 10; Parcel Number Not Available

EXISTING BUILDINGS/USES OF PROPERTY: Existing DTI Compressor Station (Maxwell Station);

One compressor building and associated above-ground facilities on-site

NAME OF AT LEAST ONE ADULT RESIDING IN EACH RESIDENCE LOCATED UPON THE SUBJECT PROPERTY N/A

ADDRESS OF AT LEAST ONE ADULT RESIDING IN EACH RESIDENCE LOCATED UPON THE SUBJECT PROPERTY N/A

To avoid delay in processing the application, please provide enough information to easily identify the project location.

DESCRIPTION OF WORK (CHECK ALL APPLICABLE BOXES)

A. STRUCTURAL DEVELOPMENT

ACTIVITY	STRUCTURAL TYPE
<input checked="" type="checkbox"/> <u>New Structure</u>	<input type="checkbox"/> Residential (1 – 4 Family)
<input type="checkbox"/> Addition	<input type="checkbox"/> Residential (more than 4 Family)
<input type="checkbox"/> Alteration	<input type="checkbox"/> Non-residential (floodproofing)
<input type="checkbox"/> Relocation	<input type="checkbox"/> Combined Use (res. & com.)
<input type="checkbox"/> Demolition	<input type="checkbox"/> Replacement
<input type="checkbox"/> Manufactured/Mobil Home	<input checked="" type="checkbox"/> <u>Industrial (Compressor Station Building)</u>

B. OTHER DEVELOPMENT ACTIVITIES:

- Fill Mining Drilling Pipelining
- Grading
- Excavation (except for STRUCTURAL DEVELOPMENT checked above)
- Watercourse Alteration (including dredging and channel modification)
- Drainage Improvements (including culvert work)
- Road, Street, or Bridge Construction
- Subdivision (including new expansion)
- Individual Water or Sewer System
- Other (please specify)

C. STANDARD SITE PLAN OR SKETCH

1. SUBMIT ALL STANDARD SITE PLANS, IF ANY HAVE BEEN PREPARED (ENGINEERING PLANS MUST BE SIGNED AND SEALED).
2. IF STANDARD SITE PLANS HAVE NOT BEEN PREPARED:
SKETCH ON A SEPARATE 8 ½ X 11 INCH SHEET OF PAPER THE SHAPE AND LOCATION OF THE LOT. SHOW THE LOCATION OF THE INTENDED CONSTRUCTION OR LAND USE INDICATING BUILDING SETBACKS, SIZE & HEIGHT. IDENTIFY EXISTING BUILDINGS, STRUCTURES OR LAND USES ON THE PROPERTY.
3. SIGN AND DATE THE SKETCH.

ACTUAL TOTAL CONSTRUCTION COSTS OF THE COMPLETE DEVELOPMENT/ PROPOSED CONSTRUCTION PROJECT WITHIN THE FLOODPLAIN \$ 245,055.00

D. ADJACENT AND/OR AFFECTED LANDOWNERS:

1. NAME AND ADDRESS OF ALL OWNERS OF SURFACE TRACTS ADJACENT TO THE AREA OF THE SURFACE TRACT (UP & DOWN STREAM) UPON WHICH THE PROPOSED ACTIVITY WILL OCCUR AND ALL OTHER SURFACE OWNERS UP & DOWN STREAM) WHO OWN PROPERTY THAT MAY BE AFFECTED BY FLOODING AS IS DEMONSTRATED BY A FLOODPLAIN STUDY OR SURVEY (IF ONE HAS BEEN COMPLETED).

NAME: I.L. (Ike) Morris **ADDRESS:** P.O. Box 397, Glenville, WV 26351

2. NAME AND ADDRESS OF AT LEAST ONE ADULT RESIDING IN EACH RESIDENCE LOCATED UPON ANY ADJACENT PROPERTY AT THE TIME THE FLOODPLAIN PERMIT APPLICATION IS FILED AND THE NAME AND ADDRESS OF AT LEAST ONE ADULT RESIDING IN ANY HOME ON ANY PROPERTY THAT MAY BE AFFECTED BY FLOODING AS IS DEMONSTRATED BY A FLOODPLAIN STUDY OR SURVEY.

NAME: Same as Above

NAME: _____

ADDRESS: _____

ADDRESS: _____

E. CONFIRMATION FORM

THE APPLICANT ACKNOWLEDGES, AGREES, AND CONFIRMS THAT HE/IT WILL PAY WITHIN 30 DAYS OF RECEIPT OF INVOICE BY THE COUNTY FOR ALL EXPENSES RELATIVE TO THE PERMIT APPLICATION PROCESS GREATER THAN THE REQUIRED DEPOSIT FOR EXPENSES INCLUDING:

- (A) PERSONAL SERVICE OF PROCESS BY THE DODDRIDGE COUNTY SHERIFF AT THE RATES PERMITTED BY LAW FOR SUCH SERVICE.
- (B) SERVICE BY CERTIFIED MAIL RETURN RECEIPT REQUESTED.
- (C) PUBLICATION.
- (D) COURT REPORTING SERVICES AT ANY HEARINGS REQUESTED BY THE APPLICANT.
- (E) CONSULTANTS AND/OR HEARING EXPERTS UTILIZED BY DODDRIDGE COUNTY FLOODPLAIN ADMINISTRATOR/MANAGER OR FLOODPLAIN APPEALS BOARD FOR REVIEW OF MATERIALS AND/OR TESTIMONY REGARDING THE EFFICACY OF GRANTING OR DENYING THE APPLICANT'S FLOODPLAIN PERMIT.

NAME (PRINT): _____

SIGNATURE: _____

DATE: _____

After completing SECTION 2, APPLICANT should submit form and fees to Clerk of Doddridge County Court or his/her representative for review.

SECTION 3: FLOODPLAIN DETERMINATION (to be completed by Floodplain Administrator/Manager or his/her representative)

THE PROPOSED DEVELOPMENT:

THE PROPOSED DEVELOPMENT IS LOCATED ON:

FIRM Panel: _____

Dated: _____

- Is NOT located in a Specific Flood Hazard Area (Notify applicant that the application review is complete and NO FLOODPLAIN DEVELOPMENT PERMIT IS REQUIRED).

- Is located in Special Flood Hazard Area.
FIRM zone designation _____
100-Year flood elevation is _____ NGVD .
Stream name _____
Profile # _____

- Unavailable

- The proposed development is located in a floodway.

- See section 4 for additional instructions.

SIGNED _____

DATE _____

SECTION 4: ADDITIONAL INFORMATION REQUIRED FOR DEVELOPMENT IN SPECIAL FLOOD HAZARD AREA (To be completed by Floodplain Administrator/Manager or his/her representative)

The applicant must submit the documents checked below before the application can be processed.

- A plan showing the location of all existing structures, water bodies, adjacent roads and proposed development.

- Development plans, drawn to scale, and specifications, including where applicable: details for anchoring structures, storage tanks, proposed elevation of lowest floor, (including basement or crawl space), types of water resistant materials used below the first floor, details of flood proofing of utilities located below the first floor and details of enclosures below the first floor.
Also _____

- Subdivision or other development plans (If the subdivision or development exceeds 10 lots or 2 acres, whichever is the lesser, the applicant must provide 100-year flood elevations if they are not otherwise available).

- Plans showing the extent of watercourse relocation and/or landform alterations.

- Top of new fill elevation _____ Ft. NGVD.
For floodproofing structures applicant must attach certification from registered engineer or architect.
- Certification from a registered engineer that the proposed activity in a regulatory floodway will not result in any increase in the height of the 100-year flood. A copy of all data and calculations supporting this finding must also be submitted.
- Manufactured homes located in a Flood Hazard Area must have a West Virginia Contractor's License and a Manufactured Home Installation License as required by the Federal Emergency Management Agency (FEMA).
- Other: _____

SECTION 5: PERMIT DETERMINATION (To be completed by Floodplain Administrator/Manager or his/her representative)

I have determined that the proposed activity (type is or is not) in conformance with provisions of the Floodplain Ordinance adopted by the County Commission of Doddridge County on May 21, 2013. The permit is issued subject to the conditions attached to and made part of this permit.

SIGNED _____ DATE _____

If the Floodplain Administrator/Manager found that the above was not in conformance with the provisions of the Doddridge County Floodplain Ordinance and/or denied that application, the applicant may appeal.

APPEALS: Appealed to the County Commission of Doddridge County? Yes No
 Hearing Date: _____
 County Commission Decision - Approved Yes No

CONDITIONS: _____

SECTION 6: AS-BUILT ELEVATIONS (To be submitted by APPLICANT before Certificate of Compliance is issued). **As-Built Elevations will be provided after the building has been constructed.**

The following information must be provided for project structures. This section must be completed by a registered professional engineer or a licensed land surveyor (or attach a certification to this application).

COMPLETE 1 OR 2 BELOW:

- 1 Actual (As-Built) Elevation of the top of the lowest floor (including basement or crawl space is _____ FT. NGVD.
 - 2 Actual (As Built) elevation of floodproofing is _____ FT. NGVD.
- Note: Any work performed prior to submittal of the above information is at risk of the applicant.

SECTION 7: COMPLIANCE ACTION (To be completed by the Floodplain Administrator/Manager or his/her representative).

The Floodplain Administrator/Manager or his/her representative will complete this section as applicable based on inspection of the project to ensure compliance with the Doddridge County Floodplain Ordinance.

INSPECTIONS:

DATE: _____ BY: _____
DEFICIENCIES? Y/N

COMMENTS _____

SECTION 8: CERTIFICATE OF COMPLIANCE (To be completed by Floodplain Administrator/Manager or his/her representative).

Certificate of Compliance issued: DATE: _____ BY: _____

**CERTIFICATE OF COMPLIANCE
FOR DEVELOPMENT IN SPECIAL FLOOD HAZARD AREA (OWNER MUST RETAIN)**

PERMIT NUMBER: _____
PERMIT DATE: _____

PURPOSE –

CONSTRUCTION LOCATION: _____

OWNER'S ADDRESS: _____

THE FOLLOWING MUST BE COMPLETED BY THE FLOODPLAIN ADMINISTRATOR/MANAGER OR HIS/HER AGENT.

COMPLIANCE IS HEREBY CERTIFIED WITH THE REQUIREMENT OF THE FLOODPLAIN ORDINANCE ADOPTED BY THE COUNTY COMMISSION OF DODDRIDGE COUNTY ON MAY 21, 2013.

SIGNED _____ DATE _____

HOLD TO LIGHT TO VIEW WATERMARK IN PAPER HEAT SENSITIVE RED IMAGE DISAPPEARS WITH HEAT DETECTION CIRCLE REVEALS A LOCK WHEN TESTED

18125

Environment & Archaeology, LLC
221 Main Street
Florence, KY 41042
(859) 746-1778

CHASE
JPMorgan Chase Bank, N.A.
www.Chase.com
25-3-440

5/13/2015

PAY TO THE
ORDER OF

Doddridge County Commission

\$ **1,730.00

One Thousand Seven Hundred Thirty and 00/100*****

DOLLARS

Doddridge County Commission



[Handwritten Signature]
AUTHORIZED SIGNATURE

MEMO

⑈018125⑈ ⑈044000037⑈

617990304⑈

Environment & Archaeology, LLC

18125

Doddridge County Commission				5/13/2015	
Date	Type	Reference	Original Amt.	Balance Due	Discount
5/13/2015	Bill		1,730.00	1,730.00	
				Check Amount	1,730.00

Security features. Details on back

ENCLOSURE 2
PROJECT MAPPING

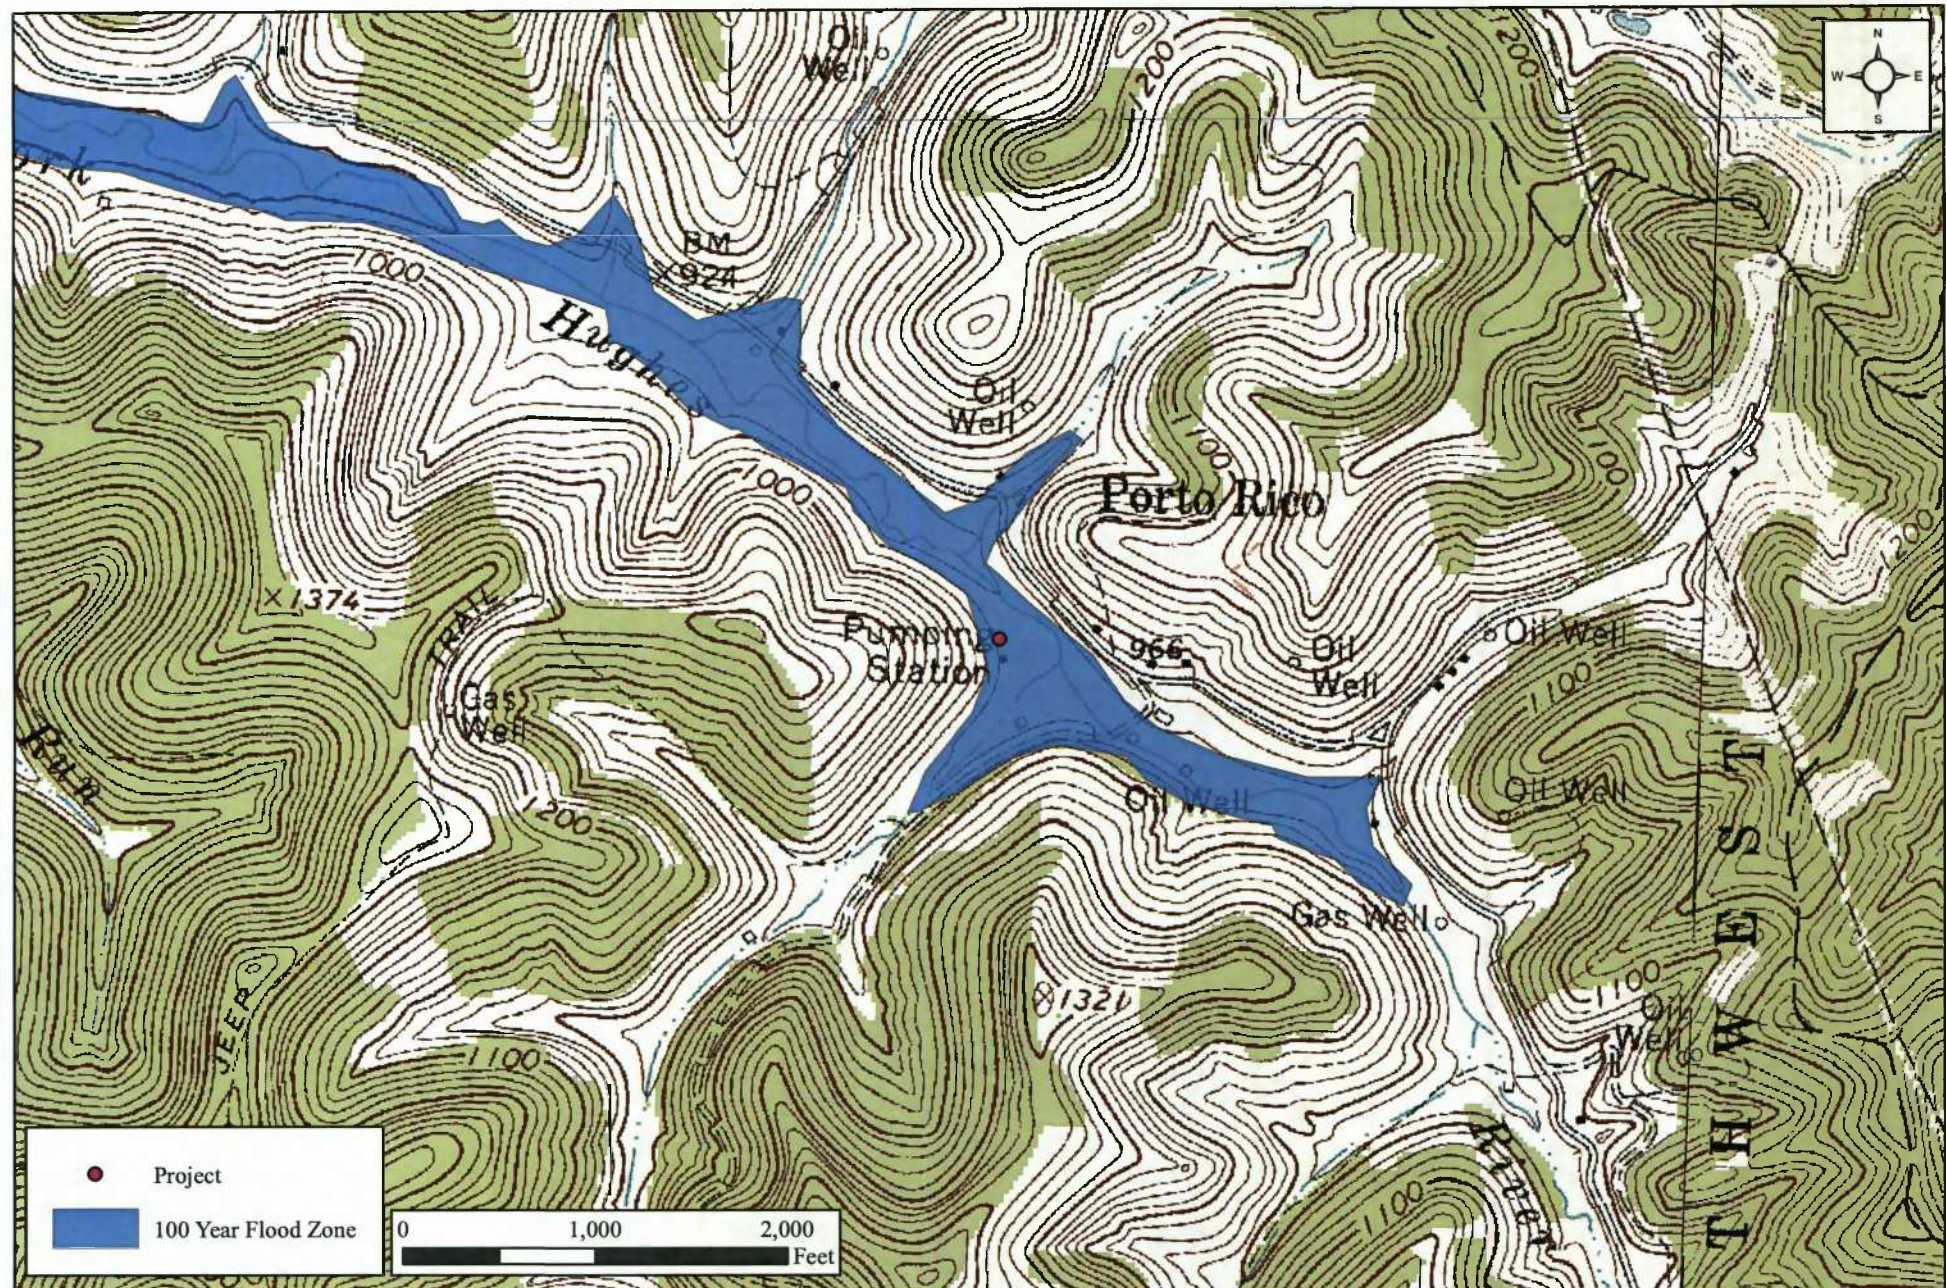


Figure 1

Dominion Transmission, Inc.
 Maxwell Station Project
 Doddridge County, West Virginia

USGS 7.5 Topographic Map with FEMA Overlay
 Oxford, WV Quadrangle
 1:12,000
 Environment & Archaeology
 LLC

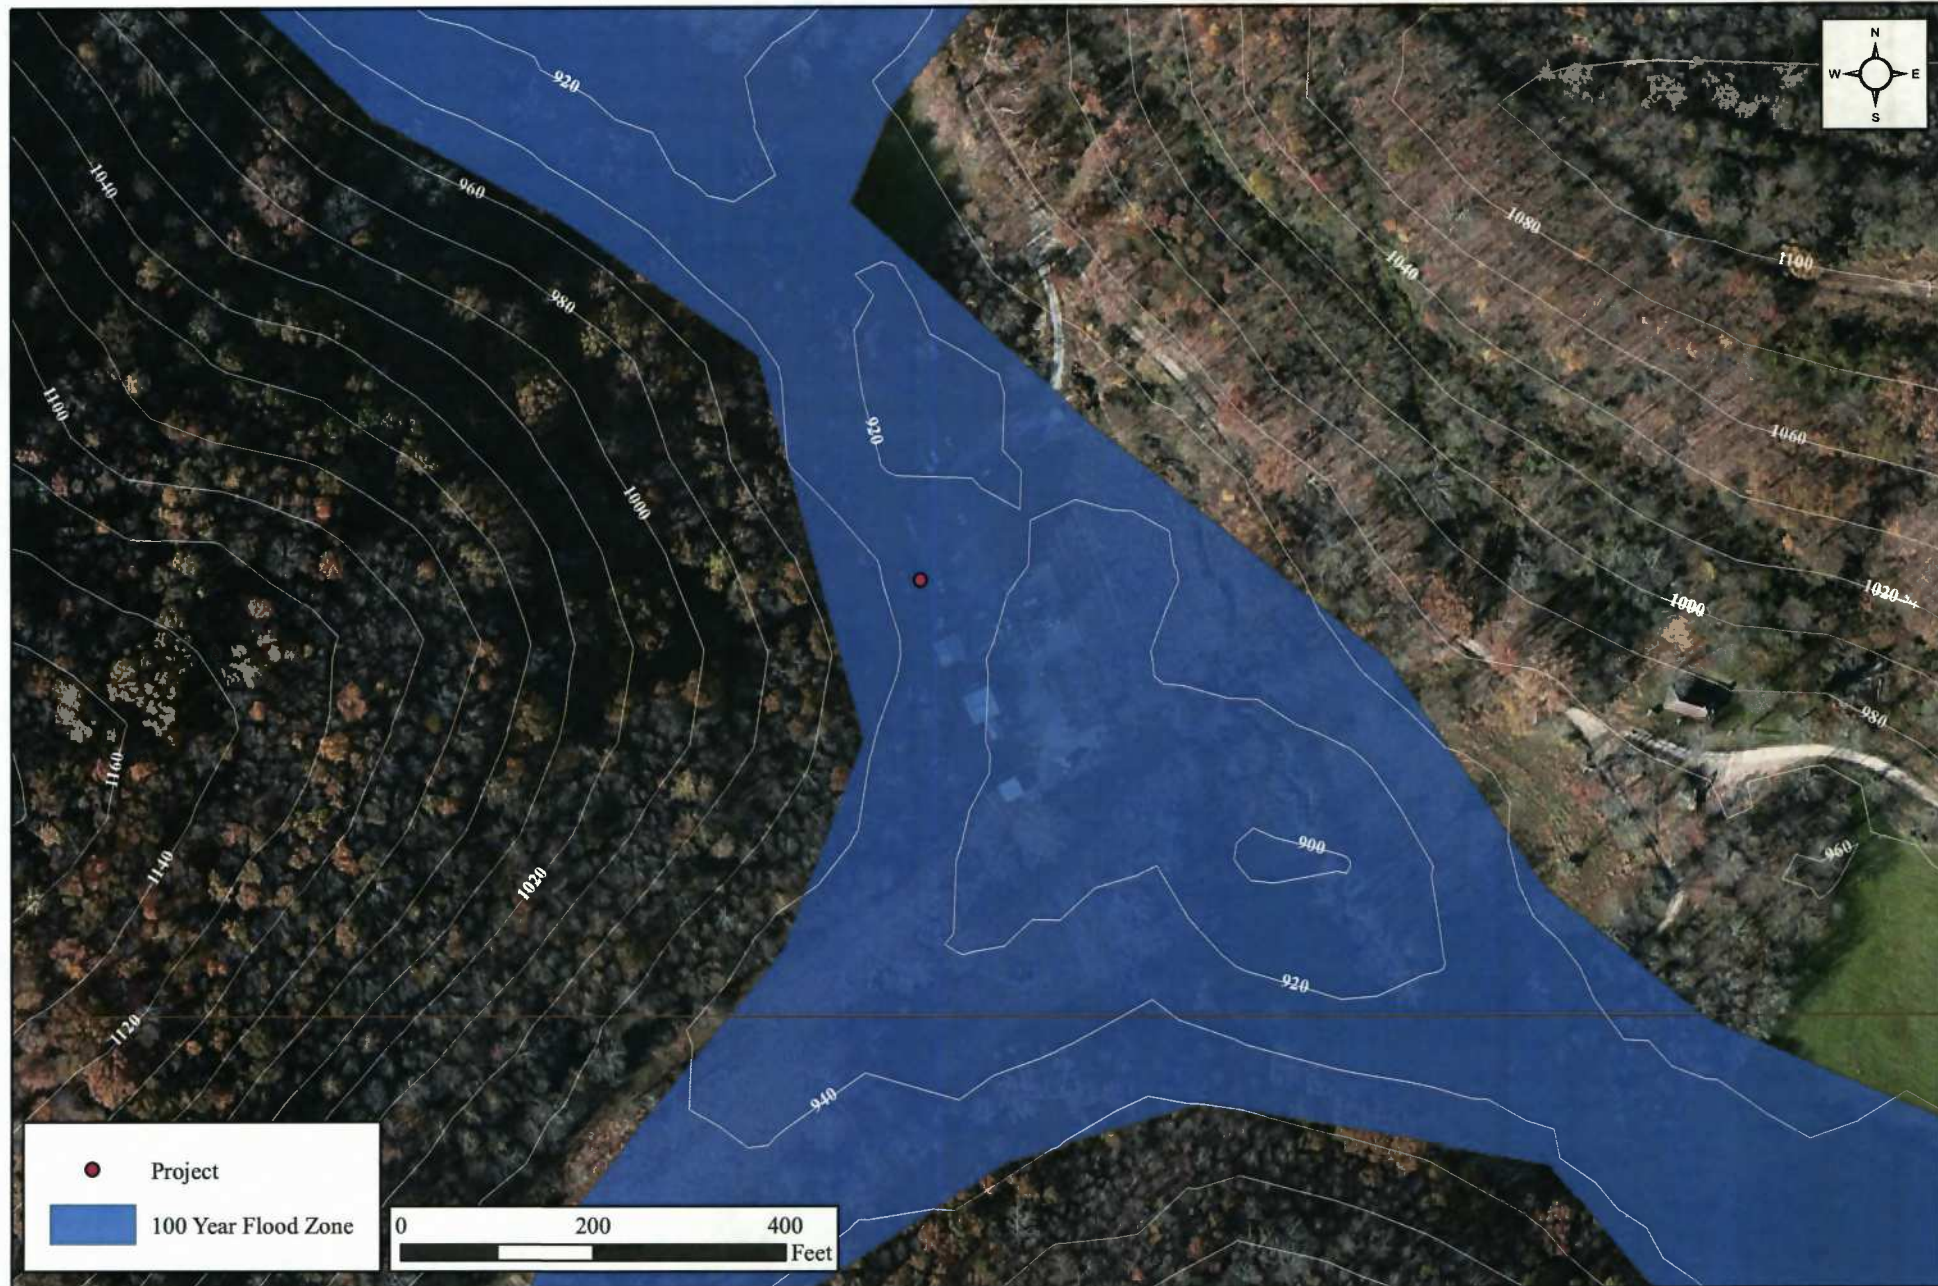


Figure 2

Dominion Transmission, Inc.
 Maxwell Station Project
 Doddridge County, West Virginia

Aerial Map
 Aerial Provided by ESRI Map Services
 1:2,400
Environment & Archaeology
 LLC

ENCLOSURE 3
SITE PHOTOGRAPHS



Photo: 1 Date: 4-28-2015 Comments: View of the existing gravel access drive and lot associated with the Maxwell Compressor Station, facing south.



Photo: 2 Date: 4-28-2015 Comments: View of proposed workspace associated with the new building installation, facing WSW.



Photo: 3 Date: 4-28-2015 Comments: Overview of location of new compressor building, approximately 40 feet in front of the existing building, facing ENE.



Photo: 4 Date: 4-28-2015 Comments: View of existing compressor building, and location of proposed new building, facing east.

The Doddridge Independent

The Doddridge Independent PUBLISHER'S CERTIFICATE

I, Michael D. Zorn, Publisher of The Doddridge Independent, A newspaper of general circulation published in the town of West Union, Doddridge County, West Virginia, do hereby certify that:

Dominion Transmission, Inc.

filed an application for a Floodplain Permit to develop land located at or about:

Southwest District

39.1797950367N/80.7624598038W

Permit #15-361 · 2015 Maxwell Compressor Station - New Building

was published in The Doddridge Independent 2 times commencing on Friday, June 19, 2015 and Ending on Friday, June 26, 2015 at the request of:

Edwin Wriston, Doddridge County Floodplain Manager & Doddridge County Commission


Given under my hand this Monday, June 29, 2015

The publisher's fee for said publication is:

**\$ 25.27 1st Run/\$ 18.95 Subsequent Runs
This Legal Ad Total: \$ 44.22**


Michael D. Zorn
Publisher of The Doddridge Independent

Subscribed to and sworn to before me on
this date: 29, June 2015



Notary Public in and for Doddridge County
My Commission expires on

The 16 day of MAY 2019

Legal Advertisement:
Doddridge County
Floodplain Permit Application

Please take notice that on the 1st day of June, 2015
Dominion Transmission, Inc.
filed an application for a Floodplain Permit to develop land located at or about:

Southwest District
39.1797950367N/80.7624598038W
Permit #15-361 2015 Maxwell Compressor Station - New Building
The Application is on file with the Clerk of the County Court and may be inspected or copied during regular business hours. As this project is outside the FEMA identified floodplain of Doddridge County, Doddridge County Floodplain Management has no regulatory authority. Any interested persons who desire to comment shall present the same in writing by July 06, 2015, delivered to:

Clerk of the County Court
118 E. Court Street, West Union, WV 26456
Beth A Rogers, Doddridge County Clerk
Edwin L. "Bo" Wriston, Doddridge County Flood Plain Manager
5/22 - 5/28

Legal Advertisement:
Doddridge County
Floodplain Permit Application

Please take notice that on the 1st day of June, 2015
Dominion Transmission, Inc.
filed an application for a Floodplain Permit to develop land located at or about:

Southwest District
39.1797950367N/80.7624598038W
Permit #15-361 2015 Maxwell Compressor Station - New Building
The Application is on file with the Clerk of the County Court and may be inspected or copied during regular business hours. As this project is outside the FEMA identified floodplain of Doddridge County, Doddridge County Floodplain Management has no regulatory authority. Any interested persons who desire to comment shall present the same in writing by July 06, 2015, delivered to:

Clerk of the County Court
118 E. Court Street, West Union, WV 26456
Beth A Rogers, Doddridge County Clerk
Edwin L. "Bo" Wriston, Doddridge County Flood Plain Manager
5/22 - 5/28

